



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
NOT GIVEN PH0001871 (S/N NO INFO ON SIF/BOTTLE)

Component
Gearbox
 Fluid
SHELL OMALA S2 GX 100 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PH0001871	---	---
Sample Date		Client Info		05 Jan 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>200	27	---	---
Chromium	ppm	ASTM D5185m	>15	<1	---	---
Nickel	ppm	ASTM D5185m	>15	<1	---	---
Titanium	ppm	ASTM D5185m		<1	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	2	---	---
Lead	ppm	ASTM D5185m	>100	0	---	---
Copper	ppm	ASTM D5185m	>200	<1	---	---
Tin	ppm	ASTM D5185m	>25	<1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION









There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>50	3	---	---
Potassium	ppm	ASTM D5185m	>20	1	---	---
Water		WC Method	>0.2	NEG	---	---
Particles >4µm		ASTM D7647	>10000	8412	---	---
Particles >6µm		ASTM D7647	>2500	1778	---	---
Particles >14µm		ASTM D7647	>320	112	---	---
Particles >21µm		ASTM D7647	>80	31	---	---
Particles >38µm		ASTM D7647	>20	2	---	---
Particles >71µm		ASTM D7647	>4	0	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/18/14	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		<1	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		<1	---	---
Calcium	ppm	ASTM D5185m		3	---	---
Phosphorus	ppm	ASTM D5185m		301	---	---
Zinc	ppm	ASTM D5185m		0	---	---
Sulfur	ppm	ASTM D5185m		8480	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		0.48	---	---
Visc @ 40°C	cSt	ASTM D445		96.3	---	---

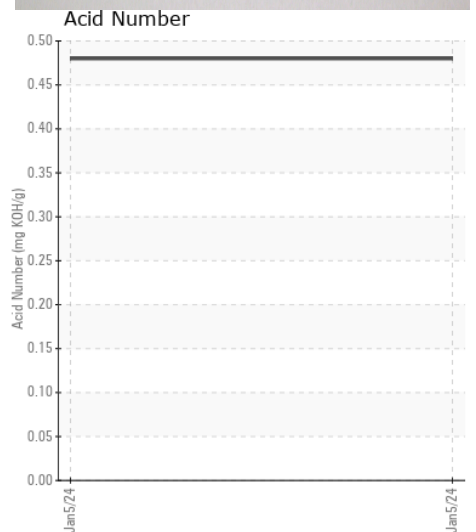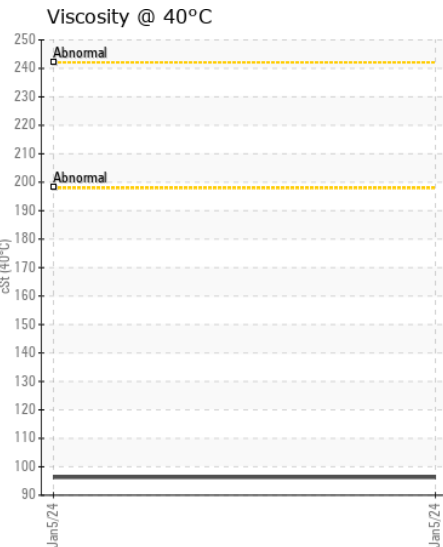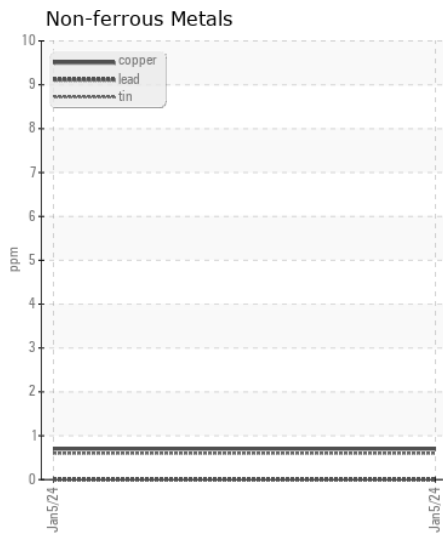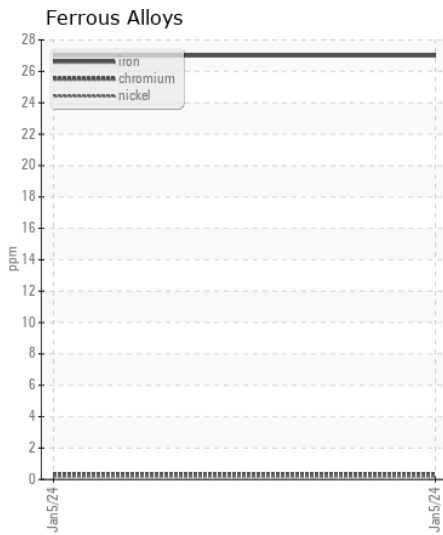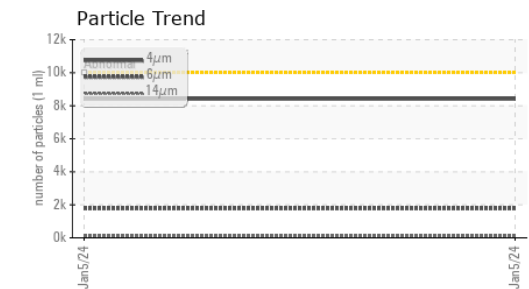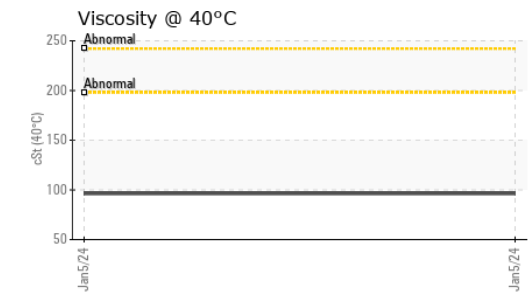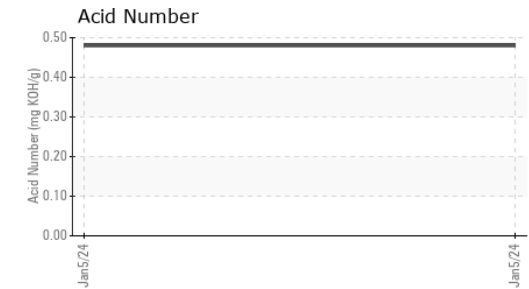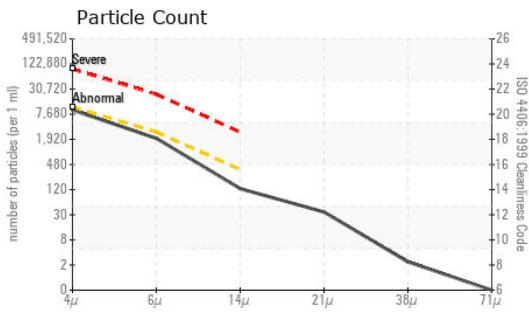

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PH0001871 **Received** : 11 Jan 2024
Lab Number : 06058725 **Diagnosed** : 15 Jan 2024
Unique Number : 10830107 **Diagnostician** : Jonathan Hester
Test Package : PLANT (Additional Tests: PrtFilter)

ALBANY ENGINEERING
 5 WASHINGTON SQ
 ALBANY, NY
 US 12205
 Contact: CRAIG POILLON

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: