



COOLANT REPORT

CORROSION	NORMAL
CONTAMINANTS	NORMAL
COOLANT CONDITION	NORMAL

Area
BOWERMAN - ORANGE COUNTY CA

Machine Id
SUTTON STROMART BOW 1

Component
Coolant

Fluid
CHEVRON DELO EXTENDED LIFE COOLANT (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. The fluid is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0848275	WC0649949	WC0649929
Sample Date		Client Info		09 Jan 2024	22 Sep 2023	14 Jun 2023
Machine Age	hrs	Client Info		0	59920	57642
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL










CORROSION

Total Dissolved Solids				470.5	442.5	438.0
Coolant Appearance		*Visual	Clear	normal	normal	normal

CONTAMINANTS

There is no indication of any contamination in the coolant.

Specific Gravity		*ASTM D1298		1.081	1.082	1.082
pH	Scale 0-14	ASTM D1287		7.40	7.35	7.30
Nitrites	ppm	AP-053:2009		NT	NT	NT
Reserve Alkalinity	Scale 0-20	*ASTM D1121		---	---	---
Percentage Glycol	%	ASTM D3321		61.2	62.1	62.1
Freezing Point	°F	ASTM D3321		-59	-61	-61
Carboxylate				fail	fail	pass
Coolant Color		*Visual		Red	Red	LtRed

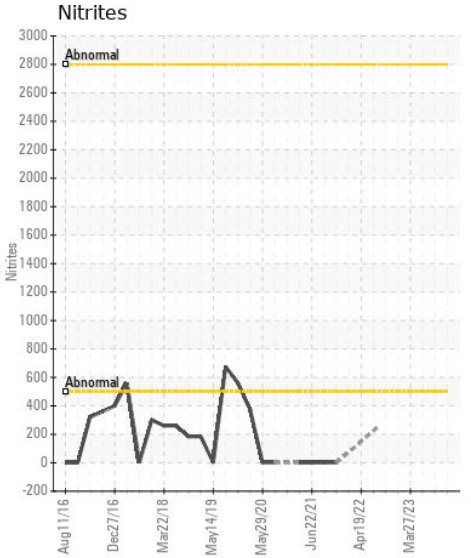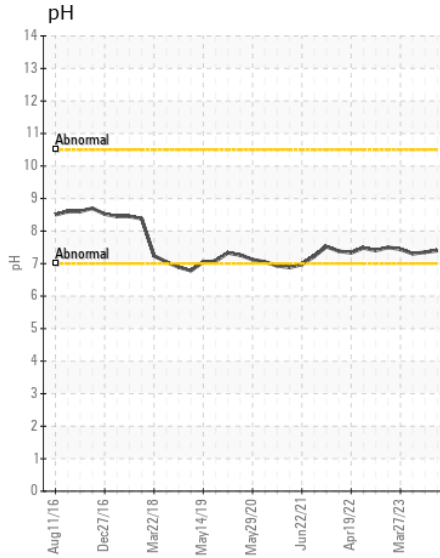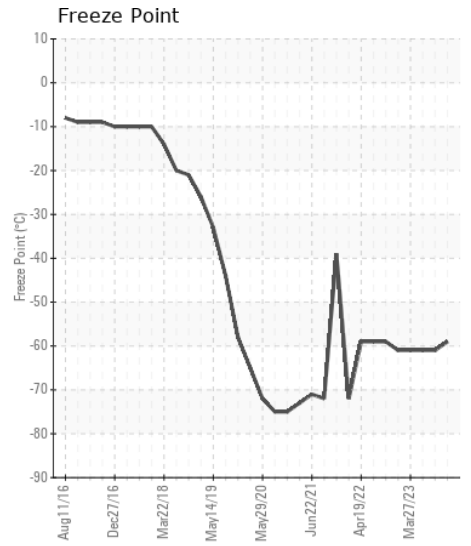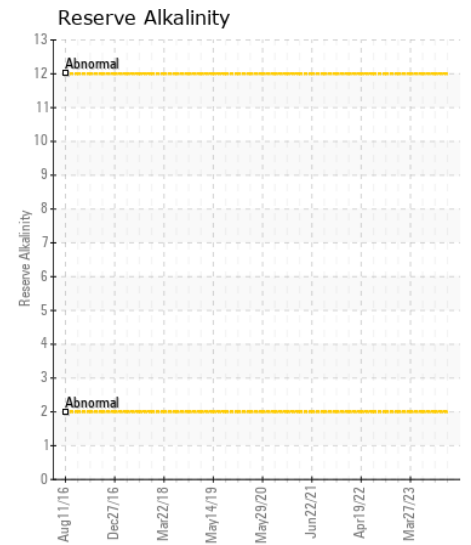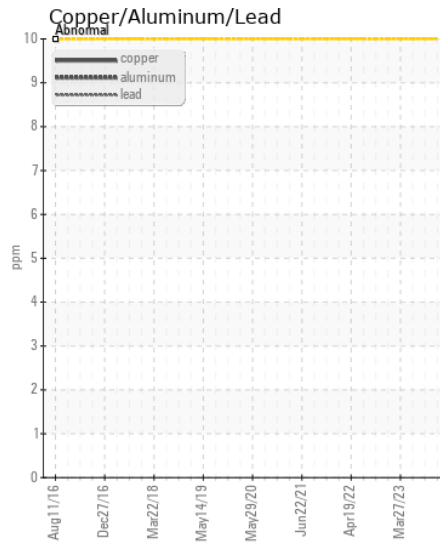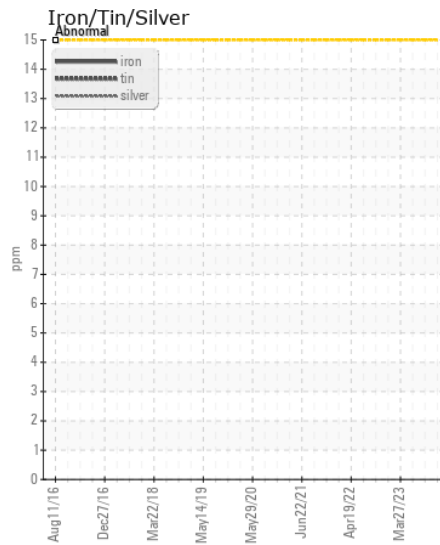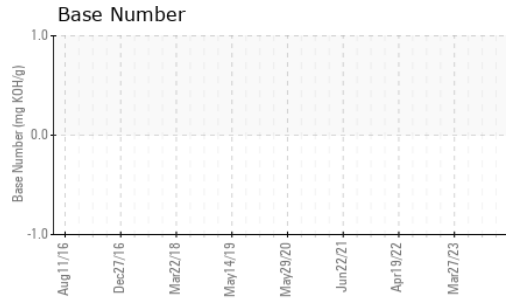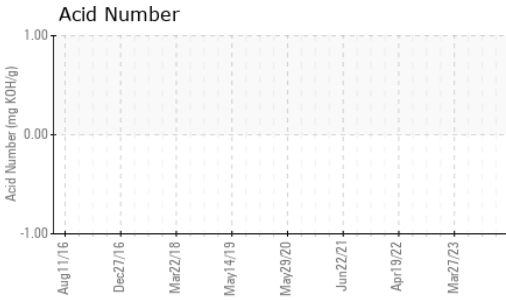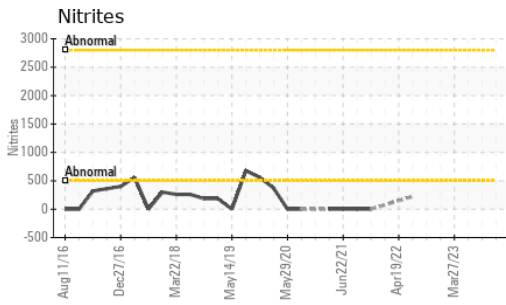

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0848275 **Received** : 11 Jan 2024
Lab Number : 06058927 **Diagnosed** : 16 Jan 2024
Unique Number : 10830309 **Diagnostician** : Jonathan Hester
Test Package : COOL- (Additional Tests: COOL, TAN Man, TBN)

MONTAUK ENERGY CAPITAL LLC (TEXAS) LP
 1412 N SAM HOUSTON PKWY E, SUITE 100
 HOUSTON, TX
 US 77032
 Contact: DAMON MCCLENAN
 dmcclenan@montaukenergy.com
 T: (713)781-1126
 F: (713)781-1127

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)