



| | |
|-----------------|---------------|
| WEAR | NORMAL |
| CONTAMINATION | NORMAL |
| FLUID CONDITION | NORMAL |

Area

WILLARD HAMMOND

Machine Id

[WILLARD HAMMOND] 008 587215-8

Component

Starboard Genset

Fluid

CHEVRON DELO 400 MULTIGRADE 15W40 (4 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

| Test | UOM | Method | Limit/Abn | Current | History1 | History2 |
|----------------|-----|-------------|-----------|--------------------|-------------|-------------|
| Sample Number | | Client Info | | MW0064388 | MW0058404 | MW0051341 |
| Sample Date | | Client Info | | 01 Jan 2024 | 29 Nov 2023 | 02 Oct 2023 |
| Machine Age | hrs | Client Info | | 29378 | 29042 | 28240 |
| Oil Age | hrs | Client Info | | 276 | 338 | 0 |
| Filter Age | hrs | Client Info | | 276 | 338 | 0 |
| Oil Changed | | Client Info | | N/A | Not Changd | N/A |
| Filter Changed | | Client Info | | N/A | Not Changd | N/A |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |

WEAR

All component wear rates are normal.

| | | | | | | |
|--------------|--------|-------------|------|--------------|------|------|
| Iron | ppm | ASTM D5185m | >50 | 6 | 5 | <1 |
| Chromium | ppm | ASTM D5185m | >4 | <1 | <1 | 0 |
| Nickel | ppm | ASTM D5185m | >2 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | >5 | 0 | 0 | <1 |
| Aluminum | ppm | ASTM D5185m | >12 | 2 | 3 | 3 |
| Lead | ppm | ASTM D5185m | >17 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >70 | <1 | <1 | 0 |
| Tin | ppm | ASTM D5185m | >15 | 0 | <1 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |

CONTAMINATION








There is no indication of any contamination in the oil.

| | | | | | | |
|------------------|----------|-------------|-------|----------------|-------|-------|
| Silicon | ppm | ASTM D5185m | >25 | 7 | 6 | 5 |
| Potassium | ppm | ASTM D5185m | >20 | 2 | <1 | <1 |
| Fuel | | WC Method | >4.0 | <1.0 | <1.0 | <1.0 |
| Water | | WC Method | >0.1 | NEG | NEG | NEG |
| Glycol | | WC Method | | NEG | NEG | NEG |
| Soot % | % | *ASTM D7844 | | 0.1 | 0.1 | 0.1 |
| Nitration | Abs/cm | *ASTM D7624 | >20 | 6.1 | 6.7 | 6.2 |
| Sulfation | Abs/.1mm | *ASTM D7415 | >30 | 22.7 | 23.4 | 23.1 |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | NEG | NEG |

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

| | | | | | | |
|------------------|----------|-------------|------|--------------|------|------|
| Sodium | ppm | ASTM D5185m | | 0 | 2 | <1 |
| Boron | ppm | ASTM D5185m | 151 | 368 | 357 | 299 |
| Barium | ppm | ASTM D5185m | 0.4 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | 250 | 131 | 128 | 116 |
| Manganese | ppm | ASTM D5185m | | <1 | 1 | <1 |
| Magnesium | ppm | ASTM D5185m | 0 | 676 | 679 | 637 |
| Calcium | ppm | ASTM D5185m | 2046 | 1633 | 1646 | 1515 |
| Phosphorus | ppm | ASTM D5185m | 1043 | 761 | 761 | 671 |
| Zinc | ppm | ASTM D5185m | 943 | 844 | 876 | 815 |
| Sulfur | ppm | ASTM D5185m | 5012 | 2747 | 2764 | 2345 |
| Oxidation | Abs/.1mm | *ASTM D7414 | >25 | 16.3 | 16.8 | 16.4 |
| Base Number (BN) | mg KOH/g | ASTM D2896 | 12.5 | 8.7 | 8.4 | 9.2 |
| Visc @ 100°C | cSt | ASTM D445 | 14.4 | 12.9 | 12.8 | 13.1 |

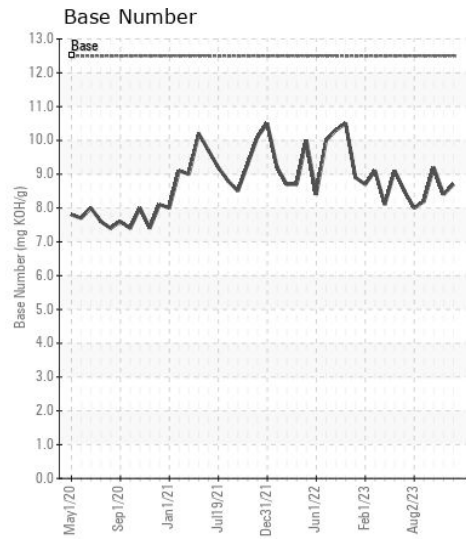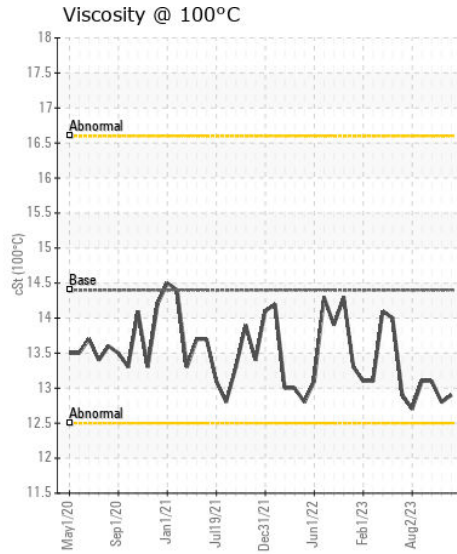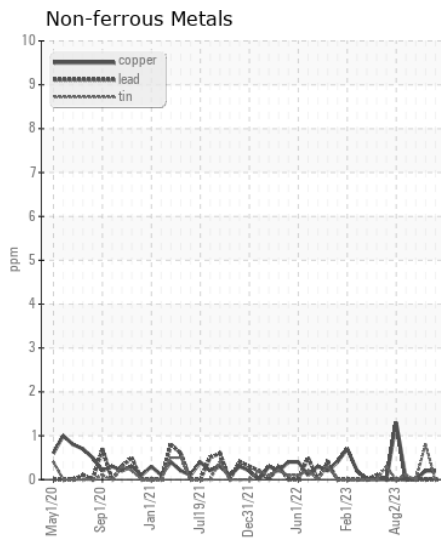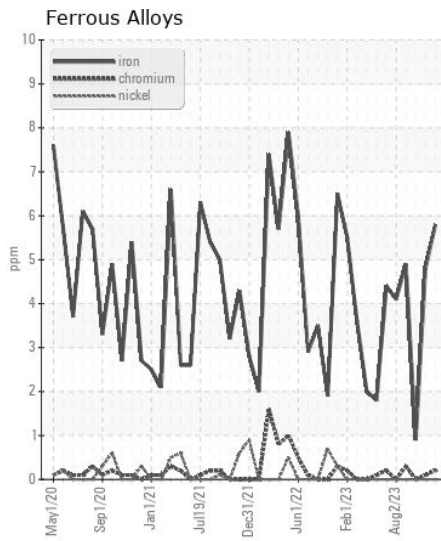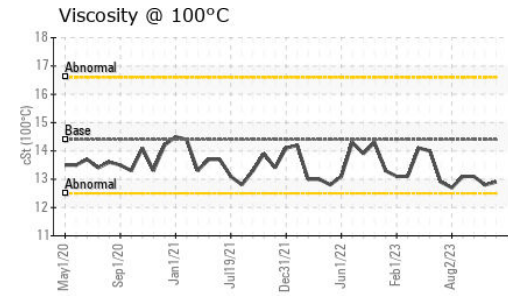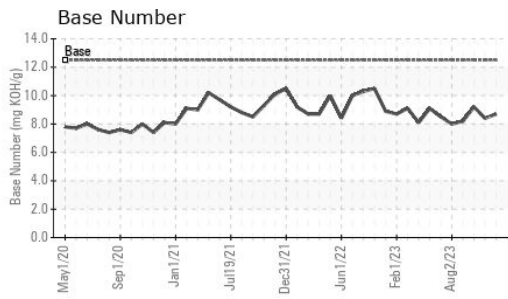

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MW0064388 **Recieved** : 12 Jan 2024
Lab Number : 06059899 **Diagnosed** : 16 Jan 2024
Unique Number : 10831281 **Diagnostician** : Wes Davis
Test Package : MAR 2

INGRAM BARGE
 900 S 3RD ST
 PADUCAH, KY
 US 42003
 Contact: CHARLES COPELAND
 charles.copeland@ingrambarga.com
 T: (270)415-4467
 F: (615)695-3697

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)