



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Machine Id
CARRO PORTA / TUNDISH 2
Component
Hydraulic System
Fluid
ANDEROL BIO GUARD FRHF 46 (--- QTS)

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

WEAR

All component wear rates are normal.

CONTAMINATION

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code.

FLUID CONDITION











The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		AN06060270	AN06060257	AN06060242
Sample Date		Client Info		13 Dec 2023	10 Nov 2023	04 Oct 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

Iron	ppm	ASTM D5185m	>20	4	4	3
Chromium	ppm	ASTM D5185m	>20	<1	<1	<1
Nickel	ppm	ASTM D5185m	>20	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	2	2	2
Lead	ppm	ASTM D5185m	>20	<1	<1	<1
Copper	ppm	ASTM D5185m	>20	4	4	4
Tin	ppm	ASTM D5185m	>20	<1	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

Silicon	ppm	ASTM D5185m	>15	<1	<1	<1
Potassium	ppm	ASTM D5185m	>20	<1	<1	1
Water	%	ASTM D6304	>0.05	0.040	0.049	0.054
ppm Water	ppm	ASTM D6304	>500	404	490	543
Particles >4µm		ASTM D7647	>5000	▲ 19230	▲ 21079	▲ 60201
Particles >6µm		ASTM D7647	>1300	▲ 1423	684	▲ 7122
Particles >14µm		ASTM D7647	>160	58	10	▲ 221
Particles >21µm		ASTM D7647	>40	19	5	▲ 53
Particles >38µm		ASTM D7647	>10	1	0	3
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	▲ 21/18/13	▲ 22/17/10	▲ 23/20/15
Silt	scalar	*Visual	NONE	NONE	NONE	LIGHT
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG

Sodium	ppm	ASTM D5185m		<1	<1	0
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		<1	<1	<1
Phosphorus	ppm	ASTM D5185m	196	241	243	245
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	1440	4407	4099	4102
Acid Number (AN)	mg KOH/g	ASTM D8045	1	1.66	1.64	1.55
Visc @ 40°C	cSt	ASTM D445	45.41	48.18	49.0	48.5

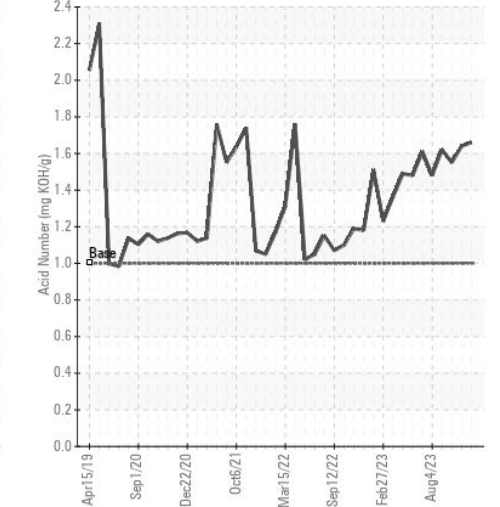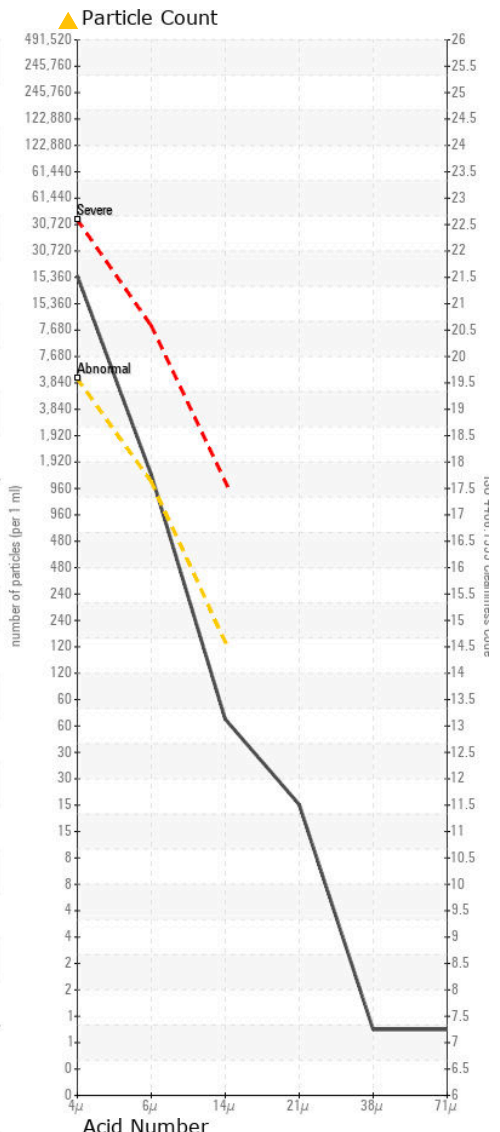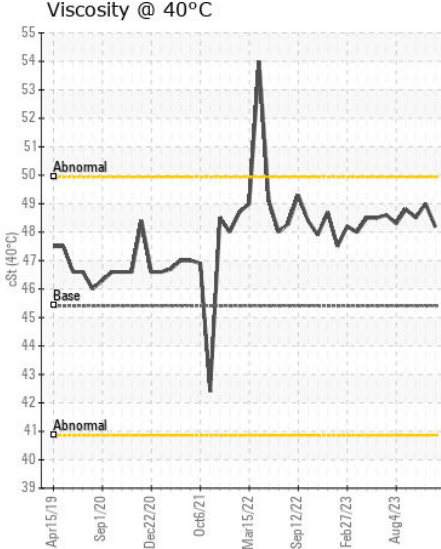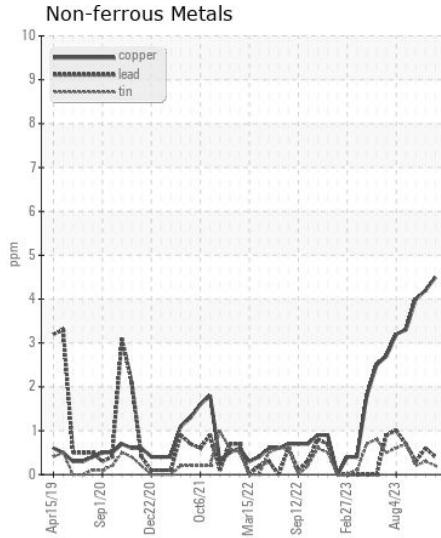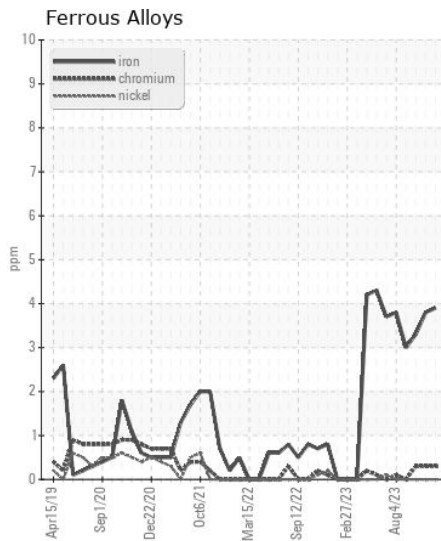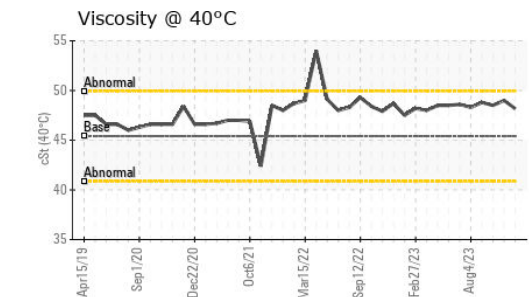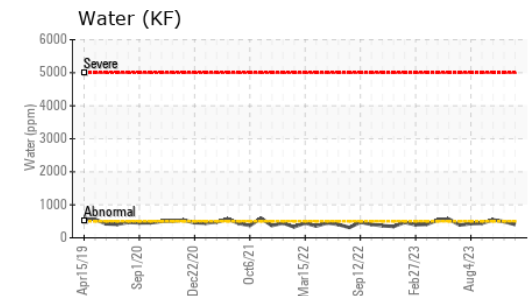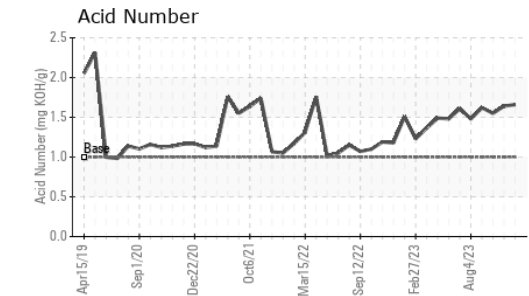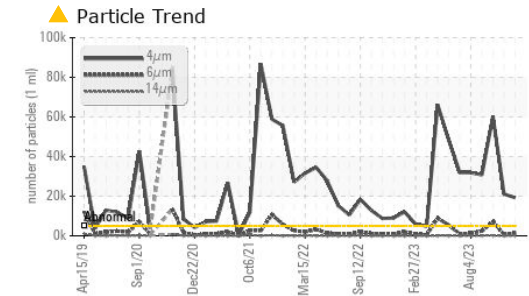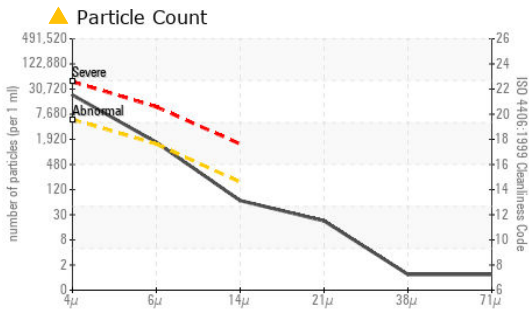

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : AN06060270 **Received** : 12 Jan 2024
Lab Number : 06060270 **Diagnosed** : 18 Jan 2024
Unique Number : 10831652 **Diagnostician** : Wes Davis
Test Package : IND 2 (Additional Tests: PrtCount)

CONEXO INC
 2320 STARR LAKE DRIVE
 ACWORTH, GA
 US 30101
 Contact: RICARDO HEIN
 rhein@conexoinc.com
 T: (678)806-0131
 F: x:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)