



| | |
|-----------------|---------------|
| WEAR | NORMAL |
| CONTAMINATION | NORMAL |
| FLUID CONDITION | NORMAL |

Machine Id
GENE NEAL
Component
Port Genset
Fluid
CHEVRON DELO 710 LE (5 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

| Test | UOM | Method | Limit/Abn | Current | History1 | History2 |
|----------------|-----|-------------|-----------|--------------------|-------------|-------------|
| Sample Number | | Client Info | | MW0058004 | MW0057997 | MW0057810 |
| Sample Date | | Client Info | | 15 Dec 2023 | 06 Nov 2023 | 28 Sep 2023 |
| Machine Age | hrs | Client Info | | 18356 | 17865 | 17393 |
| Oil Age | hrs | Client Info | | 487 | 500 | 493 |
| Filter Age | hrs | Client Info | | 487 | 500 | 493 |
| Oil Changed | | Client Info | | N/A | N/A | N/A |
| Filter Changed | | Client Info | | N/A | N/A | N/A |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |

WEAR

All component wear rates are normal.

| | | | | | | |
|--------------|--------|-------------|------|--------------|------|------|
| Iron | ppm | ASTM D5185m | >50 | 11 | 7 | 6 |
| Chromium | ppm | ASTM D5185m | >4 | <1 | <1 | <1 |
| Nickel | ppm | ASTM D5185m | >2 | 0 | 0 | <1 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | <1 |
| Silver | ppm | ASTM D5185m | >5 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >12 | 2 | 2 | 2 |
| Lead | ppm | ASTM D5185m | >17 | <1 | <1 | <1 |
| Copper | ppm | ASTM D5185m | >70 | <1 | <1 | 0 |
| Tin | ppm | ASTM D5185m | >15 | 0 | 0 | <1 |
| Vanadium | ppm | ASTM D5185m | | <1 | <1 | 0 |
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |

CONTAMINATION







There is no indication of any contamination in the oil.

| | | | | | | |
|------------------|----------|-------------|-------|----------------|-------|-------|
| Silicon | ppm | ASTM D5185m | >25 | 5 | 4 | 3 |
| Potassium | ppm | ASTM D5185m | >20 | <1 | <1 | 2 |
| Fuel | | WC Method | >4.0 | <1.0 | <1.0 | <1.0 |
| Water | | WC Method | >0.1 | NEG | NEG | NEG |
| Glycol | | WC Method | | NEG | NEG | NEG |
| Soot % | % | *ASTM D7844 | | 0.3 | 0.2 | 0.1 |
| Nitration | Abs/cm | *ASTM D7624 | >20 | 8.7 | 8.8 | 8.3 |
| Sulfation | Abs/.1mm | *ASTM D7415 | >30 | 15.8 | 15.5 | 14.9 |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | NEG | NEG |

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

| | | | | | | |
|------------------|----------|-------------|------|--------------|------|------|
| Sodium | ppm | ASTM D5185m | | 1 | <1 | <1 |
| Boron | ppm | ASTM D5185m | | 39 | 38 | 40 |
| Barium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 45 | 44 | 42 |
| Manganese | ppm | ASTM D5185m | | <1 | <1 | 0 |
| Magnesium | ppm | ASTM D5185m | | 14 | 46 | 13 |
| Calcium | ppm | ASTM D5185m | | 3322 | 3278 | 3132 |
| Phosphorus | ppm | ASTM D5185m | | 8 | 35 | 15 |
| Zinc | ppm | ASTM D5185m | 10 | 10 | 45 | 14 |
| Sulfur | ppm | ASTM D5185m | | 2181 | 2218 | 2552 |
| Oxidation | Abs/.1mm | *ASTM D7414 | >25 | 10.0 | 10.2 | 9.3 |
| Base Number (BN) | mg KOH/g | ASTM D2896 | 9.2 | 6.0 | 6.4 | 6.3 |
| Visc @ 100°C | cSt | ASTM D445 | 15.5 | 14.8 | 14.8 | 14.7 |

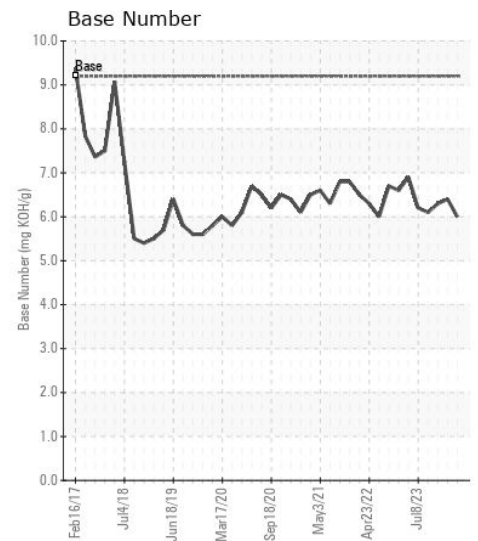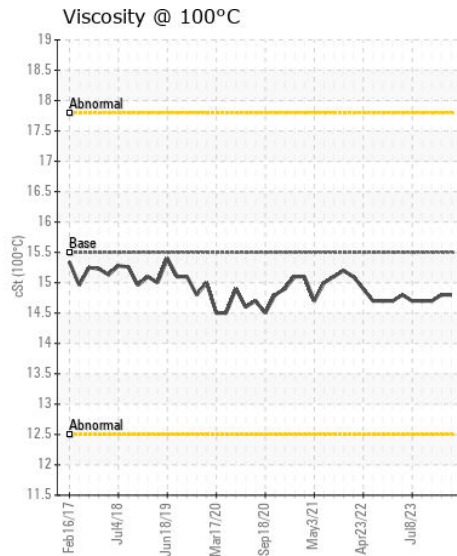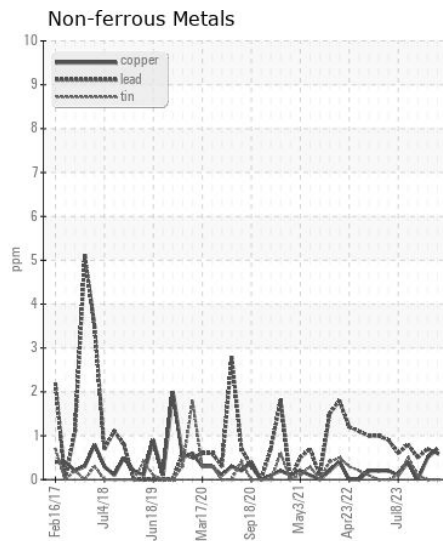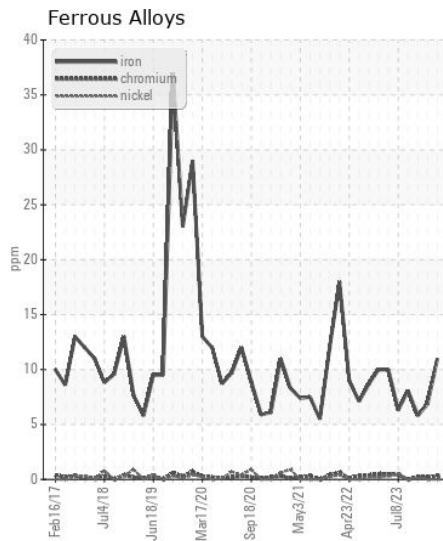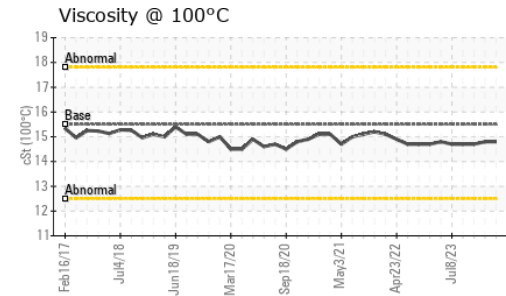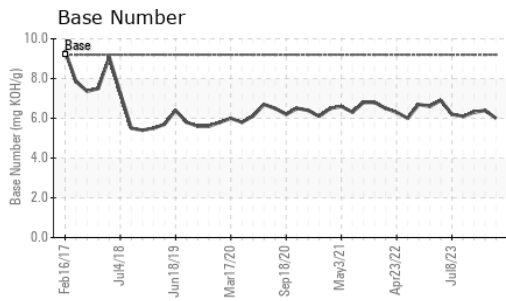

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MW0058004 **Recieved** : 16 Jan 2024
Lab Number : 06061667 **Diagnosed** : 17 Jan 2024
Unique Number : 10833049 **Diagnostician** : Wes Davis
Test Package : MAR 2

MAGNOLIA MARINE TRANSPORT
 697 HAINING ROAD
 VICKSBURG, MS
 US 39183

Contact: MMT MAINTENANCE PLANNERS
 mmtmaintenanceplanners@ergon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: x:
 F: (601)638-8028