



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
MRC-298
 Component
Compressor
 Fluid
TULCO LUBSOIL LPG WS 150 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		TO60001962	TO60001925	TO60001718
Sample Date		Client Info		05 Jan 2024	02 Dec 2023	04 Nov 2023
Machine Age	hrs	Client Info		7619	6829	6177
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<1	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	2	0	0
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>15	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	<1
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION











There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>25	7	3	2
Potassium	ppm	ASTM D5185m	>20	2	0	1
Water	%	ASTM D6304	>2.26	0.007	0.023	0.022
ppm Water	ppm	ASTM D6304	>22600	76	238	228.2
Particles >4µm		ASTM D7647	>10000	3618	726	2184
Particles >6µm		ASTM D7647	>1300	381	175	521
Particles >14µm		ASTM D7647	>320	9	6	21
Particles >21µm		ASTM D7647	>80	2	2	4
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/17/15	19/16/10	17/15/10	18/16/12
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2.26	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	2	3
Boron	ppm	ASTM D5185m	0	132	100	74
Barium	ppm	ASTM D5185m	0	3	0	0
Molybdenum	ppm	ASTM D5185m	0	<1	<1	<1
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	0	5	4	6
Calcium	ppm	ASTM D5185m	0	1210	1272	1231
Phosphorus	ppm	ASTM D5185m	0	304	293	302
Zinc	ppm	ASTM D5185m	0	265	295	318
Sulfur	ppm	ASTM D5185m	0	3287	2498	2236
Acid Number (AN)	mg KOH/g	ASTM D8045		1.85	1.36	0.38
Visc @ 40°C	cSt	ASTM D445	151	125	128	131
Visc @ 100°C	cSt	ASTM D445	28	13.1	13.2	13.5
Viscosity Index (VI)	Scale	ASTM D2270	224	98	96	97

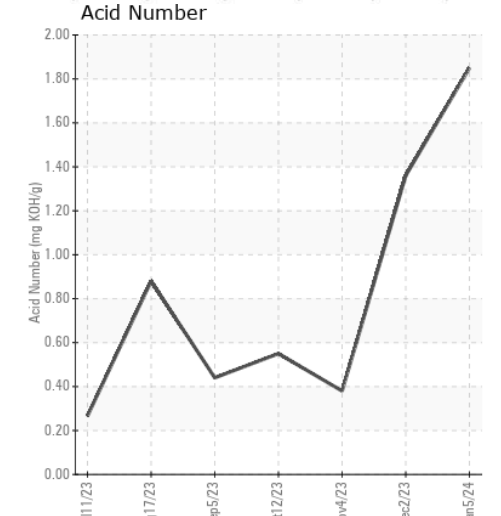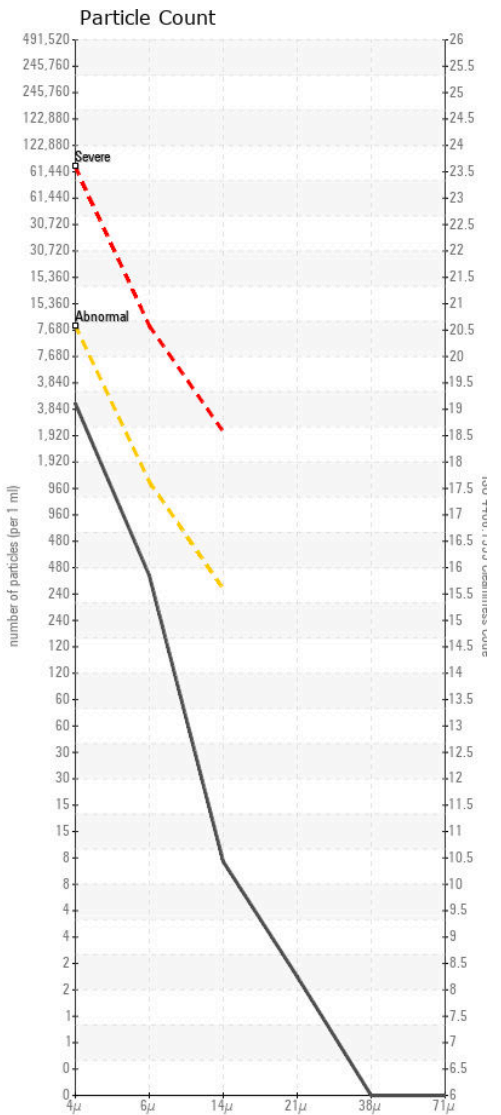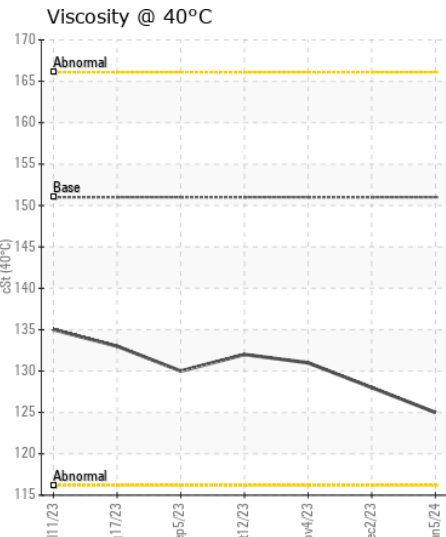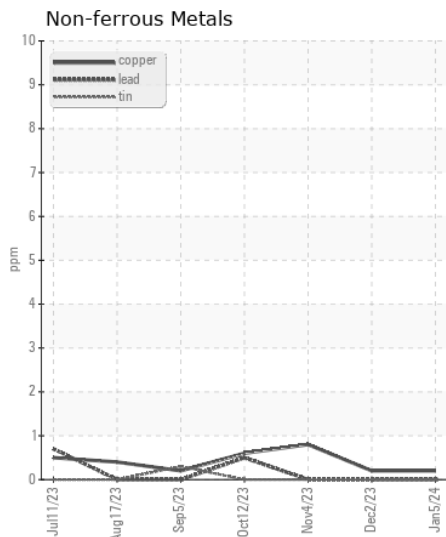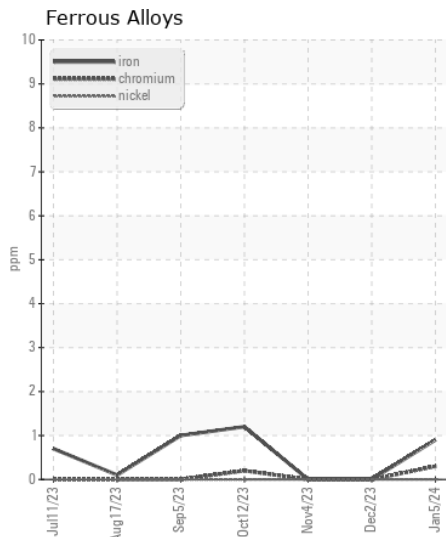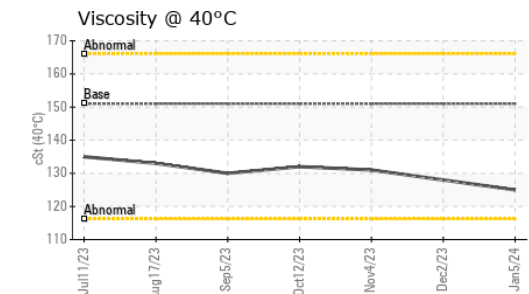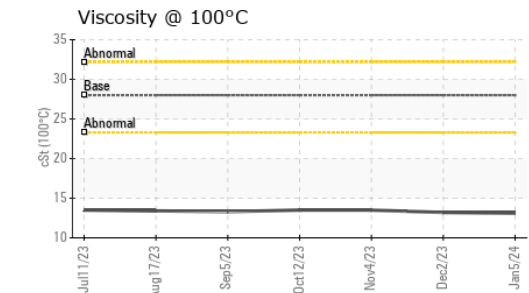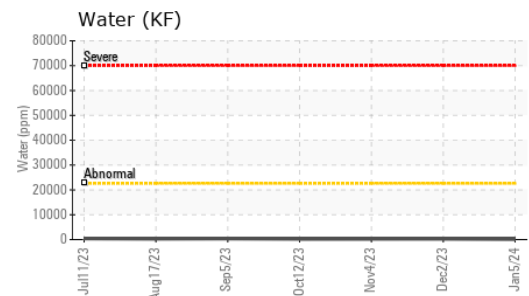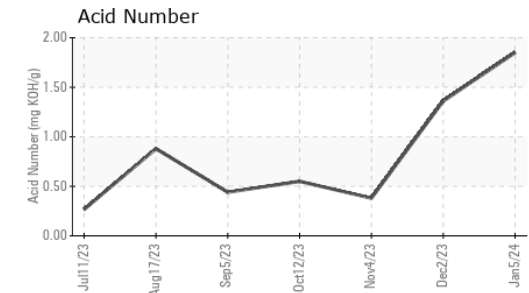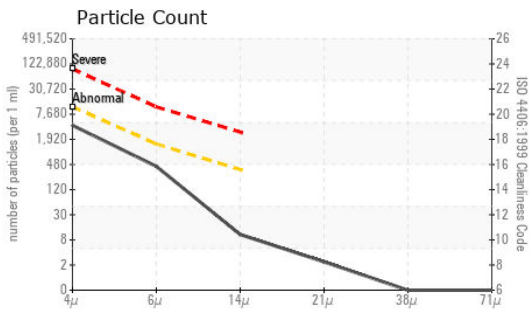

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60001962 **Received** : 17 Jan 2024
Lab Number : 06063635 **Diagnosed** : 19 Jan 2024
Unique Number : 10835017 **Diagnostician** : Don Baldrige
Test Package : MOB 2 (Additional Tests: KF, KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MIDLAND - EOG RESOURCES INC.
 5509 CHAMPIONS DRIVE
 MIDLAND, TX
 US 79706
 Contact: HERMAN GARZA
 herman_garza@eogresources.com
 T: (432)686-3600
 F: