



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
PALEXTRA 44
Machine Id
POLAR AIR 261722-EVO - ESTROLD WILLISTON
Component
Compressor

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCS06065727	UCS05774055	---
Sample Date		Client Info		10 Jan 2024	18 Feb 2023	---
Machine Age	hrs	Client Info		8960	6988	---
Oil Age	hrs	Client Info		1000	3000	---
Filter Age	hrs	Client Info		1000	3000	---
Oil Changed		Client Info		Not Changed	Changed	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				NORMAL	ABNORMAL	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<1	0	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	0	0	---
Lead	ppm	ASTM D5185m	>25	0	0	---
Copper	ppm	ASTM D5185m	>50	2	1	---
Tin	ppm	ASTM D5185m	>15	0	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---

CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	7	1	---
Potassium	ppm	ASTM D5185m	>20	0	<1	---
Water		WC Method	>0.1	NEG	NEG	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	▲ 0.2%	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	0	---
Boron	ppm	ASTM D5185m	0	0	0	---
Barium	ppm	ASTM D5185m	0.3	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m	0.3	0	0	---
Magnesium	ppm	ASTM D5185m	0.4	0	<1	---
Calcium	ppm	ASTM D5185m	0	0	0	---
Phosphorus	ppm	ASTM D5185m	689	277	33	---
Zinc	ppm	ASTM D5185m	0	8	20	---
Sulfur	ppm	ASTM D5185m	1237	763	1299	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.135	0.27	0.13	---
Visc @ 40°C	cSt	ASTM D445	44.62	42.8	45.5	---

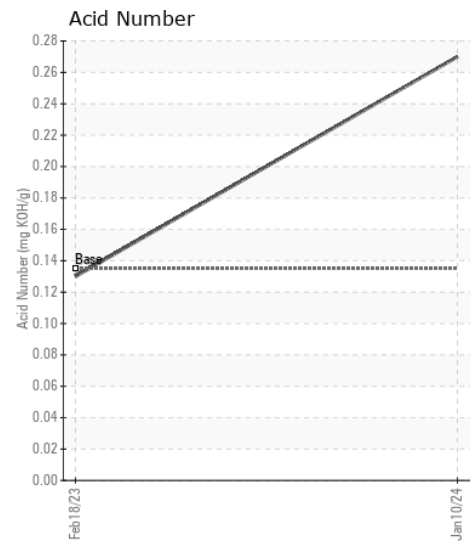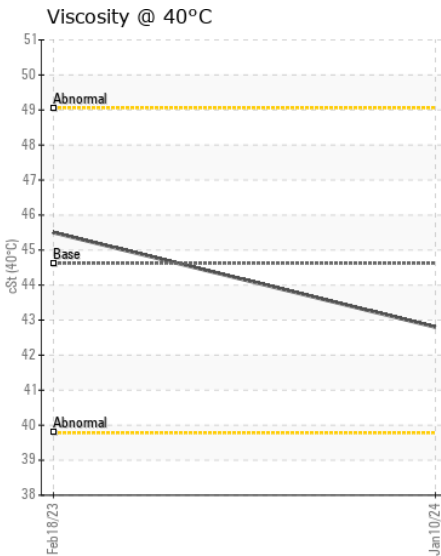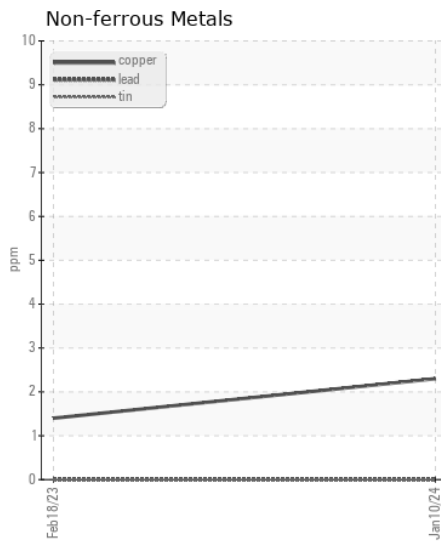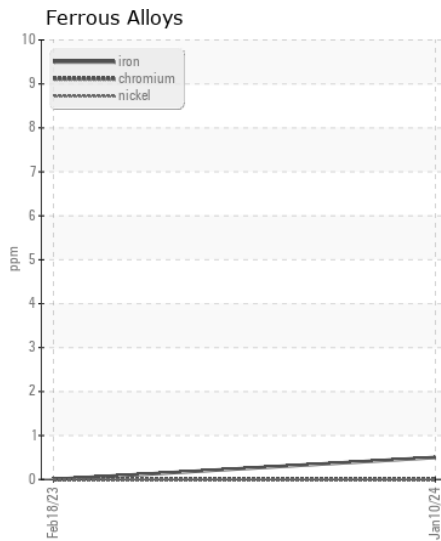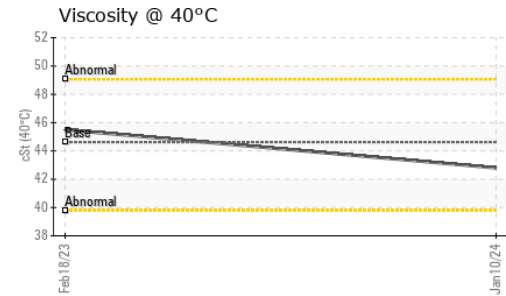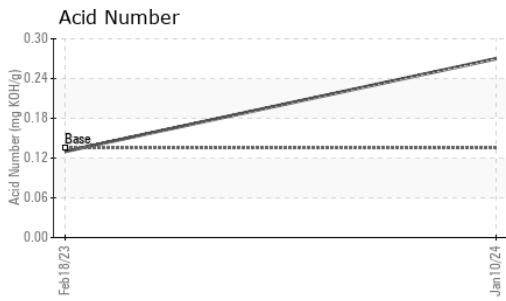

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCS06065727 **Received** : 19 Jan 2024
Lab Number : 06065727 **Diagnosed** : 22 Jan 2024
Unique Number : 10837109 **Diagnostician** : Angela Borella
Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

JEMCO-MAXAIR

WEST FARGO, ND
 US 58078

Contact: DALE K
 dalek@jemco-maxair.com

T: (701)281-0362

F: x: