



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**VQU (S/N RG6090L149301)**  
Component  
**Port Genset**  
Fluid  
**CHEVRON DELO 710 LS (8 GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>MW0060725</b>	MW0060712	MW0060706
Sample Date		Client Info		<b>16 Jan 2024</b>	25 Dec 2023	05 Dec 2023
Machine Age	hrs	Client Info		<b>4905</b>	4647	4460
Oil Age	hrs	Client Info		<b>250</b>	250	273
Filter Age	hrs	Client Info		<b>250</b>	250	273
Oil Changed		Client Info		<b>N/A</b>	Changed	Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>2</b>	2	3
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>12	<b>2</b>	2	2
Lead	ppm	ASTM D5185m	>17	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>70	<b>0</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	<1
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>2</b>	2	3
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844		<b>0.1</b>	0.1	0.2
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.7</b>	6.9	7.3
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>14.3</b>	14.2	14.4
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>1</b>	<1	4
Boron	ppm	ASTM D5185m		<b>45</b>	42	42
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>43</b>	40	41
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>28</b>	20	21
Calcium	ppm	ASTM D5185m		<b>3153</b>	3132	3148
Phosphorus	ppm	ASTM D5185m		<b>6</b>	8	8
Zinc	ppm	ASTM D5185m		<b>4</b>	3	3
Sulfur	ppm	ASTM D5185m		<b>2071</b>	2073	2070
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>7.7</b>	7.6	7.9
Base Number (BN)	mg KOH/g	ASTM D2896	10.5	<b>6.0</b>	6.2	5.9
Visc @ 100°C	cSt	ASTM D445	15.5	<b>14.3</b>	14.1	14.3

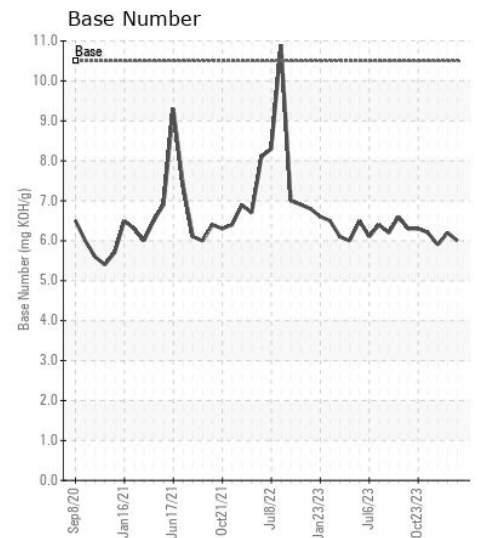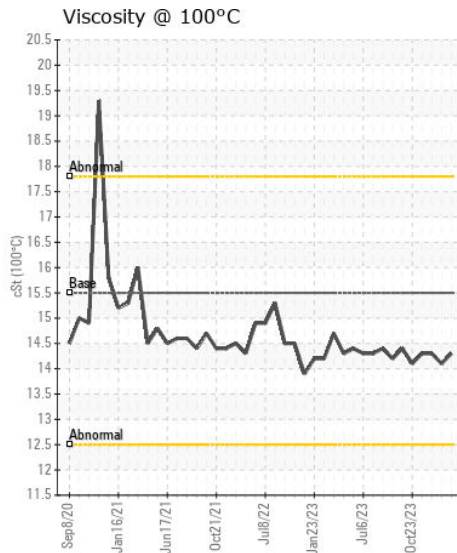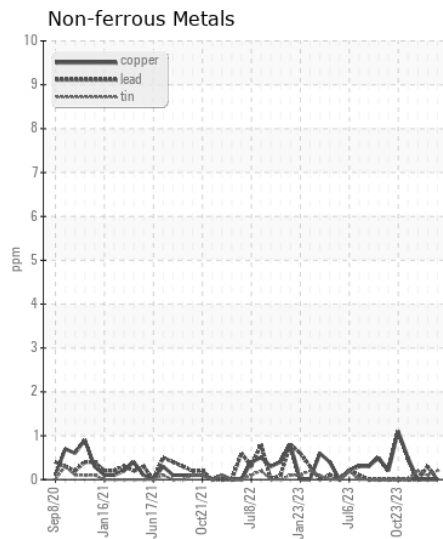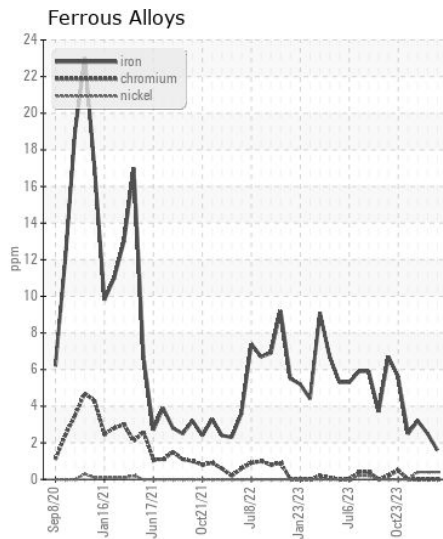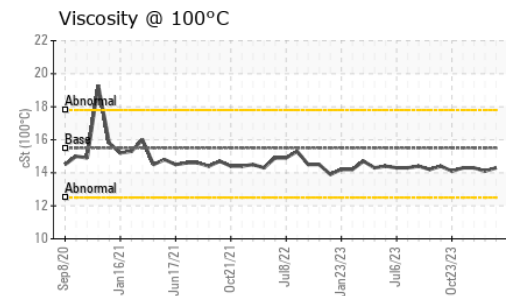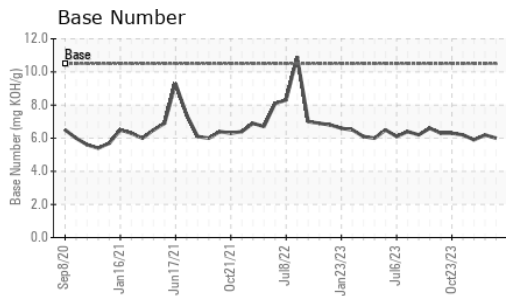

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MW0060725 **Received** : 30 Jan 2024  
**Lab Number** : 06074351 **Diagnosed** : 31 Jan 2024  
**Unique Number** : 10856442 **Diagnostician** : Wes Davis  
**Test Package** : MAR 2

**AMERICAN RIVER TRANSPORTATION CO.**  
P.O. BOX 2889  
ST. LOUIS, MO  
US 63111  
Contact: BRIAN GRIEWING  
brian.griewing@adm.com  
T:  
F: (314)481-5278

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)