



WEAR	ABNORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
ROBERT W TAYLOR
Machine Id
[ROBERT W TAYLOR] 007 568680-7
Component
Port Genset
Fluid
SHELL ROTELLA T 15W40 (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		MW0063120	MW0063118	MW0062960
Sample Date		Client Info		02 Jan 2024	02 Jan 2024	01 Dec 2023
Machine Age	hrs	Client Info		16482	31467	31083
Oil Age	hrs	Client Info		1122	108	132
Filter Age	hrs	Client Info		1122	108	132
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Filter Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				ABNORMAL	NORMAL	NORMAL

WEAR

The copper level is abnormal. In the absence of other significant wear metals, suspect copper due to sources other than wear (i.e. cooling core). All other component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	5	2	1
Chromium	ppm	ASTM D5185m	>4	0	0	0
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>12	0	<1	<1
Lead	ppm	ASTM D5185m	>17	1	<1	<1
Copper	ppm	ASTM D5185m	>70	▲ 83	<1	<1
Tin	ppm	ASTM D5185m	>15	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION








There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	2	3	3
Potassium	ppm	ASTM D5185m	>20	0	5	5
Fuel		WC Method	>4.0	<1.0	<1.0	<1.0
Water		WC Method	>0.1	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844		0	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	3.7	5.5	8.5
Sulfation	Abs/.1mm	*ASTM D7415	>30	14.8	20.4	21.1
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185m		2	2	1
Boron	ppm	ASTM D5185m	316	34	228	172
Barium	ppm	ASTM D5185m	0.0	0	0	0
Molybdenum	ppm	ASTM D5185m	1.2	87	16	10
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	24	43	92	64
Calcium	ppm	ASTM D5185m	2292	2456	2065	1943
Phosphorus	ppm	ASTM D5185m	1064	892	943	973
Zinc	ppm	ASTM D5185m	1160	1094	1128	1099
Sulfur	ppm	ASTM D5185m	4996	2941	3475	3346
Oxidation	Abs/.1mm	*ASTM D7414	>25	7.7	16.0	17.9
Base Number (BN)	mg KOH/g	ASTM D2896	10.1	8.3	8.5	7.5
Visc @ 100°C	cSt	ASTM D445	15.7	13.3	14.2	13.8

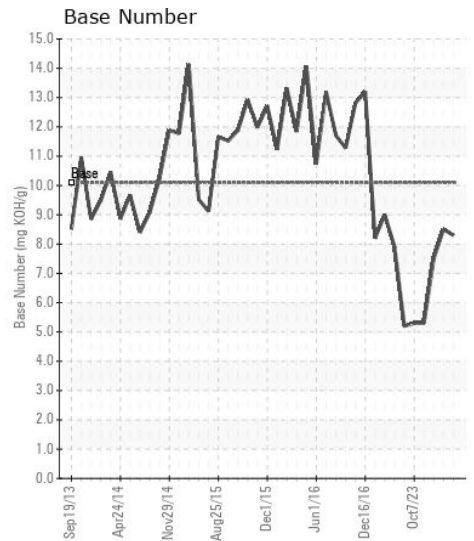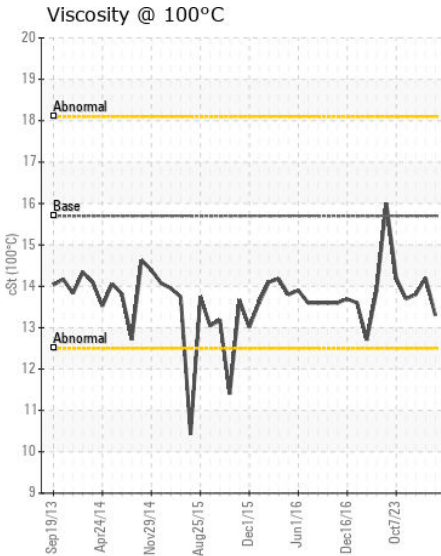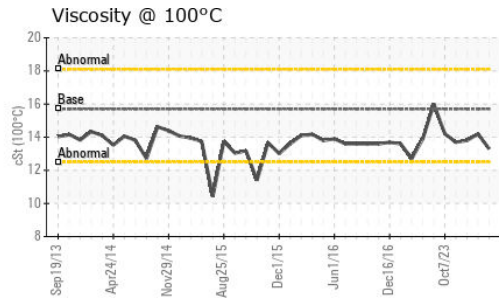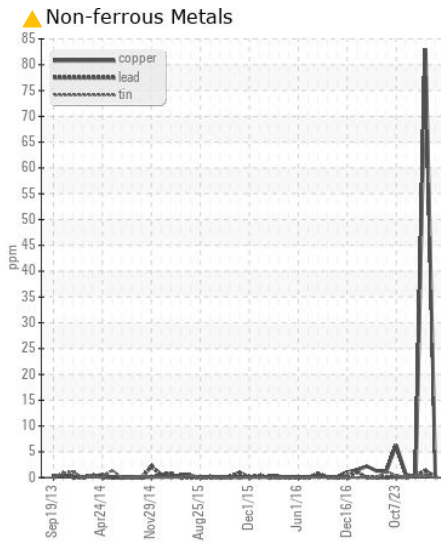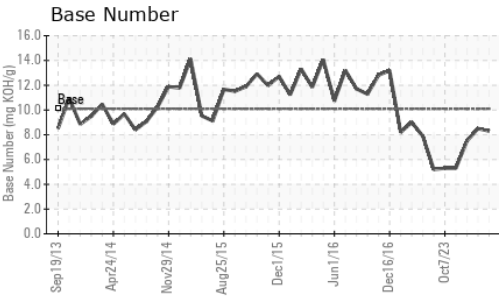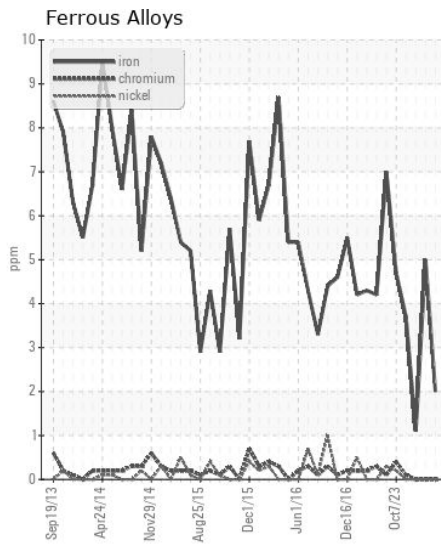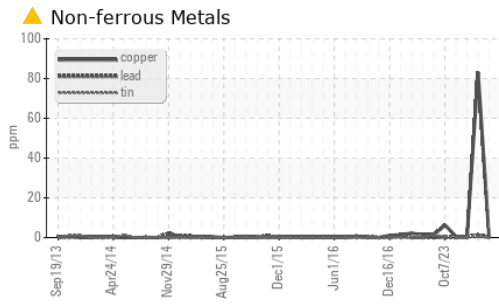

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MW0063120 **Received** : 30 Jan 2024
Lab Number : 06074512 **Diagnosed** : 31 Jan 2024
Unique Number : 10856603 **Diagnostician** : Sean Felton
Test Package : MAR 2

INGRAM BARGE
 900 S 3RD ST
 PADUCAH, KY
 US 42003
 Contact: ANTHONY VAN CURA
 anthony.vancura@ingrambarga.com
 T: (270)415-4467
 F: (615)695-3697

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)