



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Machine Id
SULLAIR 80017 - QUIKERET
 Component
Compressor
 Fluid
QC ULTRA PLUS (--- GAL)

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		TO50001863	---	---
Sample Date		Client Info		05 Jan 2024	---	---
Machine Age	hrs	Client Info		28631	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Not Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				ABNORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<1	---	---
Chromium	ppm	ASTM D5185m	>10	<1	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		<1	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	2	---	---
Lead	ppm	ASTM D5185m	>25	<1	---	---
Copper	ppm	ASTM D5185m	>50	3	---	---
Tin	ppm	ASTM D5185m	>15	<1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION











There is a high amount of particulates present in the oil.

Silicon	ppm	ASTM D5185m	>25	2	---	---
Potassium	ppm	ASTM D5185m	>20	3	---	---
Water	%	ASTM D6304	>0.1	0.063	---	---
ppm Water	ppm	ASTM D6304	>1000	631	---	---
Particles >4µm		ASTM D7647	>10000	▲ 81373	---	---
Particles >6µm		ASTM D7647	>2500	▲ 33882	---	---
Particles >14µm		ASTM D7647	>320	▲ 3415	---	---
Particles >21µm		ASTM D7647	>80	▲ 586	---	---
Particles >38µm		ASTM D7647	>20	4	---	---
Particles >71µm		ASTM D7647	>4	0	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ 24/22/19	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		46	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		38	---	---
Molybdenum	ppm	ASTM D5185m		<1	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m		2	---	---
Calcium	ppm	ASTM D5185m		7	---	---
Phosphorus	ppm	ASTM D5185m		263	---	---
Zinc	ppm	ASTM D5185m		0	---	---
Sulfur	ppm	ASTM D5185m		52	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		0.23	---	---
Visc @ 40°C	cSt	ASTM D445		51.3	---	---
Visc @ 100°C	cSt	ASTM D445		7.6	---	---
Viscosity Index (VI)	Scale	ASTM D2270		111	---	---

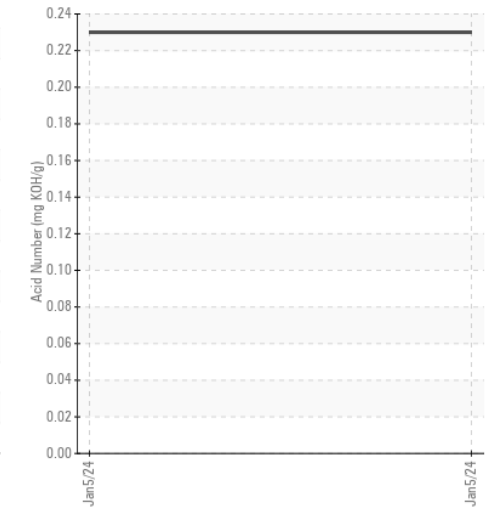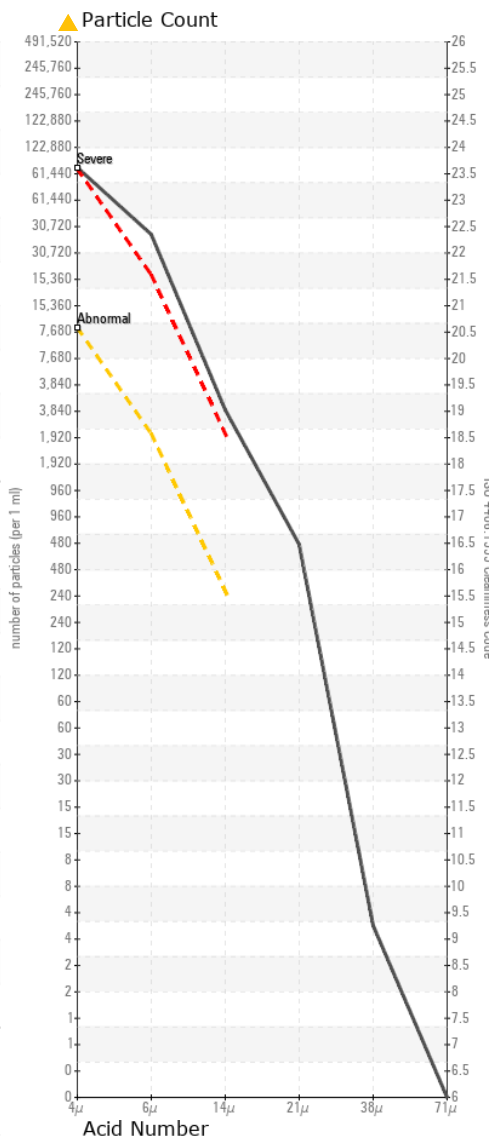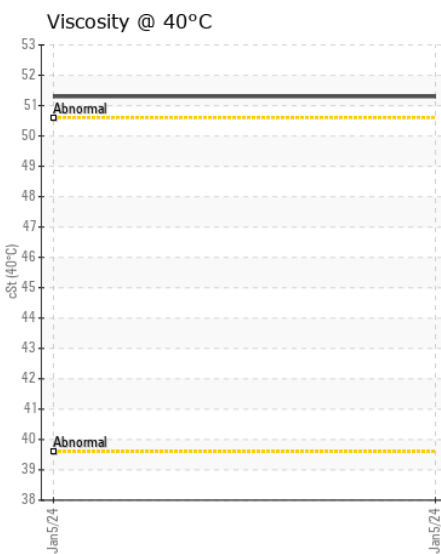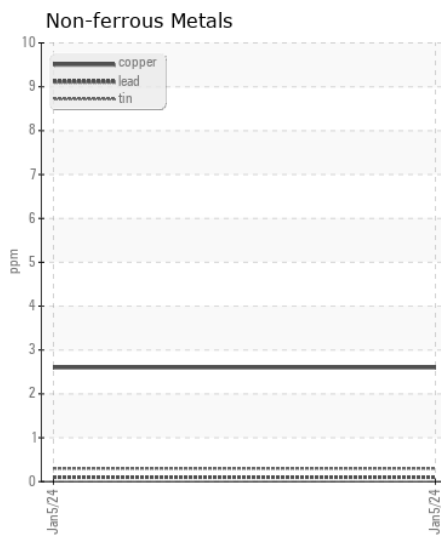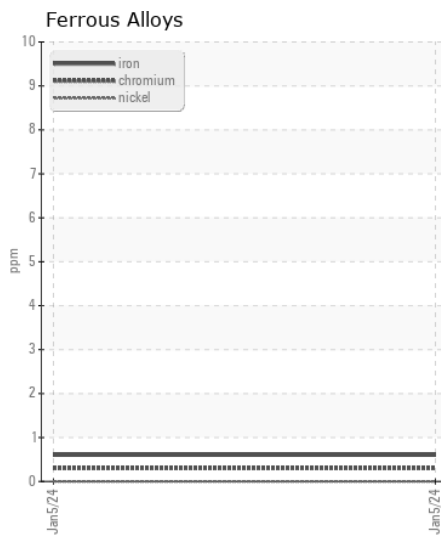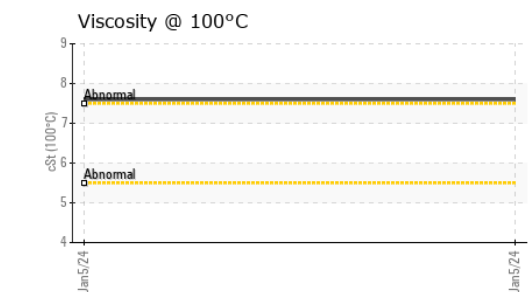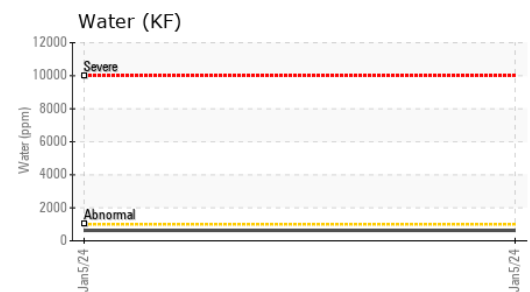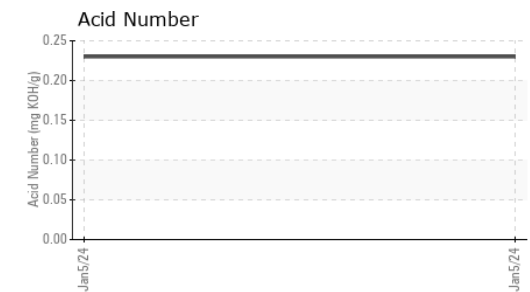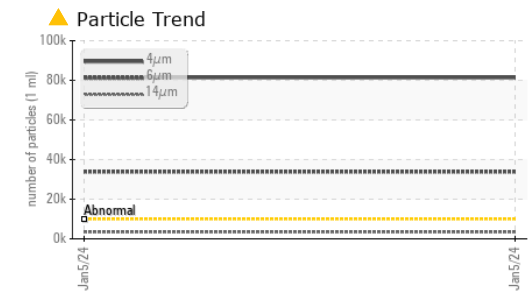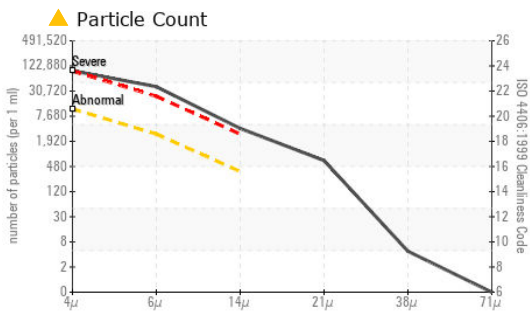

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO50001863 **Received** : 30 Jan 2024
Lab Number : 06074689 **Diagnosed** : 01 Feb 2024
Unique Number : 10856780 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

QUALITY COMPRESSOR

4428 CR 616
 ALVARADO, TX
 US 76009

Contact: SEAN
 SEAN@QCOMPRESSOR.COM

T: (817)822-1333

F: