



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ATTENTION
FLUID CONDITION	NORMAL

Machine Id
GARDNER DENVER D065298 - LONGHORN LOCKERS

Component
Compressor

Fluid
QUINCY QUINSYN (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		TO50001876	QUC0000537	---
Sample Date		Client Info		08 Jan 2024	20 Oct 2023	---
Machine Age	hrs	Client Info		21821	21812	---
Oil Age	hrs	Client Info		0	0	---
Filter Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		Not Changed	Changed	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				ATTENTION	ABNORMAL	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<1	<1	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		<1	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	2	7	---
Lead	ppm	ASTM D5185m	>25	0	0	---
Copper	ppm	ASTM D5185m	>50	<1	<1	---
Tin	ppm	ASTM D5185m	>15	<1	<1	---
Vanadium	ppm	ASTM D5185m		0	0	---
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---

CONTAMINATION











There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Silicon	ppm	ASTM D5185m	>25	1	5	---
Potassium	ppm	ASTM D5185m	>20	2	<1	---
Water	%	ASTM D6304	>0.1	0.029	0.031	---
ppm Water	ppm	ASTM D6304	>1000	297	313.9	---
Particles >4µm		ASTM D7647	>10000	▲ 18889	▲ 188683	---
Particles >6µm		ASTM D7647	>2500	▲ 4300	▲ 138771	---
Particles >14µm		ASTM D7647	>320	223	▲ 29540	---
Particles >21µm		ASTM D7647	>80	45	▲ 8004	---
Particles >38µm		ASTM D7647	>20	1	▲ 153	---
Particles >71µm		ASTM D7647	>4	0	2	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ 21/19/15	▲ 25/24/22	---
Silt	scalar	*Visual	NONE	NONE	LIGHT	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	<1	---
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		<1	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		0	1	---
Calcium	ppm	ASTM D5185m		0	3	---
Phosphorus	ppm	ASTM D5185m		17	50	---
Zinc	ppm	ASTM D5185m		47	48	---
Sulfur	ppm	ASTM D5185m		359	426	---
Acid Number (AN)	mg KOH/g	ASTM D8045	.10	0.30	0.31	---
Visc @ 40°C	cSt	ASTM D445	44.6	47.9	48.0	---
Visc @ 100°C	cSt	ASTM D445	7.8	7.7	7.7	---
Viscosity Index (VI)	Scale	ASTM D2270	132	127	127	---

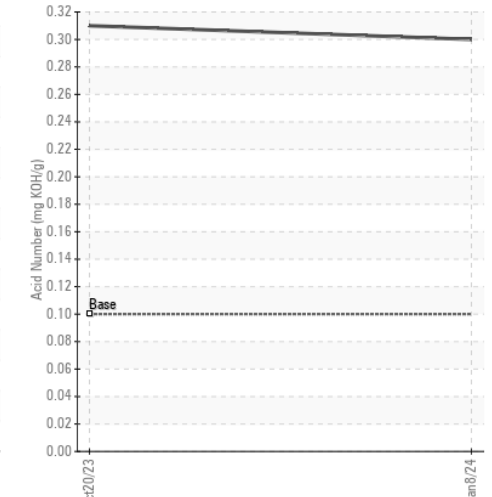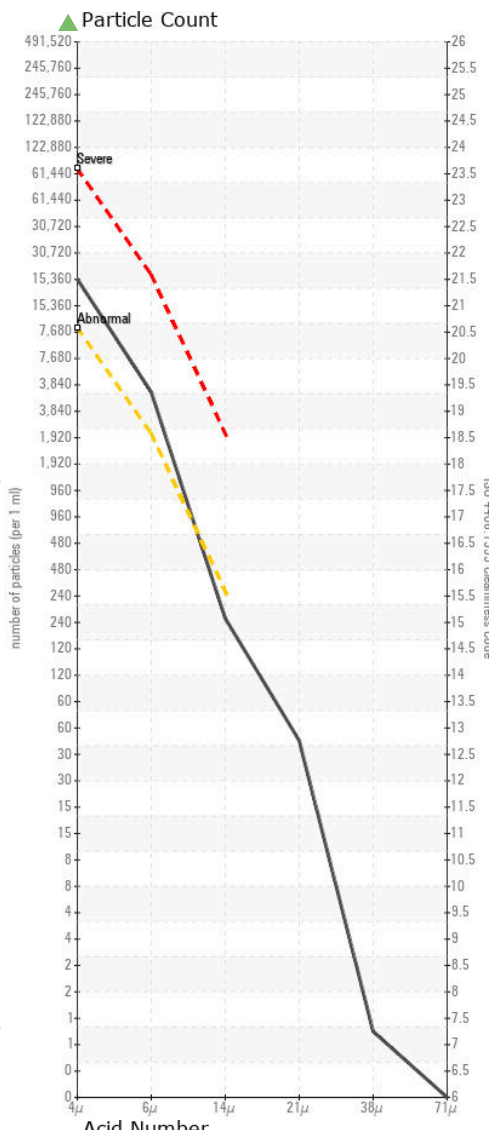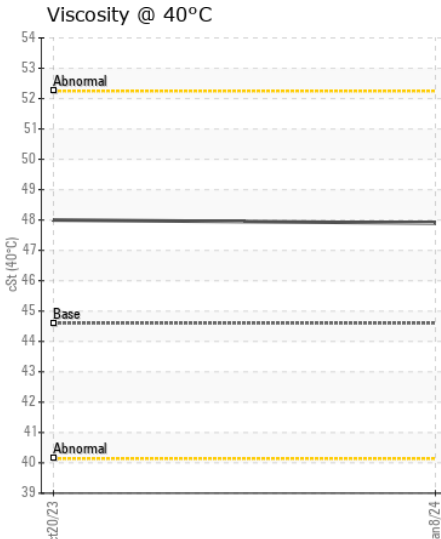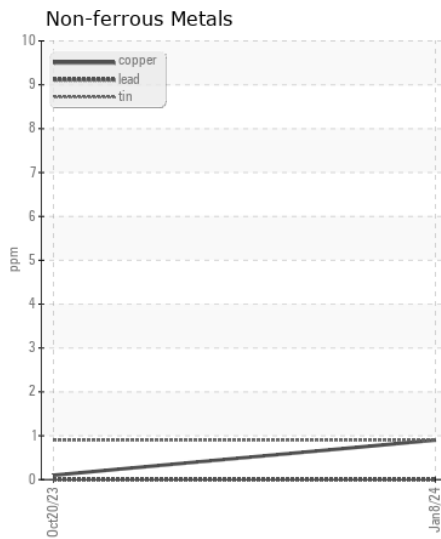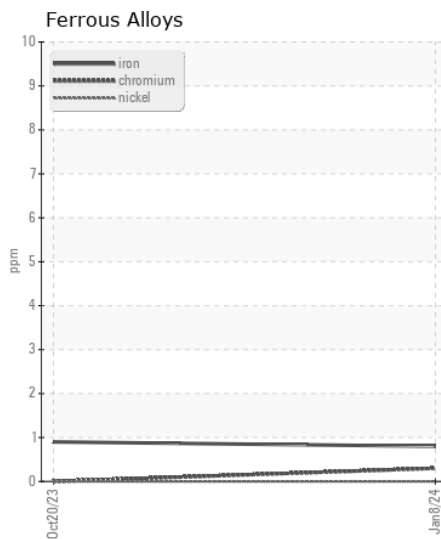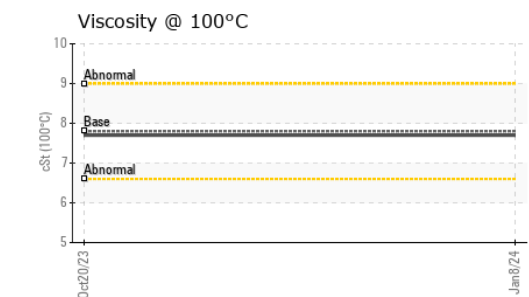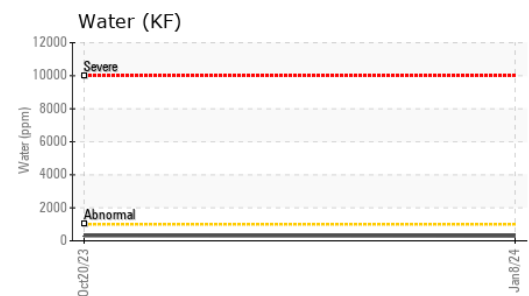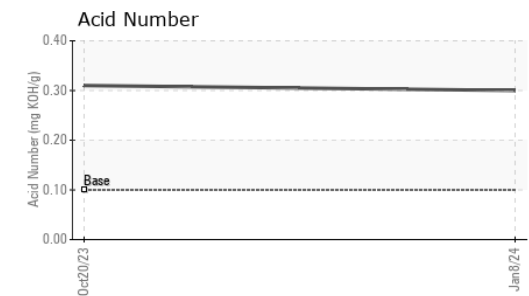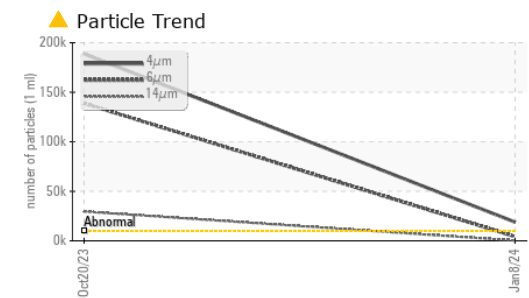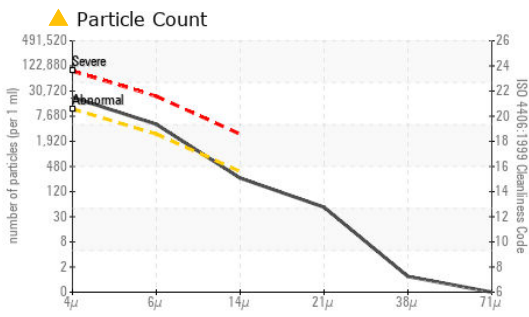

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO50001876 **Received** : 30 Jan 2024
Lab Number : 06074697 **Diagnosed** : 01 Feb 2024
Unique Number : 10856788 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

QUALITY COMPRESSOR
 4428 CR 616
 ALVARADO, TX
 US 76009
 Contact: SEAN
 SEAN@QCOMPRESSOR.COM
 T: (817)822-1333
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)