



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Machine Id
QUINCY 88362 - BUILDERS 1ST DALLAS

Component
Compressor

Fluid
QUINCY QUINSYN (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.











CONTAMINATION

There is a high amount of particulates present in the oil. The water content is negligible.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		TO50001868	QUC0000523	QUC0000472
Sample Date		Client Info		24 Jan 2024	24 Oct 2023	14 Jul 2023
Machine Age	hrs	Client Info		16381	0	15580
Oil Age	hrs	Client Info		0	10	0
Filter Age	hrs	Client Info		0	3	0
Oil Changed		Client Info		Changed	Not Changed	Not Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	SEVERE
Iron	ppm	ASTM D5185m	>50	12	6	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		<1	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	2	3	---
Lead	ppm	ASTM D5185m	>25	0	0	---
Copper	ppm	ASTM D5185m	>50	2	0	---
Tin	ppm	ASTM D5185m	>15	<1	<1	---
Vanadium	ppm	ASTM D5185m		0	0	---
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Silicon	ppm	ASTM D5185m	>25	<1	2	---
Potassium	ppm	ASTM D5185m	>20	3	1	---
Water	%	ASTM D6304	>0.1	0.007	0.005	90.0
ppm Water	ppm	ASTM D6304	>1000	80	53.0	900000
Particles >4µm		ASTM D7647	>10000	82389	101395	---
Particles >6µm		ASTM D7647	>2500	20728	38627	---
Particles >14µm		ASTM D7647	>320	621	3160	---
Particles >21µm		ASTM D7647	>80	97	726	---
Particles >38µm		ASTM D7647	>20	2	19	---
Particles >71µm		ASTM D7647	>4	0	1	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	24/22/16	24/22/19	---
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	0.2%
Sodium	ppm	ASTM D5185m		<1	4	---
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		<1	0	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m		<1	<1	---
Calcium	ppm	ASTM D5185m		0	2	---
Phosphorus	ppm	ASTM D5185m		82	99	---
Zinc	ppm	ASTM D5185m		67	47	---
Sulfur	ppm	ASTM D5185m		903	837	---
Acid Number (AN)	mg KOH/g	ASTM D8045	.10	0.28	0.25	---
Visc @ 40°C	cSt	ASTM D445	44.6	50.6	49.8	---
Visc @ 100°C	cSt	ASTM D445	7.8	8.5	8.3	---
Viscosity Index (VI)	Scale	ASTM D2270	132	144	140	---

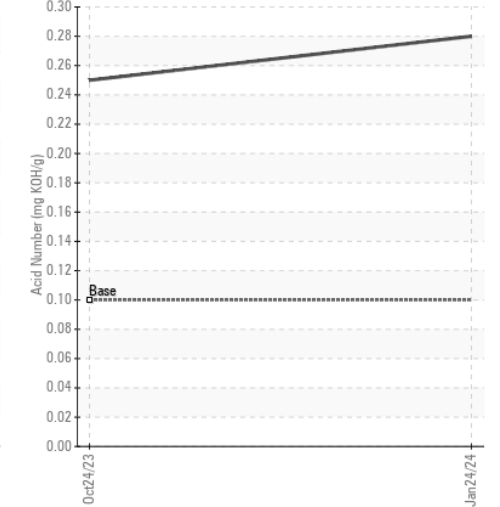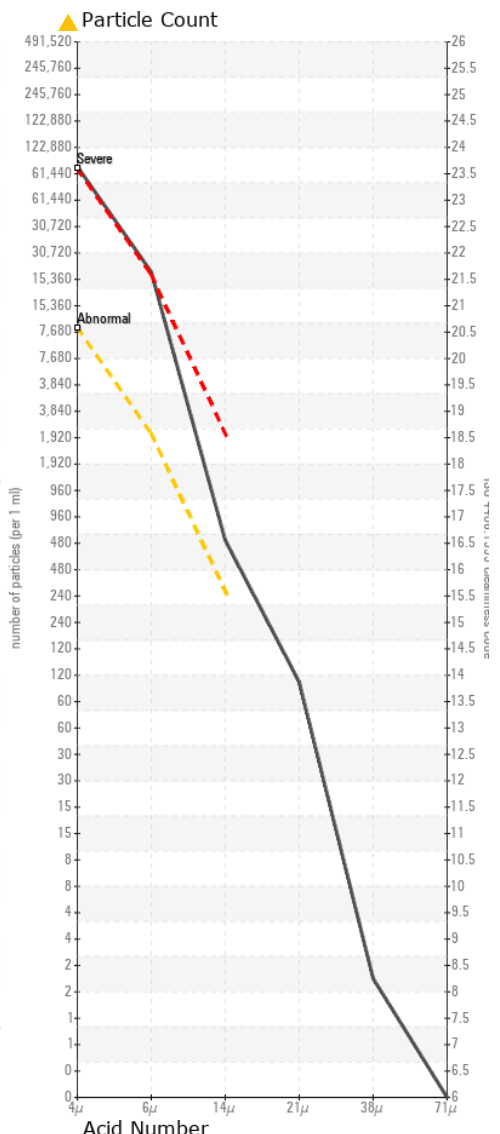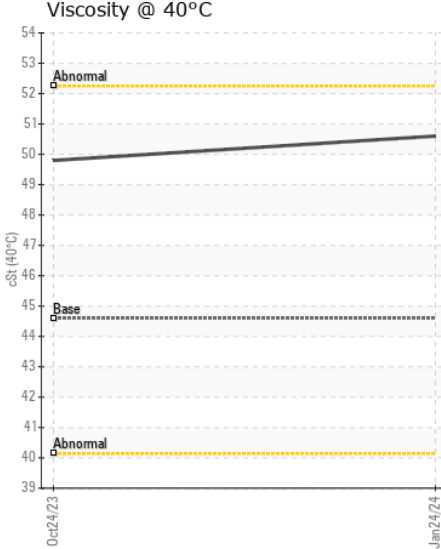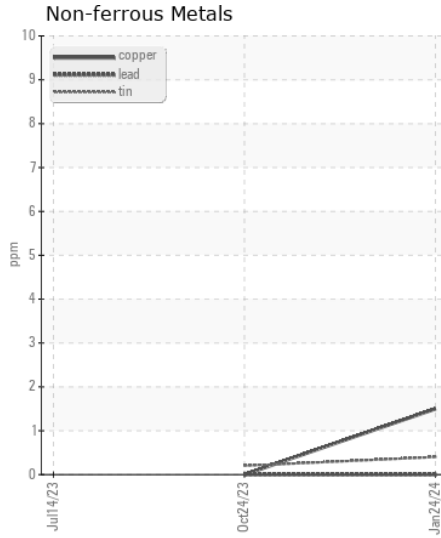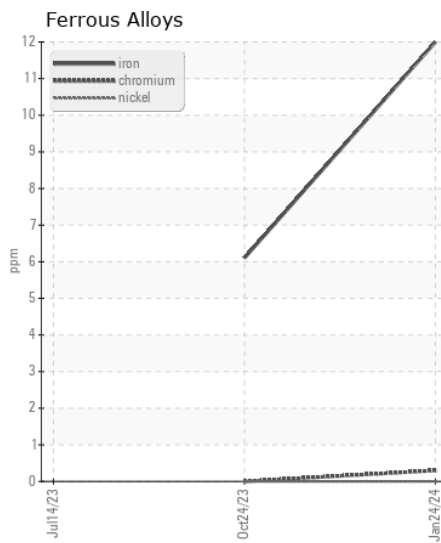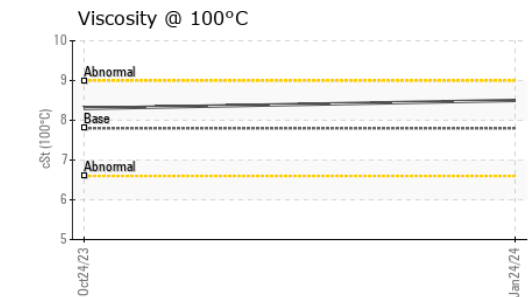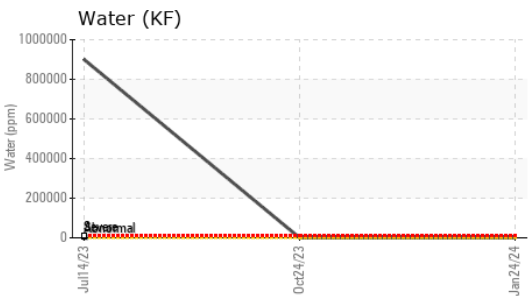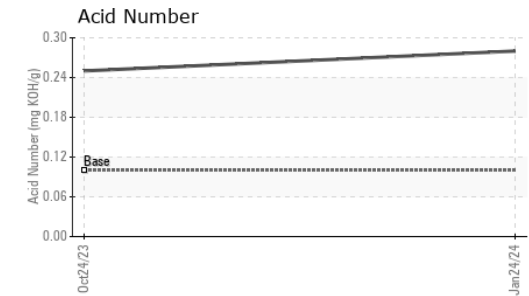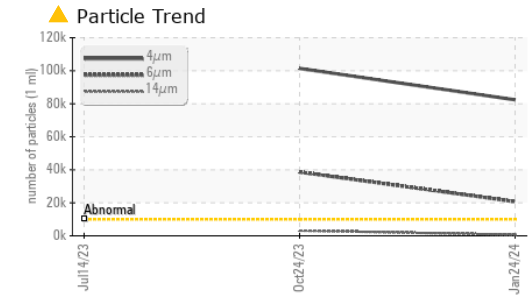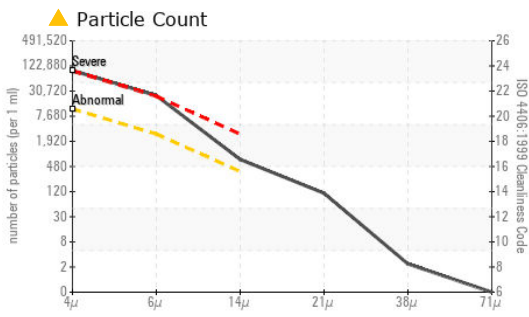

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO50001868 **Received** : 30 Jan 2024
Lab Number : 06074708 **Diagnosed** : 01 Feb 2024
Unique Number : 10856799 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

QUALITY COMPRESSOR
 4428 CR 616
 ALVARADO, TX
 US 76009
 Contact: SEAN
 SEAN@QCOMPRESSOR.COM
 T: (817)822-1333
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)