



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	ATTENTION

Area
SYN-5
Machine Id
GARDNER DENVER S522313
Component
Compressor
Fluid
{not provided} (--- GAL)

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.

CONTAMINATION


There is no indication of any contamination in the oil.

FLUID CONDITION


The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UAC06074831	---	---
Sample Date		Client Info		06 Dec 2023	---	---
Machine Age	hrs	Client Info		6951	---	---
Oil Age	hrs	Client Info		6951	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				ATTENTION	---	---
Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m		<1	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	0	---	---
Lead	ppm	ASTM D5185m	>25	0	---	---
Copper	ppm	ASTM D5185m	>50	0	---	---
Tin	ppm	ASTM D5185m	>15	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Silicon	ppm	ASTM D5185m	>25	<1	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water		WC Method	>0.1	NEG	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Sodium	ppm	ASTM D5185m		<1	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		2	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		<1	---	---
Calcium	ppm	ASTM D5185m		<1	---	---
Phosphorus	ppm	ASTM D5185m		406	---	---
Zinc	ppm	ASTM D5185m		0	---	---
Sulfur	ppm	ASTM D5185m		1295	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		0.16	---	---
Visc @ 40°C	cSt	ASTM D445		▲ 55.3	---	---


▲ Viscosity @ 40°C

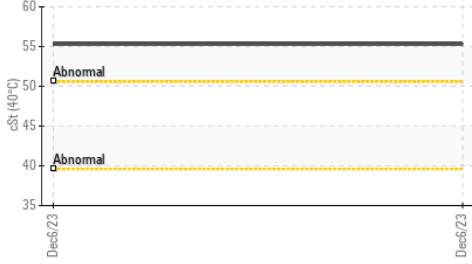


Ferrous Alloys

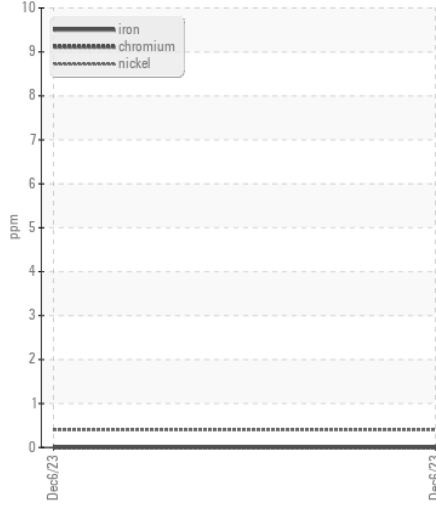


Acid Number

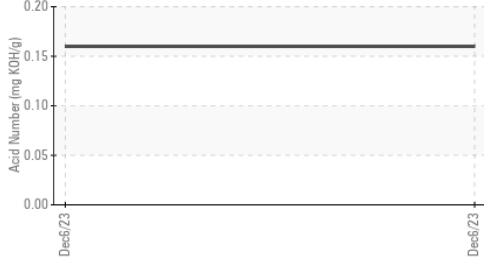


Non-ferrous Metals

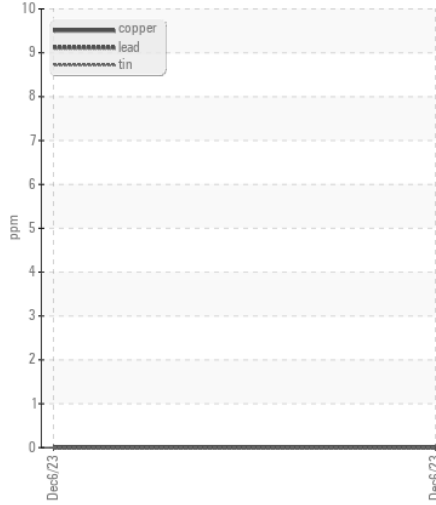

▲ Viscosity @ 40°C

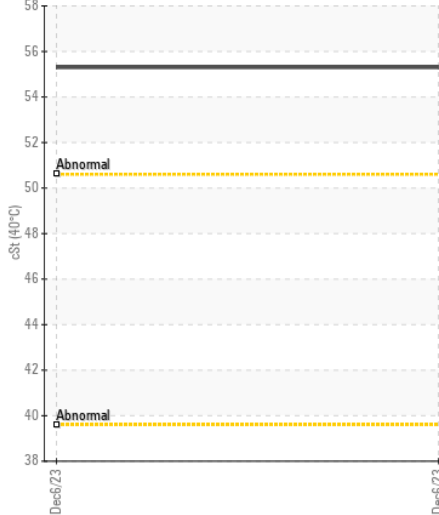

Acid Number

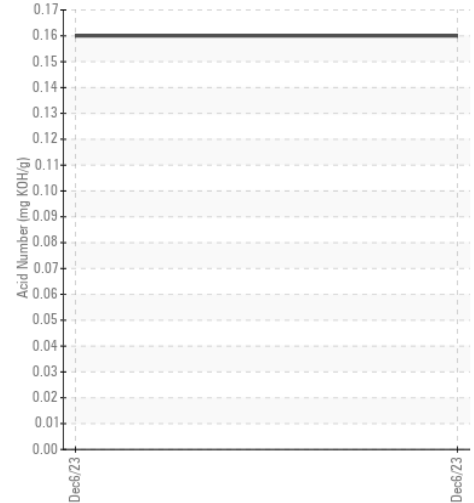

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : UAC06074831

Lab Number : 06074831

Unique Number : 10856922

Test Package : IND 2

Received : 30 Jan 2024

Tested : 31 Jan 2024

Diagnosed : 01 Feb 2024 - Don Baldrige

ATLANTIC COMPRESSORS

2144 SALEM INDUSTRIAL DRIVE

SALEM, VA

US 24153

Contact: BILL RIMER

bill@atlanticcompressors.com

T: (540)728-1147

F: (757)216-0134

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)