

Machine Id 7388388 (S/N 1076) Component Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

WEAR	

All component wear rates are normal.

CONTAMINATION


There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

.....

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		KCPA010219		
Sample Date		Client Info		25 Jan 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Filter Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Filter Changed		Client Info		Changed		
Sample Status				ATTENTION		
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Silicon	ppm	ASTM D5185m	>25	<1		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.014		
ppm Water	ppm	ASTM D6304	>500	143		
Particles >4µm		ASTM D7647	1000	4513		
Particles >6µm		ASTM D7647	>1300	1453		
Particles >14µm		ASTM D7647	>80	61		
Particles >21µm		ASTM D7647	>20	13		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	1 9/18/13		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.05	NEG		
Sodium	ppm	ASTM D5185m		9		
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	15		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	72		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	16891		
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.36		
Visc @ 40°C	cSt	ASTM D445	45	46.3		
		•				

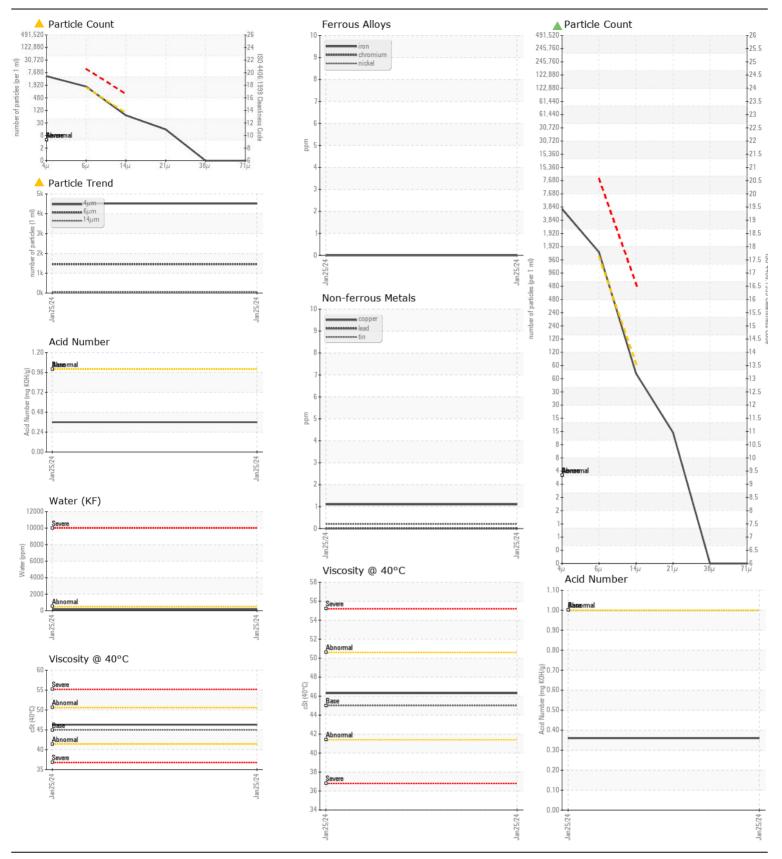

WEAVER AND COMPANY Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 Sample No. 565 NUCLA WAY, SUITE B : KCPA010219 Received : 31 Jan 2024 Lab Number : 06075784 AURORA, CO Tested :01 Feb 2024 Unique Number : 10857875 : 01 Feb 2024 - Don Baldridge US 80011 Diagnosed Test Package : IND 2 (Additional Tests: KF, PrtCount) Contact: Service Manager Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: F: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - WEAAUR