

2)

8148216 (S/N 1882) Component Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

RECOMMENDATION

Machine Id

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.



All component wear rates are normal.


CONTAMINATION

There is a high amount of particulates present in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				~~~~		
Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		KCPA007397	KCP53122	
Sample Date		Client Info		25 Jan 2024	26 Jan 2023	
Machine Age	hrs	Client Info		3775	1778	
Oil Age	hrs	Client Info		0	1778	
Filter Age	hrs	Client Info		0	1778	
Oil Changed		Client Info		N/A	Changed	
Filter Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	ABNORMAL	
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	4	4	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		<1	0	
White Metal	scalar	*Visual	NONE	LIGHT	LIGHT	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
		violai				
Silicon	ppm	ASTM D5185m	>25	<1	1	
Potassium	ppm	ASTM D5185m	>20	1	2	
Water	%	ASTM D6304	>0.05	0.024	0.016	
ppm Water	ppm	ASTM D6304	>500	243	164.7	
Particles >4µm	ppiii	ASTM D7647	2000	5829	142538	
Particles >6µm		ASTM D7647	>1300	A 2234	▲ 67690	
Particles >14µm		ASTM D7647	>80	▲ 242	▲ 2921	
Particles >21µm		ASTM D7647	>20	▲ 64	▲ 238	
Particles >38µm		ASTM D7647	>4	4	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 20/18/15	▲ 24/23/19	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	LIGHT	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	
	Scalai	visual	20.05	NEG	NLG	
Sodium	ppm	ASTM D5185m		13	16	
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	10	10	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m	-	<1	0	
Magnesium	ppm	ASTM D5185m	100	64	35	
Calcium	ppm	ASTM D5185m	0	0	<1	
Phosphorus	ppm	ASTM D5185m		<1	5	
Zinc		ASTM D5185m	0	7	16	
Sulfur	ppm	ASTM D5185m	23500	16679	18886	
Acid Number (AN)	ppm mg KOH/g	ASTM D5185111 ASTM D8045	1.0	0.38	0.38	
Visc @ 40°C	cSt	ASTM D6045 ASTM D445	45	44.9		
150 @ 40 0	COL	ASTIVI D445	40	44.9	50.7	

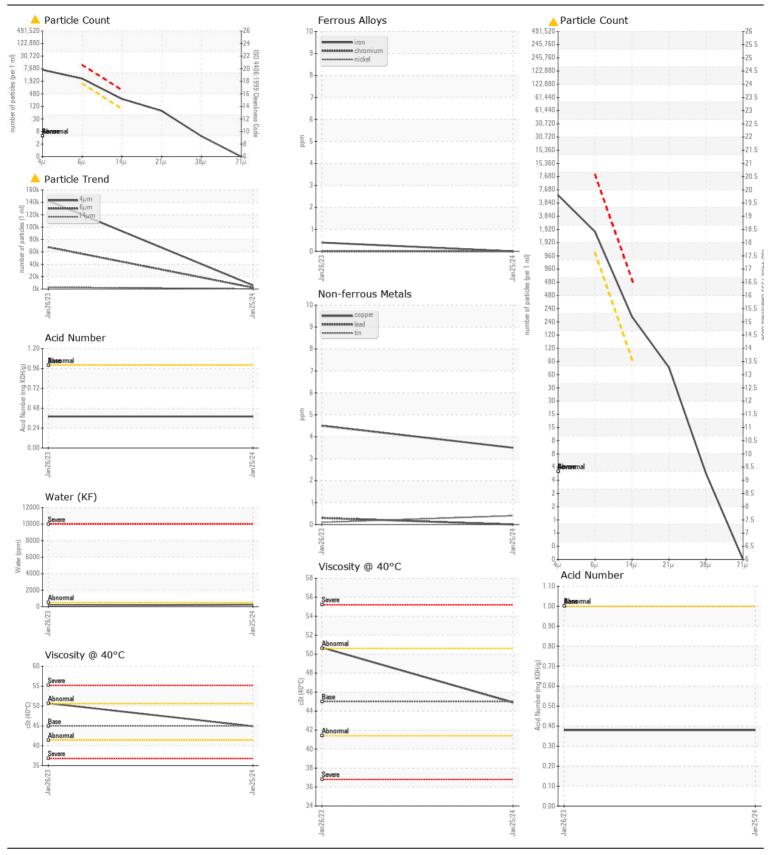

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 **E & J CABINETS** Sample No. : KCPA007397 4105 GLOBEVILLE RD Received : 31 Jan 2024 Lab Number : 06075785 DENVER, CO Tested :01 Feb 2024 Unique Number : 10857876 : 01 Feb 2024 - Don Baldridge US 80216 Diagnosed Test Package : IND 2 (Additional Tests: KF, PrtCount) Contact: JESSE Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. jesse@ejcabinets.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: F: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: EJCDEN [WUSCAR] 06075785 (Generated: 02/27/2024 10:36:45) Rev: 1

Ø

Contact/Location: JESSE ? - EJCDEN

Page 2 of 2