



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
ULTRA COOLANT 46
Machine Id
CBV491515 - WELLS PET FOOD
Component
Compressor

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCH06075962	UCH05018506	UCH04886190
Sample Date		Client Info		25 Jan 2024	26 Jun 2020	24 May 2019
Machine Age	hrs	Client Info		27777	19879	13337
Oil Age	hrs	Client Info		4000	2000	6500
Filter Age	hrs	Client Info		0	2000	0
Oil Changed		Client Info		N/A	Not Changd	Changed
Filter Changed		Client Info		N/A	Changed	Changed
Sample Status				NORMAL	ATTENTION	SEVERE

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	4	8
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		<1	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	1	<1	2
Lead	ppm	ASTM D5185m	>25	1	1	<1
Copper	ppm	ASTM D5185m	>50	1	4	4
Tin	ppm	ASTM D5185m	>15	1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	VLITE	NONE

CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	6	2	<1
Potassium	ppm	ASTM D5185m	>20	9	10	8
Water		WC Method	>0.1	NEG	NEG	NEG
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		60	107	65
Boron	ppm	ASTM D5185m	0	0	4	16
Barium	ppm	ASTM D5185m	500	616	221	144
Molybdenum	ppm	ASTM D5185m	0	0	0	<1
Manganese	ppm	ASTM D5185m		<1	1	<1
Magnesium	ppm	ASTM D5185m	0	2	0	<1
Calcium	ppm	ASTM D5185m	0	4	2	4
Phosphorus	ppm	ASTM D5185m	20	3	2	6
Zinc	ppm	ASTM D5185m	0	64	41	6
Sulfur	ppm	ASTM D5185m	200	357	179	241
Acid Number (AN)	mg KOH/g	ASTM D8045		0.48	▲ 2.686	● 7.515
Visc @ 40°C	cSt	ASTM D445	49.4	56.2	▲ 62.9	▲ 65.2

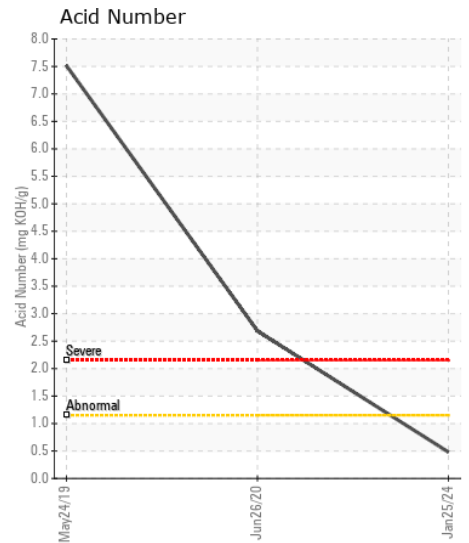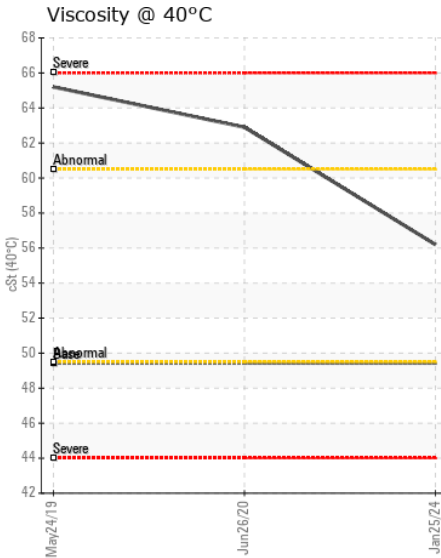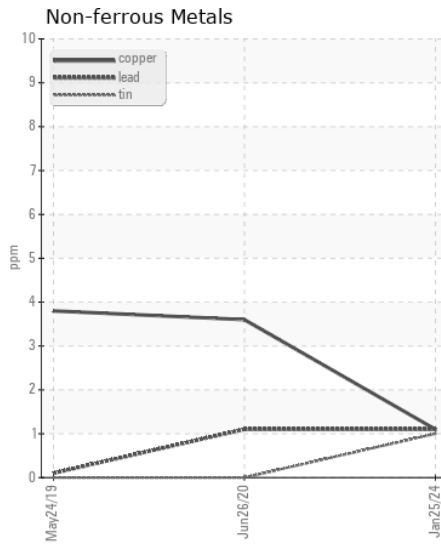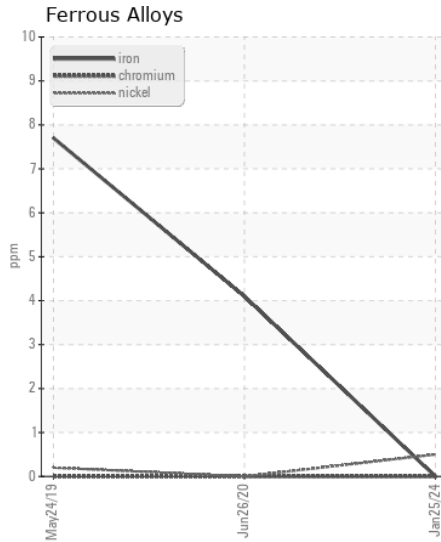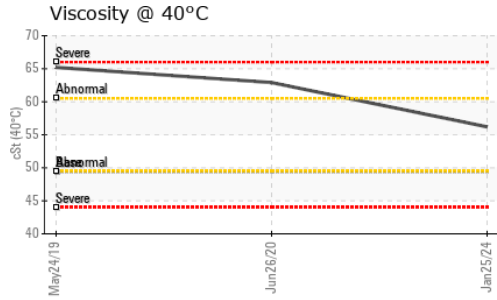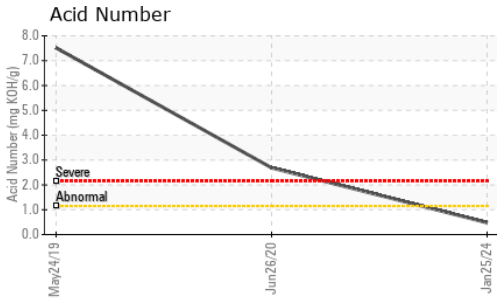

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06075962 **Received** : 31 Jan 2024
Lab Number : 06075962 **Diagnosed** : 02 Feb 2024
Unique Number : 10858053 **Diagnostician** : Don Baldrige
Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

A-L-L EQUIPMENT INC
 204 38TH ST
 MOLINE, IL
 US 61265

Contact: KEVIN DESPOT
 kevind@a-l-equipment.com
 T: (815)877-7000
 F: (309)762-9950