

[W47626]

NOT GIVEN JR0200130 - W47626 (S/N NO INFO ON SIF/BOTTLE)

Component **1 Diesel Engine** Fluid

{not provided} (--- GAL)

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor. Please specify the component make and model with your next sample. Please specify the brand, type, and viscosity of the oil on your next sample.	Sample Number		Client Info		JR0200130		
	Sample Date		Client Info		31 Jan 2024		
	Machine Age	hrs	Client Info		0		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				NORMAL		
WEAR	Iron	ppm	ASTM D5185m	<100	1		
	Chromium	ppm	ASTM D5185m		0		
All component wear rates are normal.	Nickel	ppm	ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m	~7	0		
	Silver	ppm	ASTM D5185m	-3	0		
	Aluminum	ppm	ASTM D5185m		2		
	Lead		ASTM D5185m		0		
	Copper	ppm ppm	ASTM D5185m		0		
	Tin	ppm	ASTM D5185m		۰ <1		
	Vanadium	ppm	ASTM D5185m	210	0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
		304141	1300				
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	5		
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m	>20	0		
	Fuel		WC Method	>5	<1.0		
	Water		WC Method	>0.2	NEG		
	Glycol		WC Method		NEG		
	Soot %	%	*ASTM D7844	>3	0.1		
	Nitration	Abs/cm	*ASTM D7624	>20	5.4		
	Sulfation	Abs/.1mm	*ASTM D7415	>30	21.4		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.2	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185m		<1		
	Boron		ASTM D5185m		70		
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		<1		
	Molybdenum	ppm	ASTM D5185m		40		
	Manganese	ppm	ASTM D5185m		-+0 <1		
	Magnesium	ppm	ASTM D5185m		477		
	Calcium		ASTM D5185m		1508		
	Phosphorus	ppm ppm	ASTM D5185m		724		
	Zinc		ASTM D5185m		846		
		ppm			040		

Sulfur

Oxidation

Visc @ 100°C cSt

ppm ASTM D5185m

Base Number (BN) mg KOH/g ASTM D2896

Abs/.1mm *ASTM D7414 >25


ASTM D445

2324

19.1

9.8

12.9

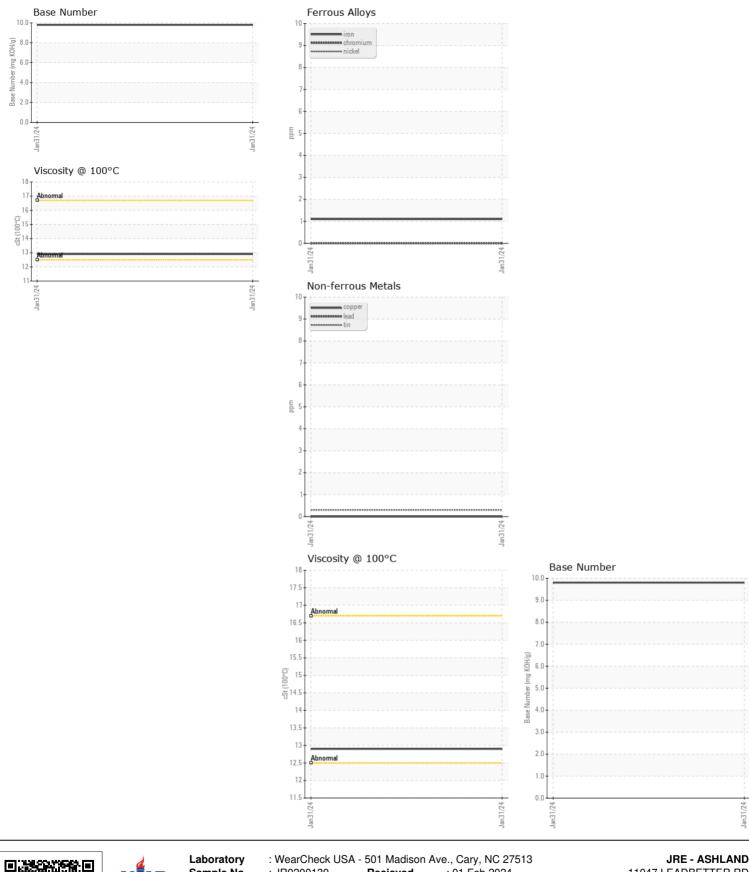

JRE - ASHLAND Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 Sample No. : JR0200130 Recieved :01 Feb 2024 11047 LEADBETTER RD Lab Number : 06076605 Diagnosed :01 Feb 2024 ASHLAND, VA : 10858696 Unique Number Diagnostician : Wes Davis US 23005 Test Package : CONST (Additional Tests: TBN) Contact: JOHN BRUMMER Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. jbrummer@jrenet.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (804)798-0292

ē

Contact/Location: JOHN BRUMMER - JAMASH