



**LEAHY-WOLF**  
Lubricating specialists since 1946

**OIL ANALYSIS REPORT**

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>



Machine Id  
**4016**  
Component  
**Diesel Engine**  
Fluid  
**DIESEL ENGINE OIL SAE 40 (--- GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>LW0008620</b>	LW0007894	LW0005535
Sample Date		Client Info		<b>27 Jan 2024</b>	06 Nov 2023	22 Mar 2023
Machine Age	mls	Client Info		<b>0</b>	0	0
Oil Age	mls	Client Info		<b>0</b>	0	0
Filter Age	mls	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>120	<b>12</b>	10	16
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>5	<b>3</b>	3	4
Titanium	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	<1
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>2</b>	1	2
Lead	ppm	ASTM D5185m	>40	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>330	<b>5</b>	2	43
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>2</b>	9	5
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	<1	3
Fuel		WC Method	>3.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844	>4	<b>1</b>	0.7	0.8
Nitration	Abs/cm	*ASTM D7624	>20	<b>8.9</b>	7.3	9.4
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>20.4</b>	19.4	21.4
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>216	<b>0</b>	2	2
Boron	ppm	ASTM D5185m	250	<b>&lt;1</b>	4	26
Barium	ppm	ASTM D5185m	10	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m	100	<b>62</b>	57	34
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	450	<b>927</b>	1007	474
Calcium	ppm	ASTM D5185m	3000	<b>1043</b>	1091	1541
Phosphorus	ppm	ASTM D5185m	1150	<b>941</b>	1006	973
Zinc	ppm	ASTM D5185m	1350	<b>1200</b>	1309	1183
Sulfur	ppm	ASTM D5185m	4250	<b>2774</b>	3067	3362
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>16.4</b>	14.8	14.9
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>7.5</b>	8.7	6.0
Visc @ 100°C	cSt	ASTM D445	14.4	<b>14.0</b>	14.2	14.0

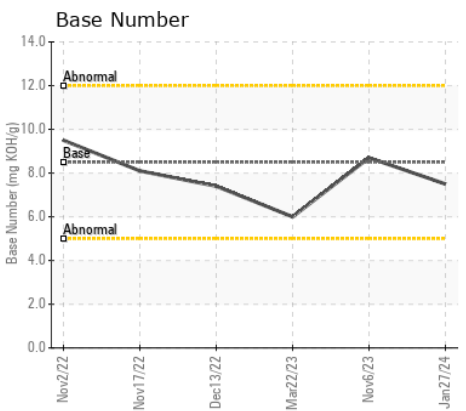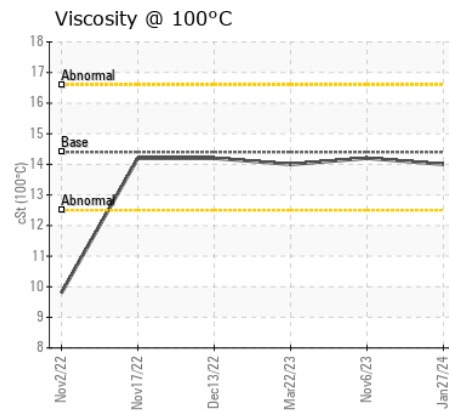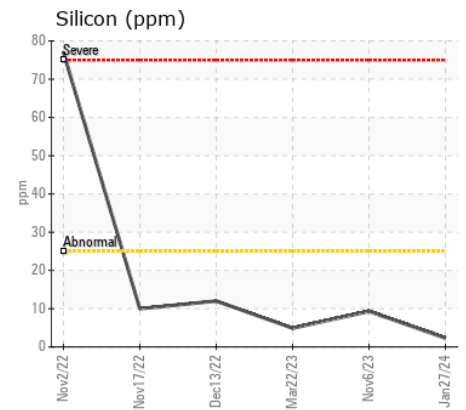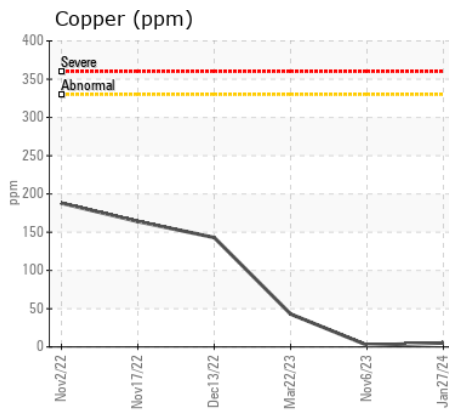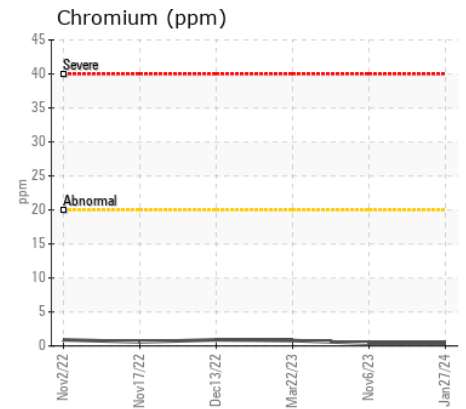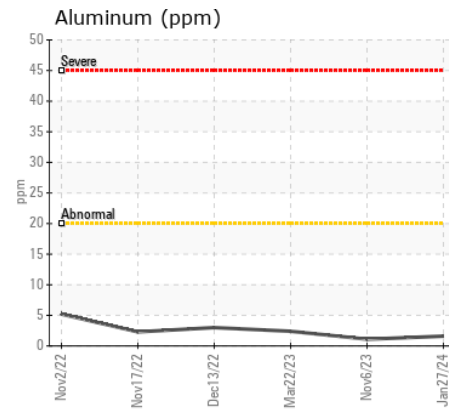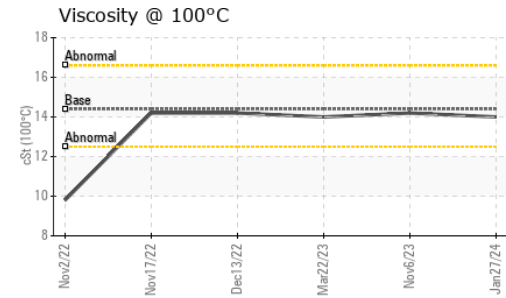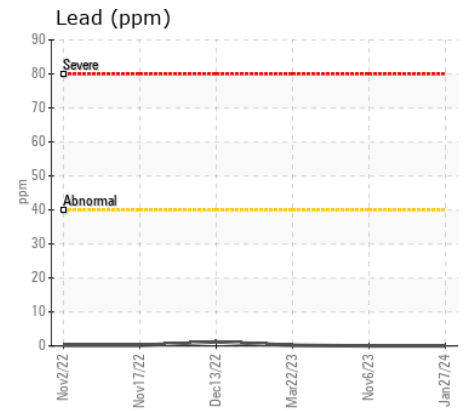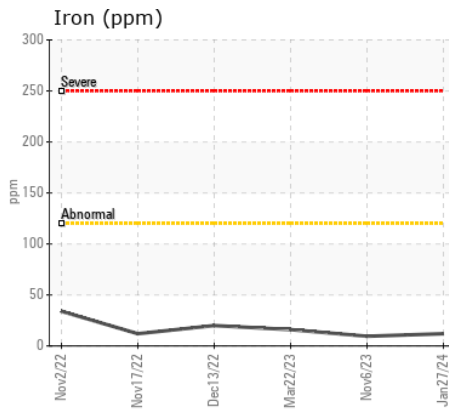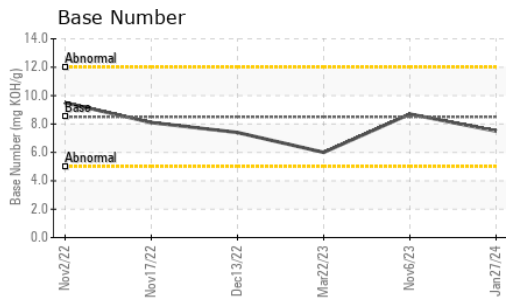

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : LW0008620 **Received** : 01 Feb 2024  
**Lab Number** : 06076734 **Diagnosed** : 02 Feb 2024  
**Unique Number** : 10858825 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: TBN )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**LRS - NILES**  
 33541 REUM RD  
 NILES, MI  
 US 49120

Contact: JOHN HUGHES  
johnh@michianarecyclinganddisposal.com

T: (269)684-0900 X:124

F: