



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**PALASYN 45 [45562]**

Machine Id  
**SULLIVAN PALATEK 19KE000540 - COLORADO MOLDED PLASTICS**

Component  
**Compressor**

### RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>UCS06077027</b>	UCS05792959	UCS05630082
Sample Date		Client Info		<b>24 Jan 2024</b>	16 Feb 2023	15 Aug 2022
Machine Age	hrs	Client Info		<b>10333</b>	7369	5833
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>Not Changed</b>	Not Changed	Not Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

### WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

### CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>1</b>	1	2
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	MODER	MODER
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

### FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>0</b>	0	0
Boron	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	0.0	<b>&lt;1</b>	0	<1
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	0.0	<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185m	0.0	<b>&lt;1</b>	<1	0
Phosphorus	ppm	ASTM D5185m	966	<b>485</b>	417	480
Zinc	ppm	ASTM D5185m	0	<b>2</b>	0	0
Sulfur	ppm	ASTM D5185m	1309	<b>761</b>	1134	1279
Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	<b>0.19</b>	0.17	0.15
Visc @ 40°C	cSt	ASTM D445	39.9	<b>44.8</b>	45.3	43.3

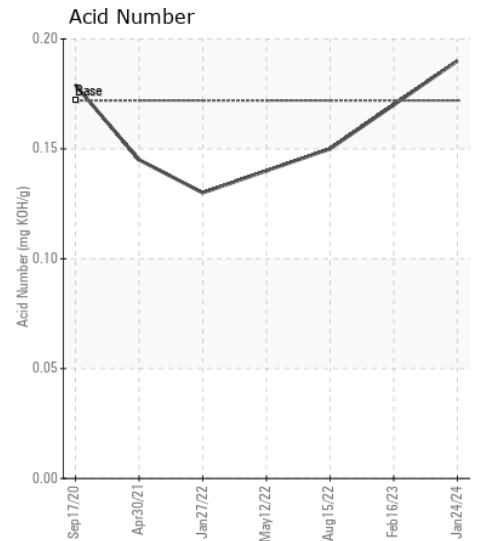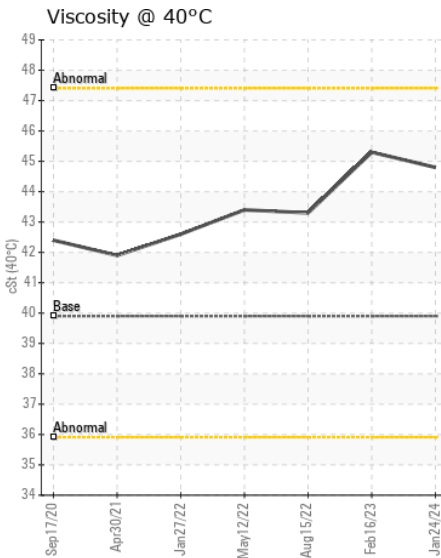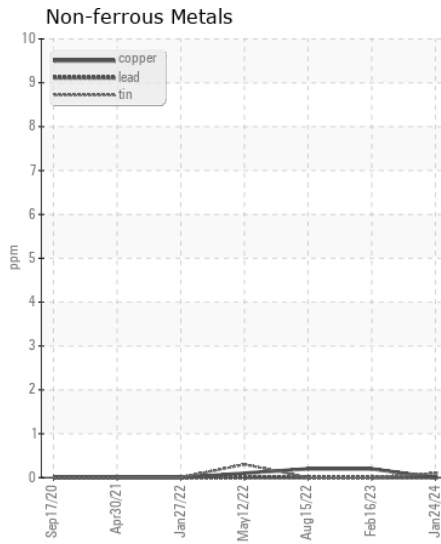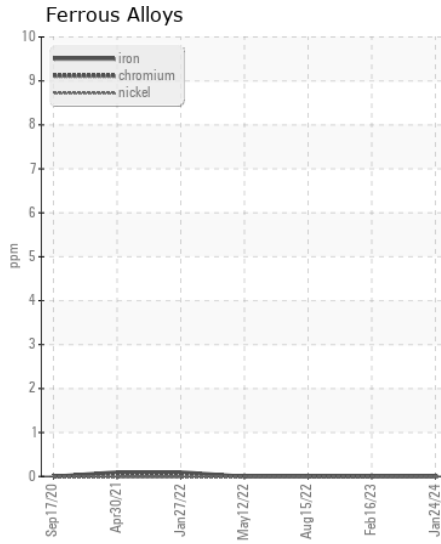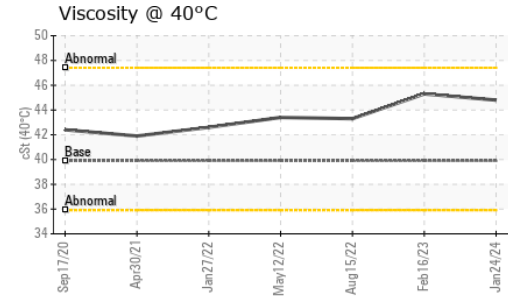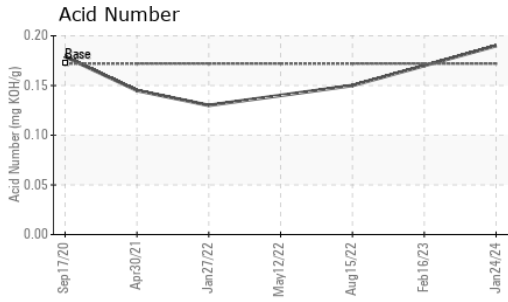

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06077027 **Received** : 01 Feb 2024  
**Lab Number** : 06077027 **Diagnosed** : 02 Feb 2024  
**Unique Number** : 10859118 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**COMPRESSION LEASING SERVICES INC**  
 5530 JOLIET ST  
 DENVER, CO  
 US 80239  
 Contact: HEATH NORRIS  
 hnorris@cls-inc.com  
 T: (308)733-4882  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)