


## Machine Id ONAN C180327971 Component Center Genset MOBIL DELVAC 1300 SUPER15W40 (5 QTS) F

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		VPA060608		
	Sample Date		Client Info		30 Jan 2024		
	Machine Age	hrs	Client Info		14206		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		Not Changd		
	Filter Changed		Client Info		Not Changd		
	Sample Status				NORMAL		
WEAR All component wear rates are normal.	Iron	ppm	ASTM D5185m	<u>\</u> 50	17		
	Chromium	ppm	ASTM D5185m		<1		
	Nickel		ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m	>2	<1		
	Silver	ppm	ASTM D5185m	. E	<1 0		
		ppm					
	Aluminum	ppm	ASTM D5185m		4		
	Lead	ppm	ASTM D5185m		1		
	Copper Tin	ppm	ASTM D5185m		<1		
		ppm	ASTM D5185m	>15	<1		
	Vanadium	ppm	ASTM D5185m	NONE	0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION There is no indication of any contamination in the oil.	Silicon	ppm	ASTM D5185m	>25	9		
	Potassium	ppm	ASTM D5185m	>20	<1		
	Fuel		WC Method	>4.0	<1.0		
	Water		WC Method	>0.1	NEG		
	Glycol		WC Method		NEG		
	Soot %	%	*ASTM D7844		0.1		
	Nitration	Abs/cm	*ASTM D7624	>20	10.5		
	Sulfation	Abs/.1mm	*ASTM D7415	>30	20.2		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
FLUID CONDITION					•		
	Sodium Boron	ppm	ASTM D5185m ASTM D5185m	0	3 66		
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is acceptable for the time in service.	Barium	ppm ppm	ASTM D5185m		<1		
	Molybdenum	ppm	ASTM D5185m		109		
	Manganese	ppm	ASTM D5185m	-	<1		
	Magnesium	ppm	ASTM D5185m	0	645		
	Calcium	ppm	ASTM D5185m	-	1365		
	Phosphorus	ppm	ASTM D5185m		750		
	Zinc	ppm	ASTM D5185m		872		
	Sulfur	ppm	ASTM D5185m		2812		
	Oxidation	Abs/.1mm	*ASTM D3103111	>25	2012		
	Base Number (BN)				6.3		
		ing KOTi/g		0.4	0.5		

Visc @ 100°C cSt

ASTM D445 14

13.7

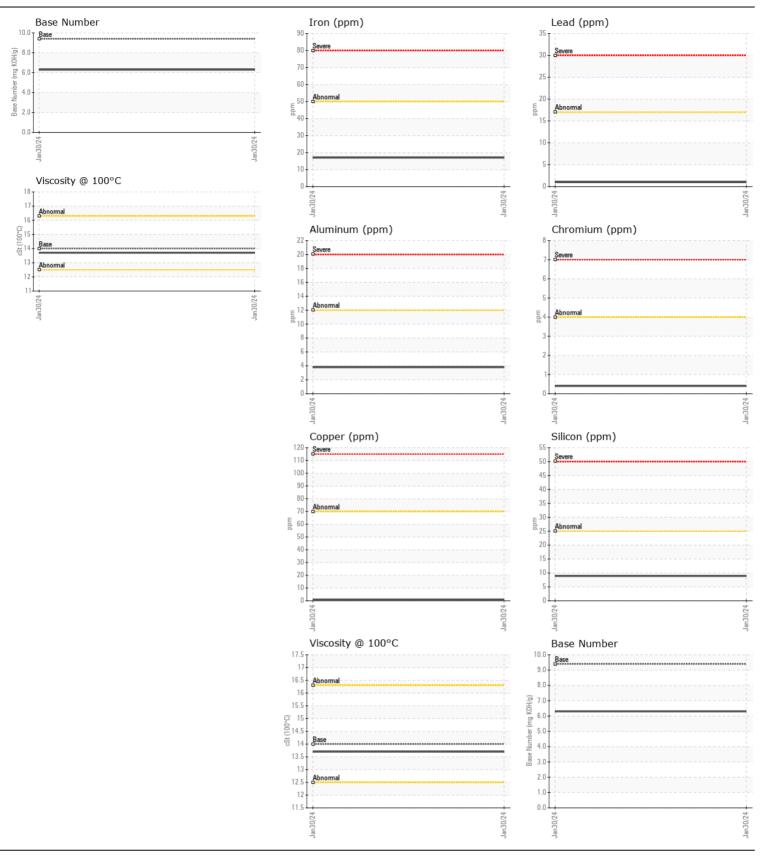

**CAROLINA MARINE DIESEL** Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 Sample No. Recieved :01 Feb 2024 PO BOX 24159 : VPA060608 Lab Number :04 Feb 2024 HILTON HEAD, SC :06077340 Diagnosed : 10859431 Diagnostician : Don Baldridge US 29925 Unique Number Test Package : MOB 1 (Additional Tests: TBN) Contact: KEVIN JACKSON Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. cmdieselsc@gmail.com \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (843)830-9202 F: (843)681-9976 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: KEVIN JACKSON - CARHILSC

Page 2 of 2