



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL



Area
{UNASSIGNED}
Machine Id
TRANE Trinity St.Joe Trane 2B (S/N L97A00694)
Component
Centrifugal Compressor
Fluid
TRANE 0022 (8 GAL)

RECOMMENDATION

Resample at the next service interval to monitor. (Customer Sample Comment: Annual test)

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0758322	---	---
Sample Date		Client Info		22 Jan 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	1	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m		<1	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	<1	---	---
Lead	ppm	ASTM D5185m	>25	2	---	---
Copper	ppm	ASTM D5185m	>50	3	---	---
Tin	ppm	ASTM D5185m	>15	3	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION








The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	1	---	---
Potassium	ppm	ASTM D5185m	>20	3	---	---
Water	%	ASTM D6304	>0.005	0.002	---	---
ppm Water	ppm	ASTM D6304	>50	21	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.005	NEG	---	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		2	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		<1	---	---
Manganese	ppm	ASTM D5185m		2	---	---
Magnesium	ppm	ASTM D5185m		<1	---	---
Calcium	ppm	ASTM D5185m		<1	---	---
Phosphorus	ppm	ASTM D5185m		8	---	---
Zinc	ppm	ASTM D5185m		49	---	---
Sulfur	ppm	ASTM D5185m		0	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		0.07	---	---
Visc @ 40°C	cSt	ASTM D445		48.2	---	---

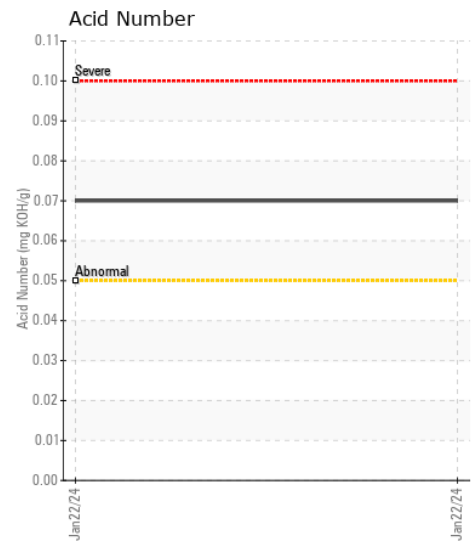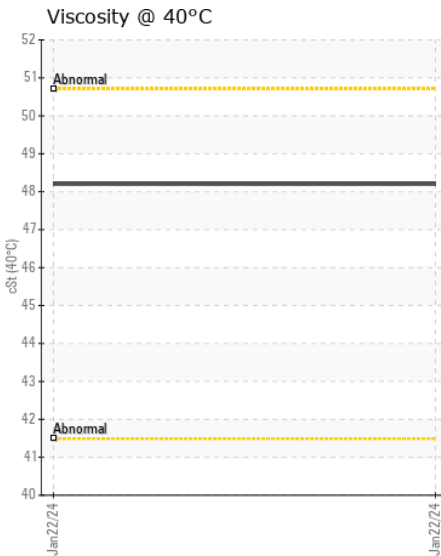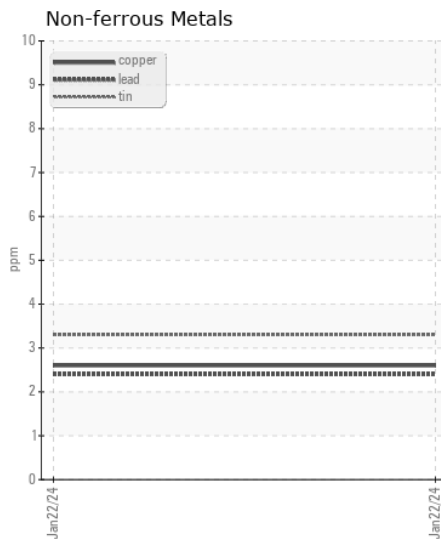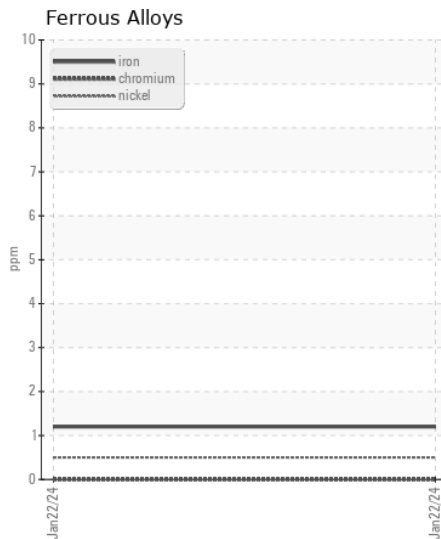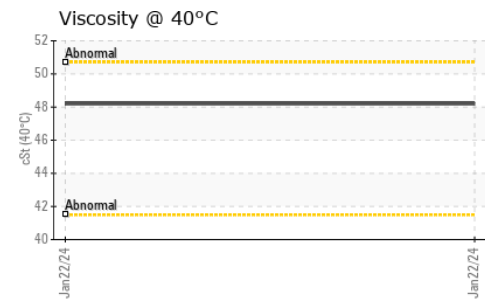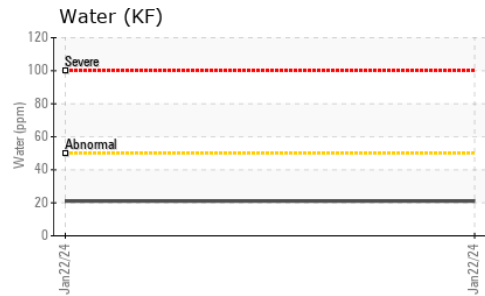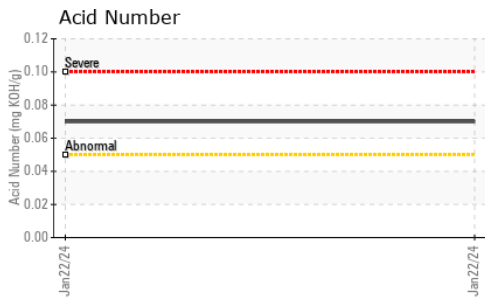

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0758322
Lab Number : 06077748
Unique Number : 10859839
Test Package : PLANT

Received : 01 Feb 2024
Tested : 05 Feb 2024
Diagnosed : 05 Feb 2024 - Jonathan Hester

DAIKIN APPLIED - AUBURN HILLS
 3955 PINNACLE COURT SUITE 300
 AUBURN HILLS, MI
 US 48326

Contact: RICK VANOVERBEKE
 richard.vanoverbeke@daikinapplied.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (248)464-8429
 F: (248)365-4001