WEAR CONTAMINATION **FLUID CONDITION**


NORMAL NORMAL NORMAL

MATTEI 10009303-2019

Component Compressor

Fluid .

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History
Resample at the next service interval to monitor.	Sample Number		Client Info		AN37724	AN37497	
	Sample Date		Client Info		17 Jan 2024	28 Apr 2023	
	Machine Age	hrs	Client Info		4078	3119	
	Oil Age	hrs	Client Info		0	0	
	Filter Age	hrs	Client Info		0	0	
	Oil Changed		Client Info		N/A	Changed	
	Filter Changed		Client Info		N/A	N/A	
	Sample Status				NORMAL	ABNORMAL	
VEAR	Iron	ppm	ASTM D5185m	>50	16	8	
All component wear rates are normal.	Chromium	ppm	ASTM D5185m		0	<1	
	Nickel	ppm	ASTM D5185m	7.0	0	1	
	Titanium	ppm	ASTM D5185m		0	0	
	Silver	ppm	ASTM D5185m		0	0	
	Aluminum	ppm	ASTM D5185m	>25	<1	3	
	Lead	ppm	ASTM D5185m		0	<1	
	Copper	ppm	ASTM D5185m		<1	<1	
	Tin	ppm	ASTM D5185m		0	2	
	Vanadium	ppm	ASTM D5185m	/10	0	0	
	White Metal	scalar	*Visual	NONE	NONE	LIGHT	
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
<u></u>	Tellow Metal		visuai	NONL	INONE	INOINL	
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	34	<u> </u>	
The water content is negligible. There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m	>20	0	2	
	Water	%	ASTM D6304	>0.1	0.026	0.036	
	ppm Water	ppm	ASTM D6304	>1000	266	366.8	
	Silt	scalar	*Visual	NONE	NONE	NONE	
	Debris	scalar	*Visual	NONE	NONE	LIGHT	
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
	Appearance	scalar	*Visual	NORML	NORML	NORML	
	Odor	scalar	*Visual	NORML	NORML	NORML	
	Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	
LUID CONDITION	Sodium	ppm	ASTM D5185m		11	3	
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Boron	ppm	ASTM D5185m		0	0	
	Barium	ppm	ASTM D5185m		0	0	
	Molybdenum	ppm	ASTM D5185m		0	0	
	Manganese	ppm	ASTM D5185m		0	<1	
	Magnesium	ppm	ASTM D5185m		0	2	
	Calcium	ppm	ASTM D5185m		0	0	
	Phosphorus	ppm	ASTM D5185m		940	1188	
	Zinc		ASTM D5185m		96	10	
	Sulfur	ppm	ASTM D5185m		234	129	
		ppm ppm	ASTM D3163111 ASTM D8045		0.23	0.26	
	Acid Number (AN) Visc @ 40°C	mg KOH/g cSt	ASTM D6045		83.1	78.7	
			4311// 1/4/45		0.5 1	/0/	

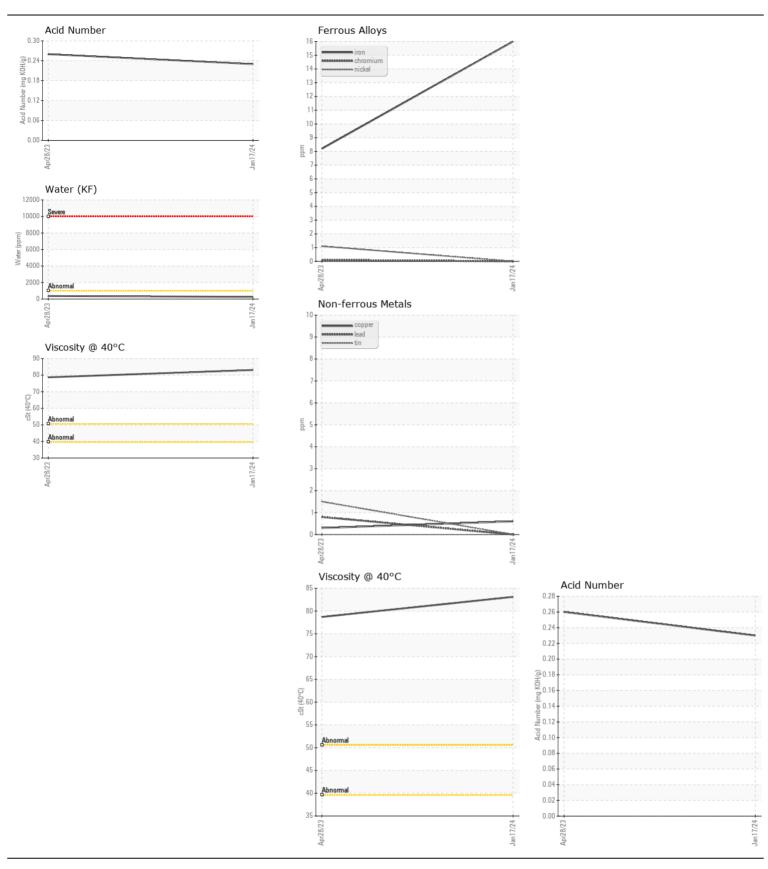





Certificate L2367

Laboratory Sample No.

: AN37724 Lab Number : 06083074 Unique Number: 10870519 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received : 07 Feb 2024 **Tested** Diagnosed

: 12 Feb 2024 : 12 Feb 2024 - Jonathan Hester MATTEI COMPRESSORS--OEM

9635 LIBERTY ROAD, SUITE E RANDALLSTOWN, MD

US 21133 Contact: MARTY WARD

jward@matteicomp.com T: (410)521-7020

F: (410)521-7024

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)