

NOT GIVEN Machine Id ATLAS COPCO AIF117079 - TULSA CEMENT PLANT 2 Component Compressor

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

W	ΙE,	AR

All component wear rates are normal.

CONTAMINATION


There is no indication of any contamination in the oil.

CI.	1.11		0	ND	ITI.		
ГL	UI.	υ		שאו		UN	

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCH06084322		
Sample Date		Client Info		29 Jan 2024		
Machine Age	hrs	Client Info		16904		
Oil Age	hrs	Client Info		8000		
Filter Age	hrs	Client Info		8000		
Oil Changed		Client Info		Changed		
Filter Changed		Client Info		Changed		
Sample Status				ABNORMAL		
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	<1		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	0		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	0		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Silioon			. 0F	10		
Silicon Potassium	ppm	ASTM D5185m	>35 >20	12		
	ppm	ASTM D5185m		0		
Water		WC Method	>0.1	NEG		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Sodium	ppm	ASTM D5185m		1		
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		2		
Phosphorus	ppm	ASTM D5185m		25		
Zinc	ppm	ASTM D5185m		1		
Sulfur	ppm	ASTM D5185m		76		
Acid Number (AN)	mg KOH/g	ASTM D8045		1.16		
Visc @ 40°C	cSt	ASTM D445		▲ 51.3		
	501					

Contact/Location: ASHLEY PIGUET - UCGRECLA

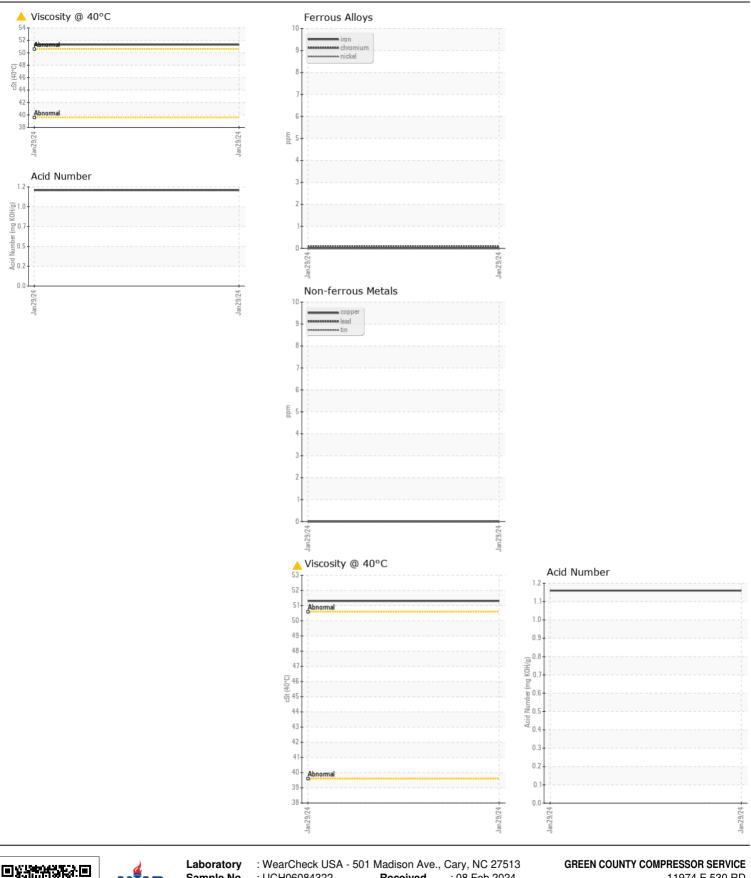

Sample No. : UCH06084322 Received :08 Feb 2024 11974 E 530 RD Lab Number : 06084322 :09 Feb 2024 CLAREMORE, OK Tested Unique Number : 10871767 : 12 Feb 2024 - Don Baldridge US 74019 Diagnosed Test Package : IND 2 Contact: ASHLEY PIGUET Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. ashley@gccs.us.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (918)906-6343 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F:

Contact/Location: ASHLEY PIGUET - UCGRECLA