
WEAR CONTAMINATION FLUID CONDITION

NORMAL
ATTENTION
NORMAL

NOT GIVEN [8371]
Machine Id
KAESER 1471 - EAGLE FOODS

Component Compressor

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.	Sample Number		Client Info		UCH06084890		
	Sample Date		Client Info		31 Jan 2024		
	Machine Age	hrs	Client Info		45025		
	Oil Age	hrs	Client Info		716		
	Filter Age	hrs	Client Info		716		
	Oil Changed		Client Info		Changed		
	Filter Changed		Client Info		Changed		
	Sample Status				ATTENTION		
WEAR	Iron	ppm	ASTM D5185m	>50	0		
All component wear rates are normal.	Chromium	ppm	ASTM D5185m	>10	0		
	Nickel	ppm	ASTM D5185m	>3	0		
	Titanium	ppm	ASTM D5185m	>3	0		
	Silver	ppm	ASTM D5185m		0		
	Aluminum	ppm	ASTM D5185m	>10	0		
	Lead	ppm	ASTM D5185m	>10	<1		
	Copper	ppm	ASTM D5185m	>50	<1		
	Tin	ppm	ASTM D5185m	>10	0		
	Vanadium	ppm	ASTM D5185m		0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Ciliana		ACTM DE10E	05	•		
CONTAMINATION	Silicon	ppm	ASTM D5185m		0		
Moderate concentration of visible dirt/debris present in the oil. Free water present.	Potassium Water	ppm %	ASTM D5185m ASTM D6304		0 000		
	ppm Water		ASTM D6304		0.023 230		
	Silt	ppm scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	MODER		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water		*Visual	>0.05	0.2%		
FLUID CONDITION	Sodium	ppm	ASTM D5185m		<1		
The AN level is acceptable for this fluid. Papert Id: LICDEL DOW IMILISCAPI 06084890 (Congreted: 02/21/2024 10:00:50) Pay: 1	Boron	ppm	ASTM D5185m		0		
	Barium	ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		0		
	Manganese	ppm	ASTM D5185m		<1		
	Magnesium	ppm	ASTM D5185m		0		
	Calcium	ppm	ASTM D5185m		0		
	Phosphorus	ppm	ASTM D5185m		0		
	Zinc	ppm	ASTM D5185m		0		
	Sulfur	ppm	ASTM D5185m		1576		
	Acid Number (AN)	mg KOH/g	ASTM D8045		0.085		
	Visc @ 40°C	cSt	ASTM D445		41.6		

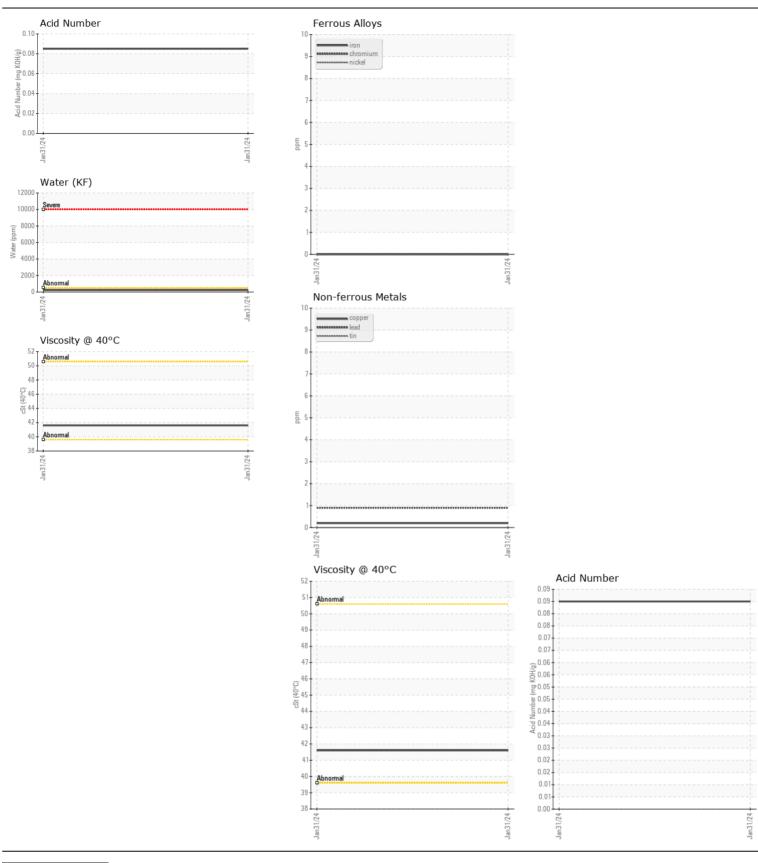



Certificate L2367

Laboratory Sample No.

Lab Number : 06084890

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06084890

Unique Number : 10872335

Tested Diagnosed

Received

: 09 Feb 2024 : 12 Feb 2024

: 12 Feb 2024 - Don Baldridge

Test Package : IND 2 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

DELTA INDUSTRIES - DOWNERS GROVE

2201 CURTISS STREET DOWNERS GROVE, IL US 60515

Contact: MICHAEL FERRIS

F: (630)960-3931