



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
LGS00181
Component
Middle Biogas Engine
Fluid
CITGO PACEMAKER GAS ENGINE LFG LA 40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0803453	WC0803455	WC0803458
Sample Date		Client Info		05 Feb 2024	30 Jan 2024	15 Jan 2024
Machine Age	hrs	Client Info		65250	65111	64756
Oil Age	hrs	Client Info		95	448	93
Filter Age	hrs	Client Info		587	448	93
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ABNORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>45	0	4	1
Chromium	ppm	ASTM D5185m	>2	0	<1	0
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	2	<1
Lead	ppm	ASTM D5185m	>5	2	0	0
Copper	ppm	ASTM D5185m	>14	<1	1	<1
Tin	ppm	ASTM D5185m	>13	<1	2	1
Vanadium	ppm	ASTM D5185m		0	0	<1
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>200	20	▲ 234	61
Potassium	ppm	ASTM D5185m	>20	<1	1	0
Fuel		WC Method	>4.0	<1.0	<1.0	<1.0
Water		WC Method	>0.1	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624	>20	3.2	3.3	3.1
Sulfation	Abs/.1mm	*ASTM D7415	>30	15.5	16.3	14.7
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<1	0	<1
Boron	ppm	ASTM D5185m		9	1	1
Barium	ppm	ASTM D5185m		0	5	0
Molybdenum	ppm	ASTM D5185m		3	2	3
Manganese	ppm	ASTM D5185m		1	0	0
Magnesium	ppm	ASTM D5185m		15	25	23
Calcium	ppm	ASTM D5185m		1618	1363	1364
Phosphorus	ppm	ASTM D5185m		203	317	297
Zinc	ppm	ASTM D5185m		306	362	341
Sulfur	ppm	ASTM D5185m		1633	2973	2602
Oxidation	Abs/.1mm	*ASTM D7414	>25	6.6	6.8	6.5
Acid Number (AN)	mg KOH/g	ASTM D8045	1.16	0.76	0.71	0.60
Base Number (BN)	mg KOH/g	ASTM D2896	5	3.64	3.28	3.87
Visc @ 100°C	cSt	ASTM D445	13.5	13.2	12.8	12.9

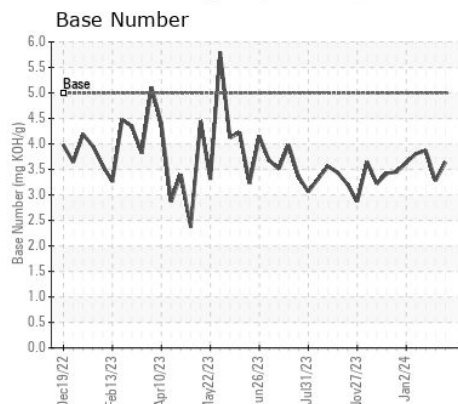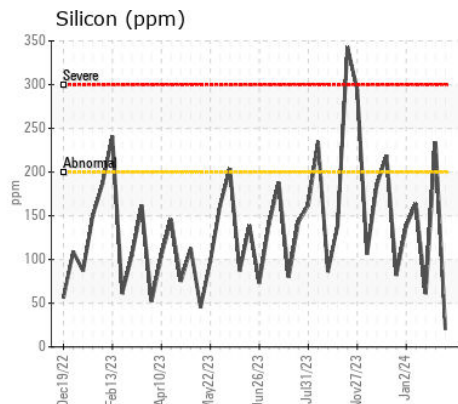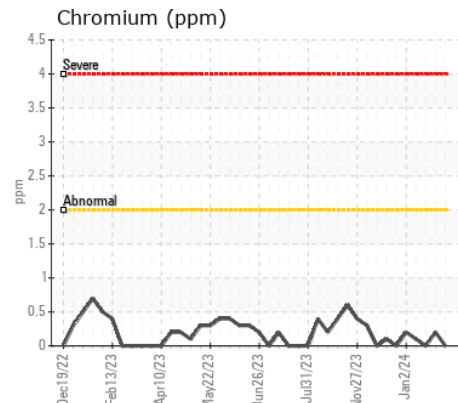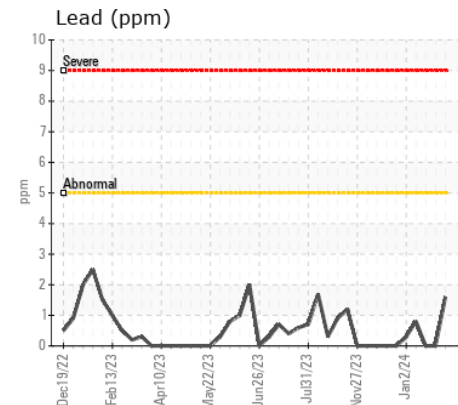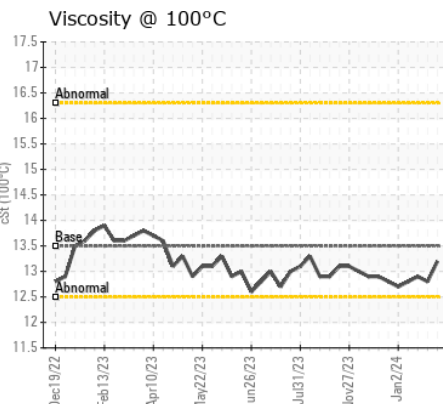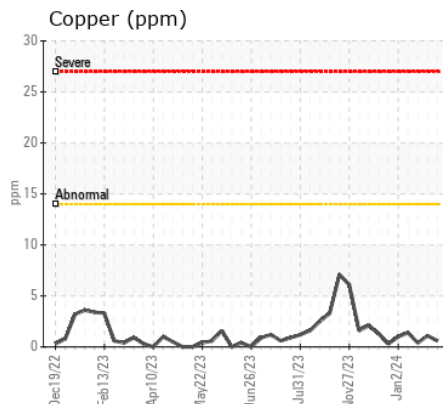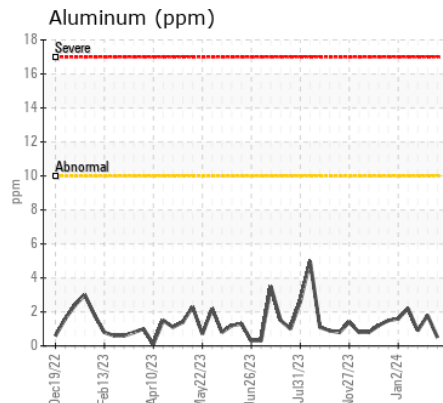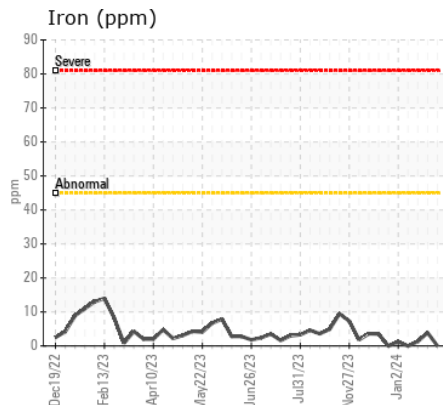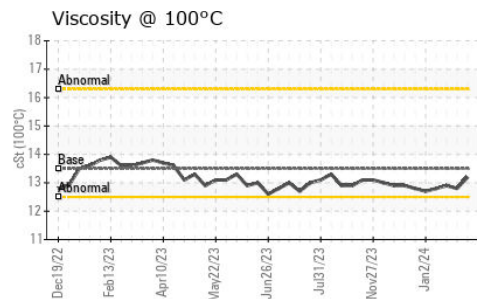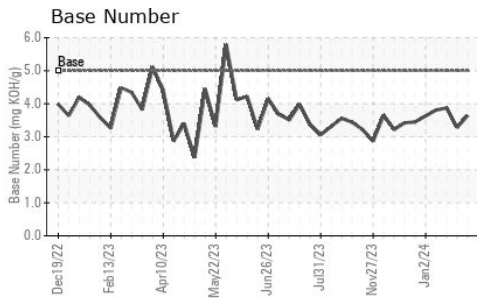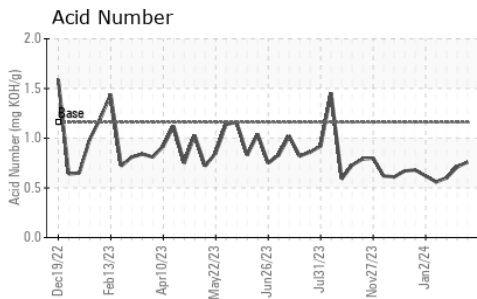

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0803453

Lab Number : 06084975

Unique Number : 10872420

Test Package : MOB 2

Received : 09 Feb 2024

Tested : 12 Feb 2024

Diagnosed : 12 Feb 2024 - Don Baldrige

BLACK OAK

5054 HWY HH

HARTVILLE, MO

US 65667

Contact: CHIP MATHEWS

chip.matthews@cubedistrictenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)