



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>



Area  
**(48031UA)**  
Machine Id  
**834027**  
Component  
**Natural Gas Engine**  
Fluid  
**{not provided} (--- GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>GFL0108247</b>	GFL0098235	---
Sample Date		Client Info		<b>07 Feb 2024</b>	06 Jan 2024	---
Machine Age	hrs	Client Info		<b>1033</b>	842	---
Oil Age	hrs	Client Info		<b>1033</b>	842	---
Filter Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed		Client Info		<b>Not Changed</b>	N/A	---
Filter Changed		Client Info		<b>Not Changed</b>	N/A	---
Sample Status				<b>NORMAL</b>	NORMAL	---

**WEAR**

All component wear rates are normal for time on oil.

Iron	ppm	ASTM D5185m	>50	<b>66</b>	48	---
Chromium	ppm	ASTM D5185m	>4	<b>2</b>	<1	---
Nickel	ppm	ASTM D5185m	>2	<b>3</b>	1	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Silver	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	---
Aluminum	ppm	ASTM D5185m	>9	<b>6</b>	5	---
Lead	ppm	ASTM D5185m	>30	<b>4</b>	2	---
Copper	ppm	ASTM D5185m	>35	<b>17</b>	13	---
Tin	ppm	ASTM D5185m	>4	<b>3</b>	2	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	---
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---

**CONTAMINATION**







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>+100	<b>29</b>	27	---
Potassium	ppm	ASTM D5185m	>20	<b>22</b>	17	---
Water		WC Method	>0.1	<b>NEG</b>	NEG	---
Soot %	%	*ASTM D7844		<b>0</b>	0	---
Nitration	Abs/cm	*ASTM D7624	>20	<b>13.9</b>	12.9	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>27.0</b>	25.2	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	---

**FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>2</b>	5	---
Boron	ppm	ASTM D5185m		<b>4</b>	4	---
Barium	ppm	ASTM D5185m		<b>0</b>	2	---
Molybdenum	ppm	ASTM D5185m		<b>65</b>	55	---
Manganese	ppm	ASTM D5185m		<b>15</b>	11	---
Magnesium	ppm	ASTM D5185m		<b>904</b>	796	---
Calcium	ppm	ASTM D5185m		<b>1460</b>	1302	---
Phosphorus	ppm	ASTM D5185m		<b>824</b>	745	---
Zinc	ppm	ASTM D5185m		<b>1069</b>	950	---
Sulfur	ppm	ASTM D5185m		<b>2473</b>	2251	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>25.3</b>	23.5	---
Base Number (BN)	mg KOH/g	ASTM D2896		<b>3.0</b>	3.0	---
Visc @ 100°C	cSt	ASTM D445		<b>14.2</b>	14.1	---

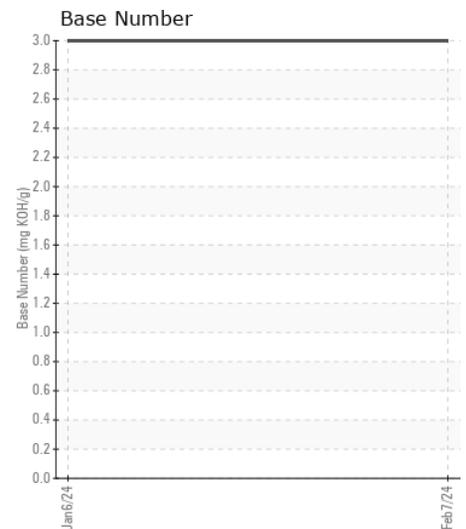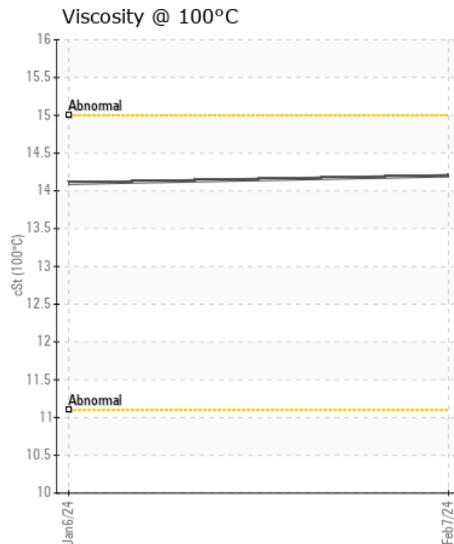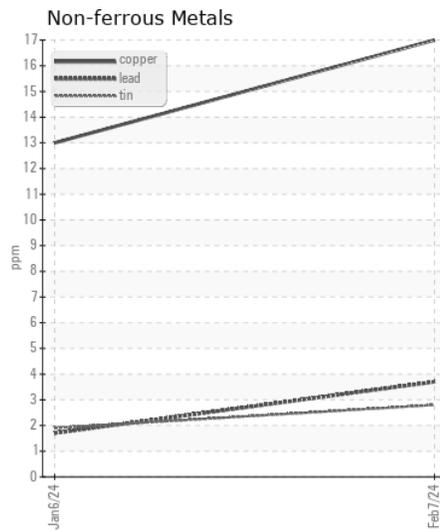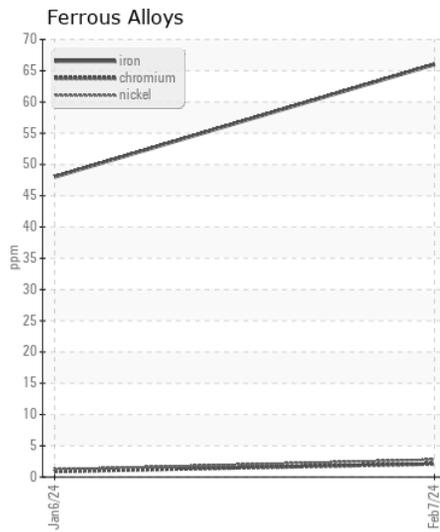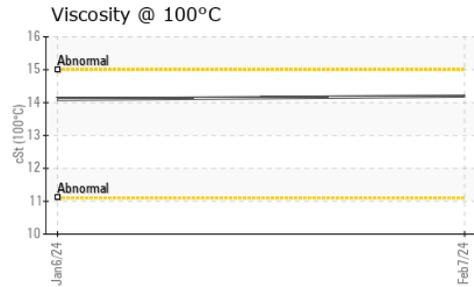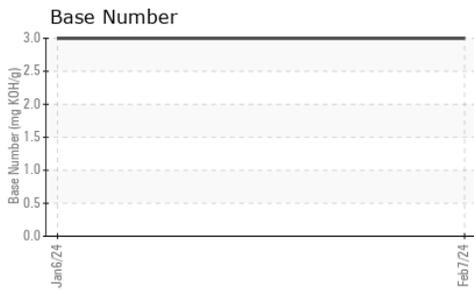

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : GFL0108247  
**Lab Number** : 06085260  
**Unique Number** : 10872705  
**Test Package** : FLEET

**Received** : 09 Feb 2024  
**Tested** : 12 Feb 2024  
**Diagnosed** : 12 Feb 2024 - Don Baldrige

**GFL Environmental - 652 - Fredericksburg Hauling**  
 10954 Houser Drive  
 Fredericksburg, VA  
 US 22408  
 Contact: WILLIAM MILO  
 wmilo@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: