
**WEAR** CONTAMINATION **FLUID CONDITION**  **NORMAL NORMAL NORMAL** 

Machine Id 17221

Component Compressor

PETRO CANADA COMPRO XI -S COMPRESSOR EL LIID 46 (55 GAL)

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		CCSI2008798		
	Sample Date		Client Info		26 Dec 2023		
	Machine Age	hrs	Client Info		0		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				NORMAL		
WEAR All component wear rates are normal.	Iron	ppm	ASTM D5185m	>50	0		
	Chromium	ppm	ASTM D5185m	>10	0		
	Nickel	ppm	ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m		0		
	Aluminum	ppm	ASTM D5185m	>25	0		
	Lead	ppm	ASTM D5185m	>25	0		
	Copper	ppm	ASTM D5185m	>50	0		
	Tin	ppm	ASTM D5185m	>15	0		
	Vanadium	ppm	ASTM D5185m		0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
	O						
CONTAMINATION	Silicon	ppm	ASTM D5185m		0		
There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.	Potassium	ppm	ASTM D5185m		0		
	Water	%	ASTM D6304		NEG		
	Particles >4µm		ASTM D7647		295		
	Particles >6µm		ASTM D7647		86		
	Particles >14µm		ASTM D7647		8		
	Particles >21µm		ASTM D7647		2 1		
	Particles >38µm		ASTM D7647 ASTM D7647		0		
	Particles >71µm Oil Cleanliness		ISO 4406 (c)		15/14/10		
	Silt	scalar	*Visual	NONE	NONE		
	Debris		*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water		*Visual	>0.1	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185m		<1		
The AN level is acceptable for this fluid. The condition of the cil is	Boron	ppm	ASTM D5185m		0		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m	20	0		
	Molybdenum	ppm	ASTM D5185m		0		
	Manganese	ppm	ASTM D5185m		0		
	Magnesium	ppm	ASTM D5185m		0		
	Calcium	ppm	ASTM D5185m		0		
	Phosphorus	ppm	ASTM D5185m		9		
	Zinc	ppm	ASTM D5185m		0		
	Sulfur	ppm	ASTM D5185m		69		
	Acid Number (AN)	mg KOH/g	ASTM D8045		0.11		
	Visc @ 40°C	cSt	ASTM D445	47.2	46.3		

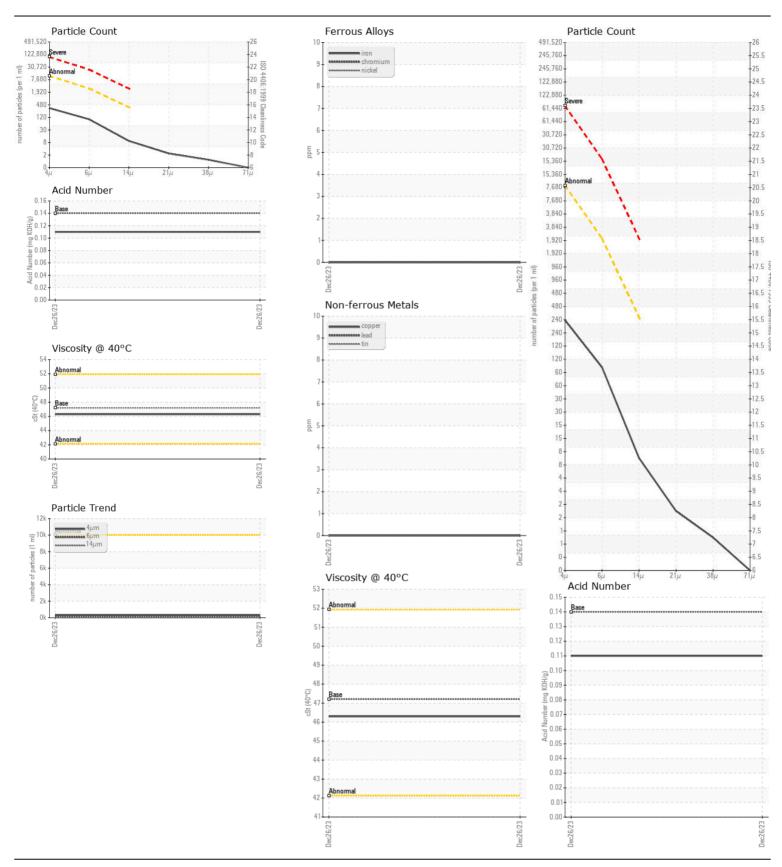



Certificate L2367

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : CCSI2008798 Lab Number : 06085377

Unique Number: 10872822

Received **Tested** Diagnosed : 09 Feb 2024

: 12 Feb 2024

: 12 Feb 2024 - Doug Bogart

Test Package: IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**MONDELEZ CANADA INC** 

277 GLADSTONE AVE TORONTO, ON CA M6J3L9 Contact: BRENT BAYLEY

brent.bayley@mdlz.com T: (416)677-8168