



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	MARGINAL
FLUID CONDITION	NORMAL

Machine Id  
**MATTEI 10014077-2020**

Component  
**Compressor**

Fluid  
**{not provided} (2 QTS)**

**RECOMMENDATION**

No corrective action is recommended at this time. Resample at the next service interval to monitor.

**WEAR**

All component wear rates are normal.

**CONTAMINATION**

Elemental level of silicon (Si) above normal.

**FLUID CONDITION**









The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>AN25410</b>	AN24350	---
Sample Date		Client Info		<b>01 Feb 2024</b>	14 Oct 2021	---
Machine Age	hrs	Client Info		<b>2611</b>	140	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Filter Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed		Client Info		<b>N/A</b>	Changed	---
Filter Changed		Client Info		<b>N/A</b>	N/A	---
Sample Status				<b>MARGINAL</b>	ABNORMAL	---

Iron	ppm	ASTM D5185m	>50	<b>8</b>	2	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	<1	---
Lead	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Copper	ppm	ASTM D5185m	>50	<b>2</b>	<1	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
White Metal	scalar	*Visual	NONE	<b>NONE</b>	▲ MODER	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---

Silicon	ppm	ASTM D5185m	>25	▲ <b>78</b>	▲ 148	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	---
Water	%	ASTM D6304	>0.1	<b>0.033</b>	▲ 0.163	---
ppm Water	ppm	ASTM D6304	>1000	<b>339</b>	▲ 1630	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	---

Sodium	ppm	ASTM D5185m		<b>4</b>	0	---
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>13</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	---
Calcium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Phosphorus	ppm	ASTM D5185m		<b>964</b>	912	---
Zinc	ppm	ASTM D5185m		<b>54</b>	23	---
Sulfur	ppm	ASTM D5185m		<b>109</b>	209	---
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.20</b>	0.148	---
Visc @ 40°C	cSt	ASTM D445		<b>83.8</b>	▲ 85.0	---

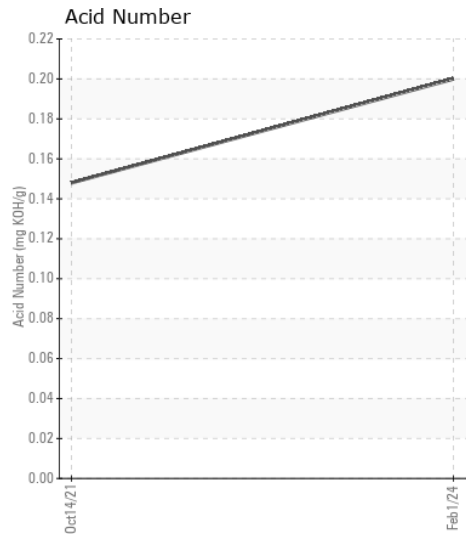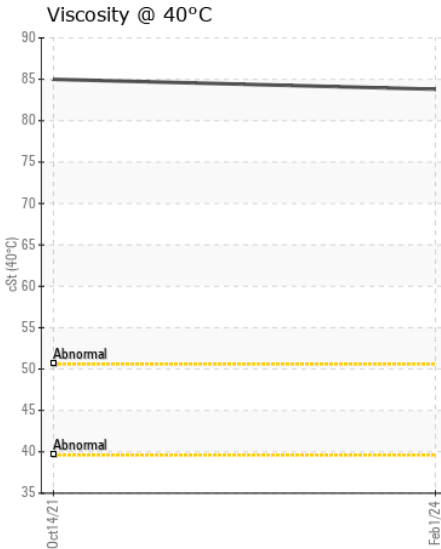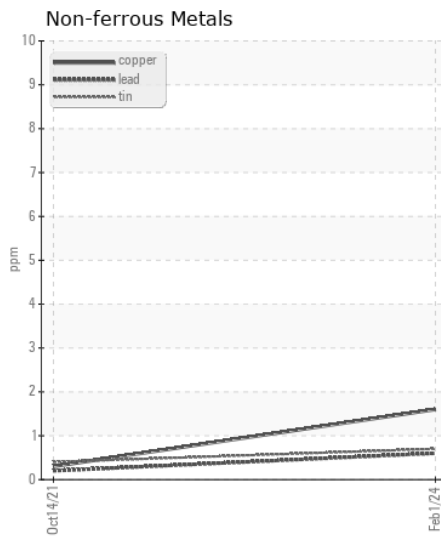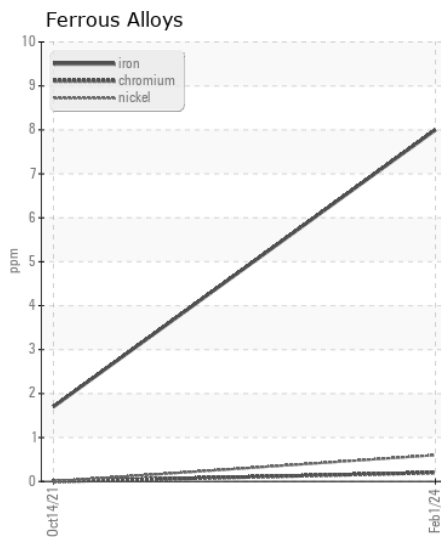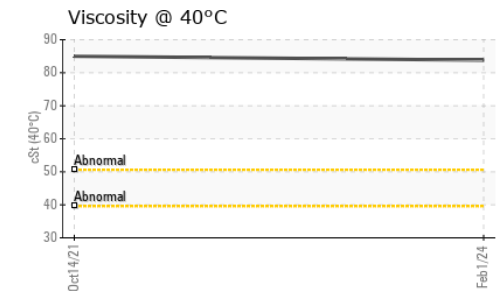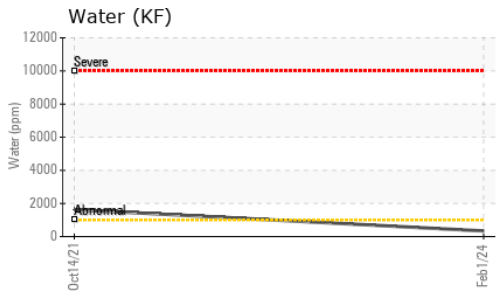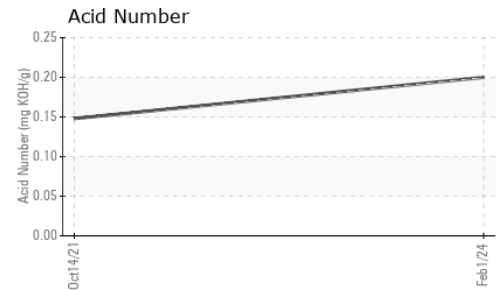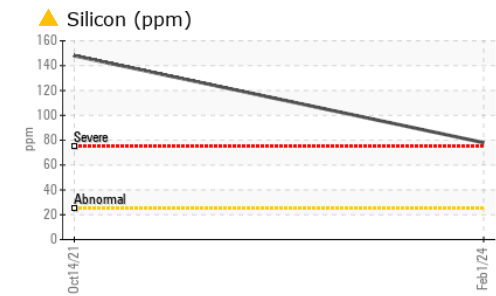

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : AN25410  
**Lab Number** : 06086126  
**Unique Number** : 10873571  
**Test Package** : IND 2  
**Received** : 12 Feb 2024  
**Tested** : 14 Feb 2024  
**Diagnosed** : 14 Feb 2024 - Jonathan Hester

**MATTEI COMPRESSORS--OEM**  
 9635 LIBERTY ROAD, SUITE E  
 RANDALLSTOWN, MD  
 US 21133  
 Contact: MARTY WARD  
 jward@matteicomp.com  
 T: (410)521-7020  
 F: (410)521-7024

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)