
WEAR CONTAMINATION **FLUID CONDITION** **NORMAL NORMAL** NORMAL

KAREN MICHELLE

Component **Genset**

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		MW0059501		
	Sample Date		Client Info		09 Feb 2024		
	Machine Age	hrs	Client Info		0		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				NORMAL		
VEAR	Iron	ppm	ASTM D5185m	>50	32		
	Chromium	ppm	ASTM D5185m		<1		
All component wear rates are normal.	Nickel	ppm	ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m		4		
	Silver	ppm	ASTM D5185m	>5	0		
	Aluminum	ppm	ASTM D5185m		3		
	Lead	ppm	ASTM D5185m		9		
	Copper	ppm	ASTM D5185m		1		
	Tin	ppm	ASTM D5185m		1		
	Vanadium	ppm	ASTM D5185m	_	- <1		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Ciliana		ACTA DE10E	05			
CONTAMINATION	Silicon	ppm	ASTM D5185m		8		
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m		2		
	Fuel		WC Method		<1.0		
	Water		WC Method	>0.1	NEG NEG		
	Glycol Soot %	%	*ASTM D7844		0.1		
	Nitration	Abs/cm	*ASTM D7624	- 20	8.7		
	Sulfation	Abs/.1mm	*ASTM D7024	>20	21.0		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
			*Visual	NORML	NORML		
	Appearance Odor	scalar scalar	*Visual	NORML	NORML		
	Emulsified Water		*Visual	>0.1	NEG		
·····	Linuisinea water	Scalai	visuai	20.1			
LUID CONDITION	Sodium	ppm	ASTM D5185m		4		
	Boron	ppm	ASTM D5185m	151	58		
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m	0.4	0		
	Molybdenum	ppm	ASTM D5185m	250	12		
	Manganese	ppm	ASTM D5185m		2		
	Magnesium	ppm	ASTM D5185m	0	761		
	Calcium	ppm	ASTM D5185m	2046	1728		
	Phosphorus	ppm	ASTM D5185m	1043	1140		
	Zinc	ppm	ASTM D5185m	943	1312		
	Sulfur	ppm	ASTM D5185m	5012	3921		
	Oxidation	Abs/.1mm	*ASTM D7414	>25	14.8		
	Base Number (BN)	mg KOH/g	ASTM D2896	12.5	7.6		
	Visc @ 100°C	cSt	ASTM D445	111	13.3		



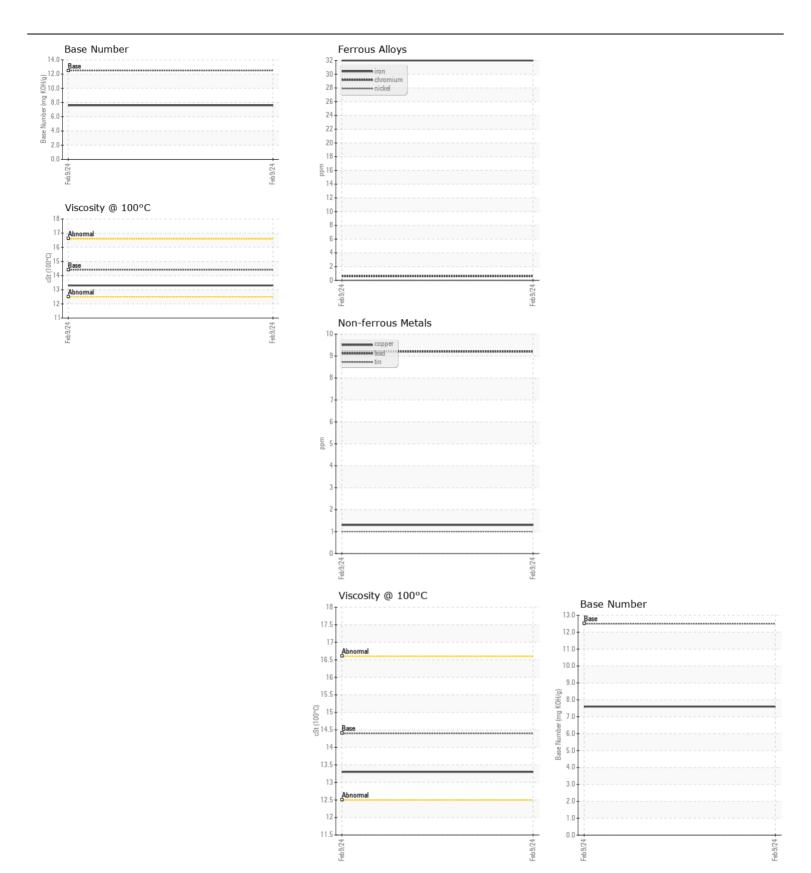



Certificate L2367

Laboratory Sample No.

: MW0059501 Lab Number : 06086945 Unique Number : 10874390 Test Package : MAR 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 13 Feb 2024 **Tested**

: 14 Feb 2024 Diagnosed

: 14 Feb 2024 - Jonathan Hester

AMERICAN RIVER TRANSPORTATION CO. P.O. BOX 2889

ST. LOUIS, MO US 63111

F: (314)481-5278

Contact: BRIAN GRIEWING brian.griewing@adm.com

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Contact/Location: BRIAN GRIEWING - AMESAI

T: