



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Machine Id
MRC-296
Component
Compressor
Fluid
TULCO LUBSOIL LPG WS 150 (--- GAL)

RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.











CONTAMINATION

There is a high amount of particulates present in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		TO60002153	TO60001960	TO60001924
Sample Date		Client Info		05 Feb 2024	05 Jan 2024	02 Dec 2023
Machine Age	hrs	Client Info		7467	6863	6099
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	NORMAL	NORMAL
Iron	ppm	ASTM D5185m	>50	0	1	0
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	<1	2	0
Lead	ppm	ASTM D5185m	>25	0	0	<1
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>15	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Silicon	ppm	ASTM D5185m	>25	3	14	4
Potassium	ppm	ASTM D5185m	>20	1	1	0
Water	%	ASTM D6304	>2.26	0.013	0.007	0.020
ppm Water	ppm	ASTM D6304	>22600	130	77	204
Particles >4µm		ASTM D7647	>10000	▲ 34168	4674	1490
Particles >6µm		ASTM D7647	>1300	▲ 13454	363	161
Particles >14µm		ASTM D7647	>320	▲ 670	26	8
Particles >21µm		ASTM D7647	>80	▲ 92	8	1
Particles >38µm		ASTM D7647	>20	1	1	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/17/15	▲ 22/21/17	19/16/12	18/15/10
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2.26	NEG	NEG	NEG
Sodium	ppm	ASTM D5185m		3	0	2
Boron	ppm	ASTM D5185m	0	58	135	101
Barium	ppm	ASTM D5185m	0	0	3	0
Molybdenum	ppm	ASTM D5185m	0	0	<1	<1
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	0	7	6	3
Calcium	ppm	ASTM D5185m	0	1217	1190	1255
Phosphorus	ppm	ASTM D5185m	0	291	298	287
Zinc	ppm	ASTM D5185m	0	310	262	292
Sulfur	ppm	ASTM D5185m	0	3813	3182	2750
Acid Number (AN)	mg KOH/g	ASTM D8045		0.517	1.73	1.43
Visc @ 40°C	cSt	ASTM D445	151	126	123	128
Visc @ 100°C	cSt	ASTM D445	28	13.3	13.0	13.3
Viscosity Index (VI)	Scale	ASTM D2270	224	99	98	97

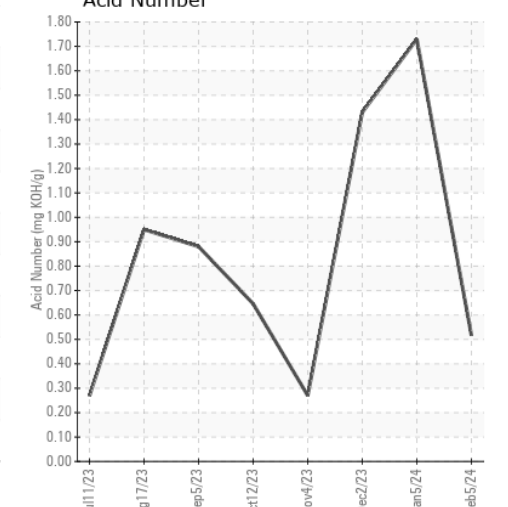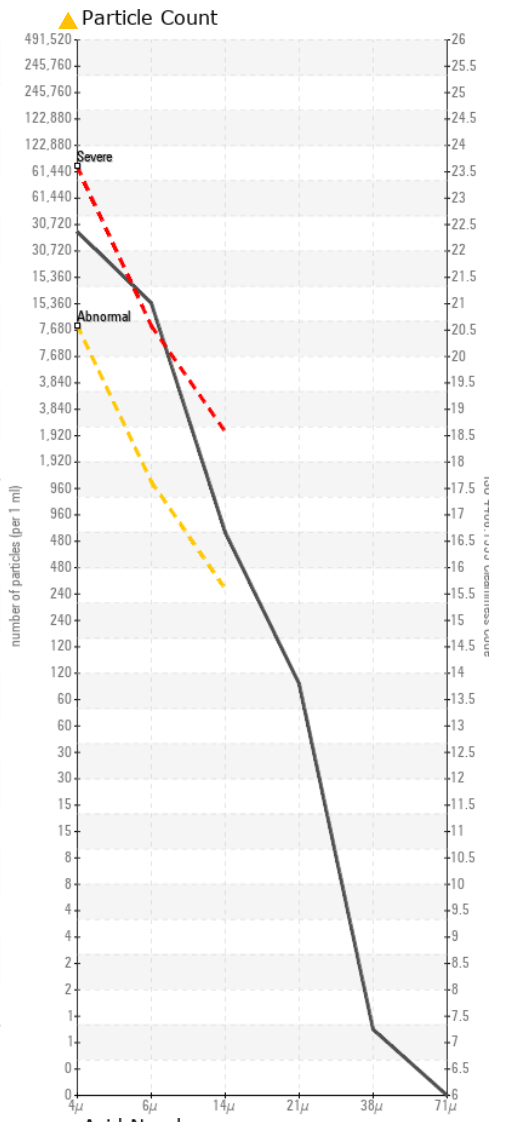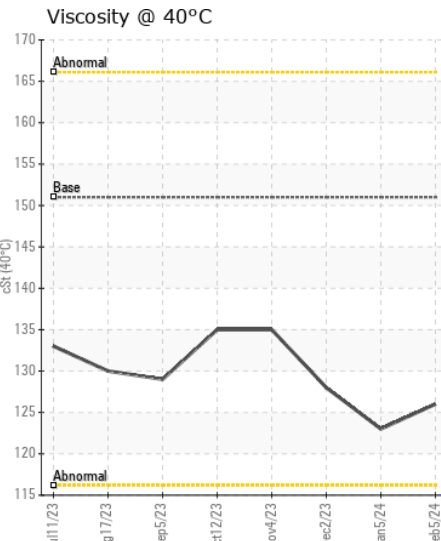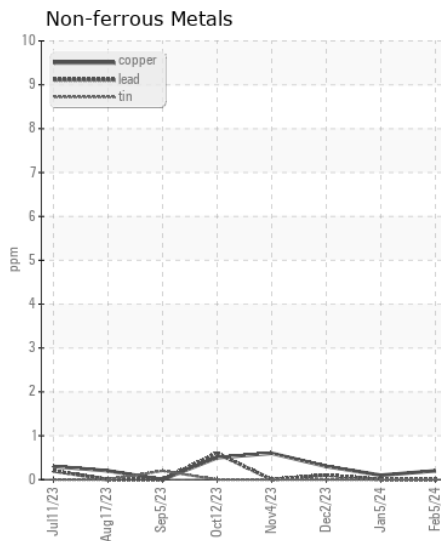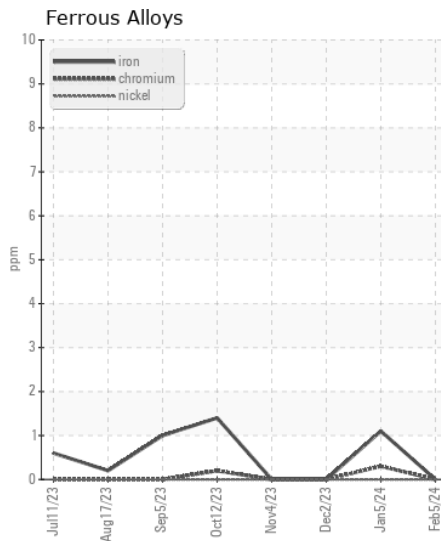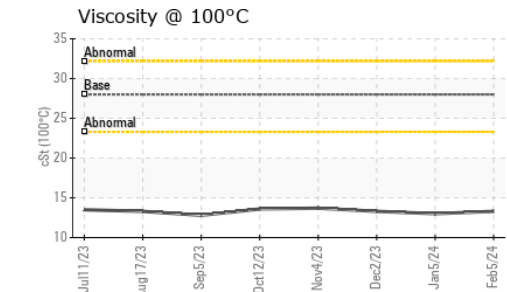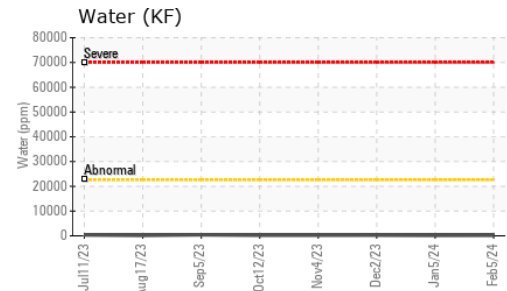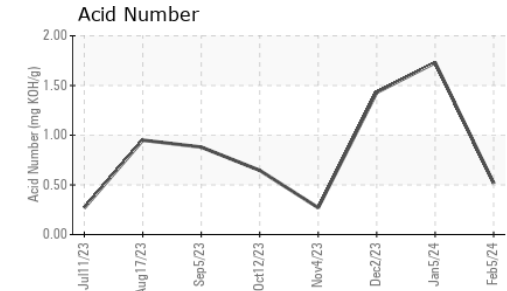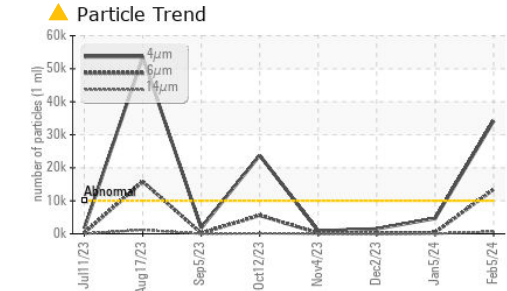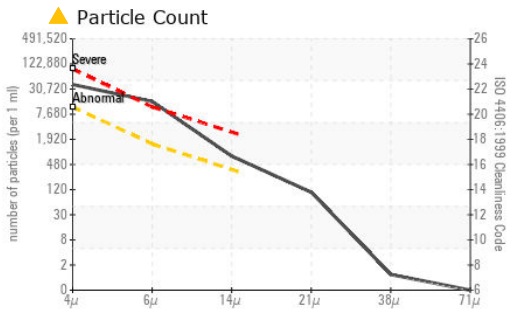

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60002153 **Received** : 13 Feb 2024
Lab Number : 06087282 **Tested** : 14 Feb 2024
Unique Number : 10874727 **Diagnosed** : 14 Feb 2024 - Don Baldrige
Test Package : MOB 2 (Additional Tests: KF, KV100, PrtCount, VI)

MIDLAND - EOG RESOURCES INC.
 5509 CHAMPIONS DRIVE
 MIDLAND, TX
 US 79706
 Contact: HERMAN GARZA
 herman_garza@eogresources.com
 T: (432)686-3600
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)