



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
SYNOIL 8K
 Machine Id
SULLAIR 25-200L WCA 003-88000 - GKN SINTERD METALS
 Component
Compressor

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCZ06087495	UCZ03142330	---
Sample Date		Client Info		23 Jan 2024	12 Jul 2012	---
Machine Age	hrs	Client Info		145927	56970	---
Oil Age	hrs	Client Info		3300	0	---
Filter Age	hrs	Client Info		3300	0	---
Oil Changed		Client Info		Not Changd	Not Changd	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				NORMAL	ATTENTION	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	45	---
Chromium	ppm	ASTM D5185m	>5	0	<1	---
Nickel	ppm	ASTM D5185m		0	<1	---
Titanium	ppm	ASTM D5185m		0	<1	---
Silver	ppm	ASTM D5185m		0	<1	---
Aluminum	ppm	ASTM D5185m	>15	0	<1	---
Lead	ppm	ASTM D5185m	>65	0	6	---
Copper	ppm	ASTM D5185m	>65	3	▲ 66	---
Tin	ppm	ASTM D5185m	>10	<1	<1	---
Vanadium	ppm	ASTM D5185m		0	0	---
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---

CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>35	<1	1	---
Potassium	ppm	ASTM D5185m	>20	0	9	---
Water		WC Method	>0.1	NEG	NEG	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	▲ 1.0%	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<1	50	---
Boron	ppm	ASTM D5185m	0.3	0	9	---
Barium	ppm	ASTM D5185m	0.3	<1	179	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m	0.9	0	<1	---
Magnesium	ppm	ASTM D5185m	0.2	0	7	---
Calcium	ppm	ASTM D5185m	0.1	0	544	---
Phosphorus	ppm	ASTM D5185m	429	383	64	---
Zinc	ppm	ASTM D5185m	0.3	31	158	---
Sulfur	ppm	ASTM D5185m	1336	663	403	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.622	0.92	▲ 1.72	---
Visc @ 40°C	cSt	ASTM D445	44.32	54.0	▲ 71.06	---

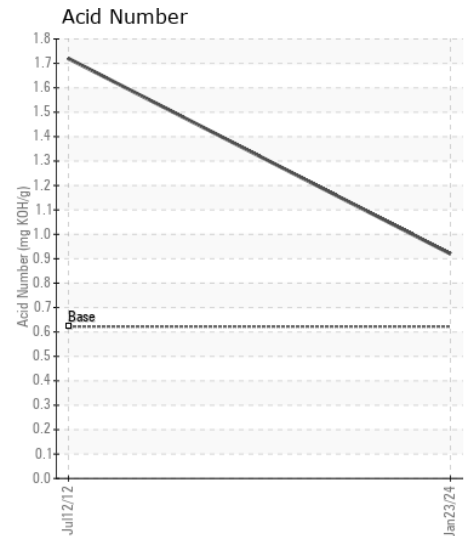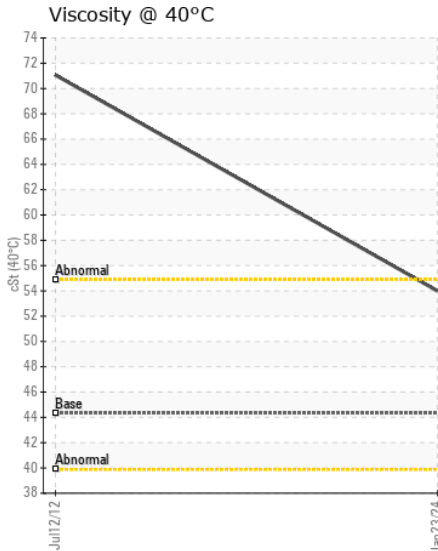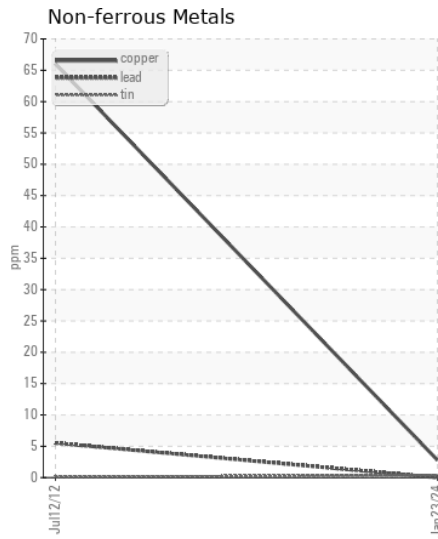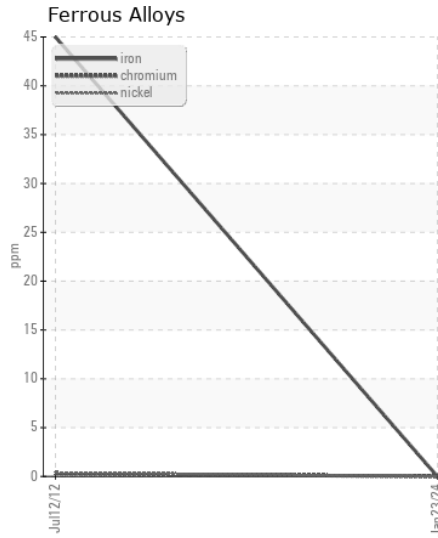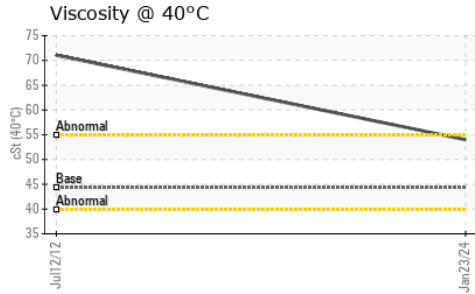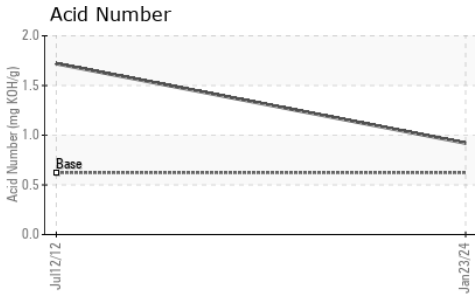

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCZ06087495
Lab Number : 06087495
Unique Number : 10874940
Test Package : IND 2

Received : 13 Feb 2024
Tested : 14 Feb 2024
Diagnosed : 14 Feb 2024 - Don Baldrige

ZORN COMP & EQUIPMENT INC - MAIN
 1335 E WISCONSIN AVE
 PEWAUKEE, WI
 US 53072
 Contact: CHRIS BOCK
 Chris.Bock@zornair.com
 T: (800)476-4637
 F: (262)695-7017

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)