**WEAR** CONTAMINATION **FLUID CONDITION** 


**NORMAL NORMAL NORMAL** 

**NOT GIVEN** 

## **SULLIVAN PALATEK 20EE001168 - PRIMARY WEAPONS**

Component Compressor

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		UCS06087530		
	Sample Date		Client Info		05 Jan 2024		
	Machine Age	hrs	Client Info		31433		
	Oil Age	hrs	Client Info		7029		
	Filter Age	hrs	Client Info		1022		
	Oil Changed		Client Info		Not Changd		
	Filter Changed		Client Info		Changed		
	Sample Status				NORMAL		
WEAR	Iron	ppm	ASTM D5185m	>50	0		
All component wear rates are normal.	Chromium	ppm	ASTM D5185m		0		
	Nickel	ppm	ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m		0		
	Aluminum	ppm	ASTM D5185m	>25	0		
	Lead	ppm	ASTM D5185m	>25	0		
	Copper	ppm	ASTM D5185m	>50	<1		
	Tin	ppm	ASTM D5185m	>15	<1		
	Vanadium	ppm	ASTM D5185m		0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Silicon		ACTM DE10Em	. 05	4		
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m ASTM D5185m		0		
	Water	ppm	WC Method	>0.1	NEG		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water		*Visual	>0.1	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185m		0		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Boron	ppm	ASTM D5185m		0		
	Barium	ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		0		
	Manganese	ppm	ASTM D5185m		0		
	Magnesium	ppm	ASTM D5185m		0		
	Calcium	ppm	ASTM D5185m		0		
	Phosphorus	ppm	ASTM D5185m		389		
	Zinc	ppm	ASTM D5185m		0		
	Sulfur	ppm	ASTM D5185m		910		
	Acid Number (AN)		ASTM D8045		0.15		
Report Id: UCAIRTRA IWUSCARI 06087530 (Generated: 02/15/2024 07:52:42) Rev: 1	Visc @ 40°C	cSt	ASTM D445	_	45.3		

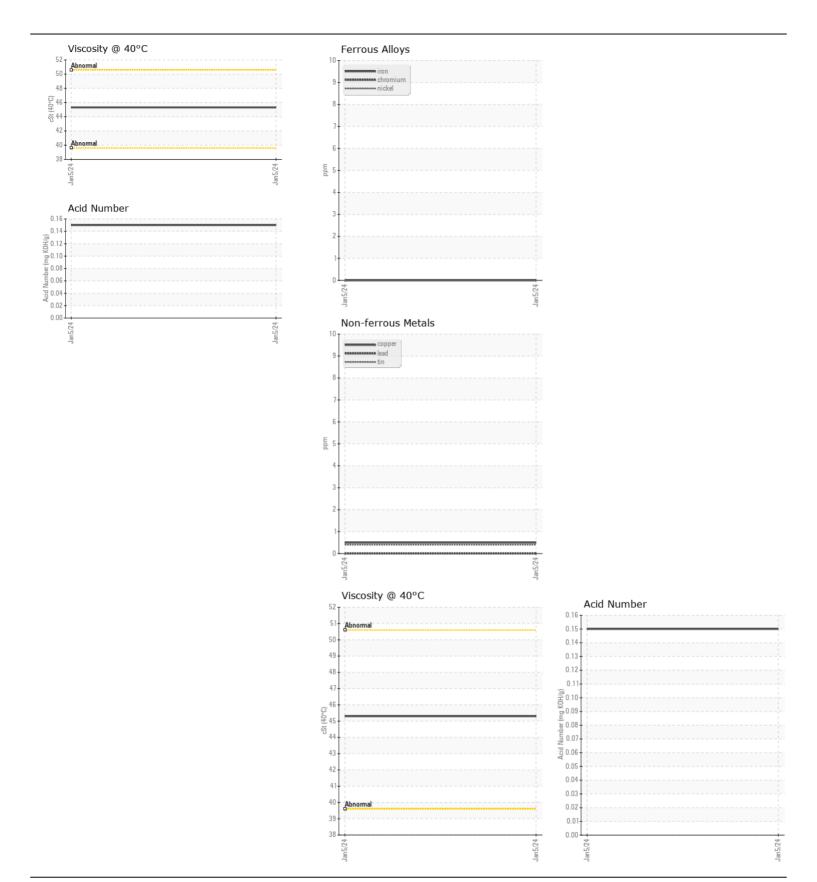





Laboratory

Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Lab Number : 06087530 Unique Number : 10874975

: UCS06087530

Received : 13 Feb 2024 : 14 Feb 2024 **Tested** 

Diagnosed

: 14 Feb 2024 - Don Baldridge

TRAVERSE CITY, MI US 49686 Contact: MIKE office@airlex.com T: (231)929-1601

Test Package : IND 2 Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) **AIRLEX**