



WEAR CHECK

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
SHANNON - WOMENS AND CHILDRENS

Component
Diesel Engine

Fluid
SHELL ROTELLA T 15W40 (35 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0872212	LF0001056	LF0001058
Sample Date		Client Info		11 Jan 2024	17 Jan 2023	19 Dec 2021
Machine Age	hrs	Client Info		16	16	12
Oil Age	hrs	Client Info		16	16	12
Filter Age	hrs	Client Info		16	16	12
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185m	>90	<1	2	2
Chromium	ppm	ASTM D5185m	>20	<1	<1	<1
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m	>2	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>20	1	0	<1
Lead	ppm	ASTM D5185m	>40	0	0	<1
Copper	ppm	ASTM D5185m	>330	<1	<1	<1
Tin	ppm	ASTM D5185m	>15	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	3	2	3
Potassium	ppm	ASTM D5185m	>20	4	8	6
Fuel		WC Method	>3.0	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844	>6	0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	4.9	5.6	5.5
Sulfation	Abs/.1mm	*ASTM D7415	>30	19.9	20.5	20.2
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	2	2
Boron	ppm	ASTM D5185m	316	338	219	213
Barium	ppm	ASTM D5185m	0.0	8	0	0
Molybdenum	ppm	ASTM D5185m	1.2	44	<1	<1
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	24	191	13	13
Calcium	ppm	ASTM D5185m	2292	1495	2103	2269
Phosphorus	ppm	ASTM D5185m	1064	864	963	980
Zinc	ppm	ASTM D5185m	1160	1074	1114	1201
Sulfur	ppm	ASTM D5185m	4996	3161	3250	4149
Oxidation	Abs/.1mm	*ASTM D7414	>25	15.0	16.5	16.4
Base Number (BN)	mg KOH/g	ASTM D2896	10.1	8.4	9.0	8.8
Visc @ 100°C	cSt	ASTM D445	15.7	14.4	14.3	14.4

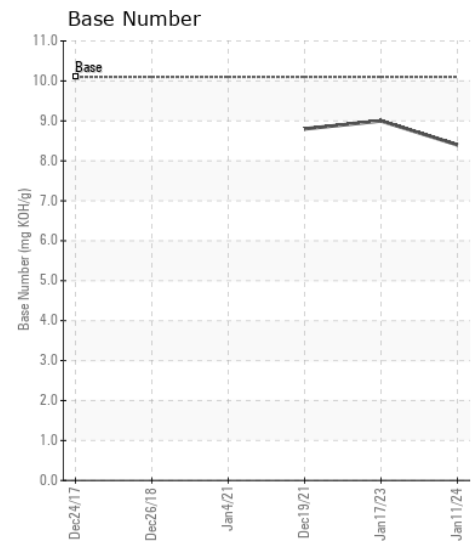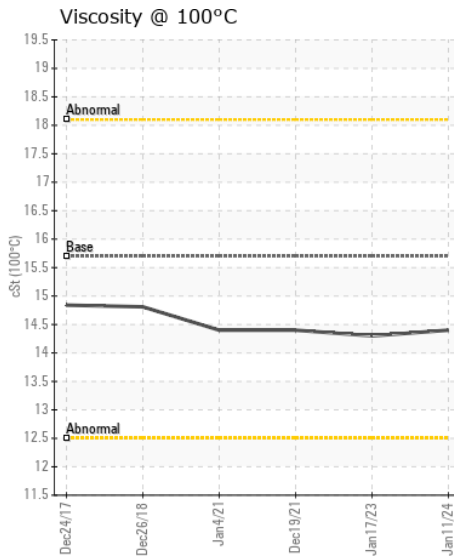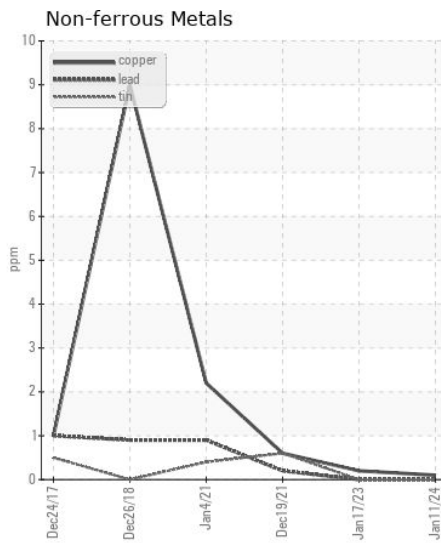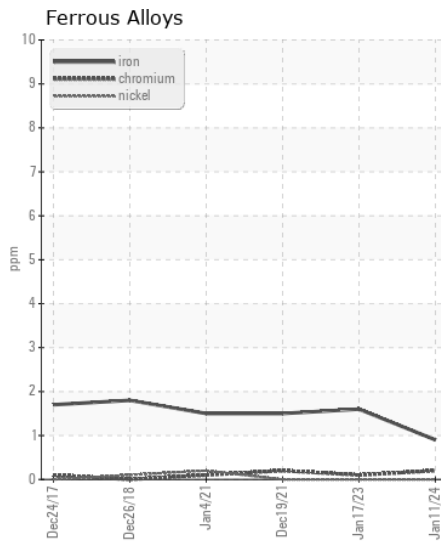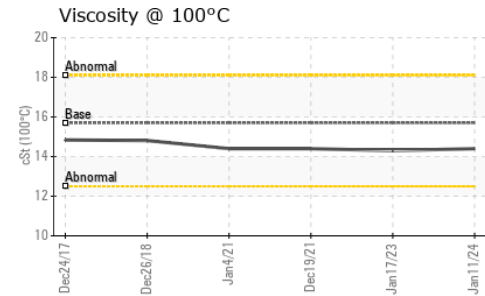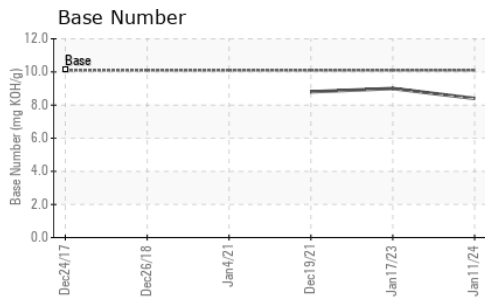

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0872212
Lab Number : 06088497
Unique Number : 10875942
Test Package : FLEET

Received : 14 Feb 2024
Tested : 15 Feb 2024
Diagnosed : 15 Feb 2024 - Wes Davis

STANDBY POWER SUPPORT SYSTEMS
 6100 COLORADO AVE
 ODESSA, TX
 US 79760
 Contact: SANTANA SARABIA
 standbypower7114@yahoo.com
 T: (432)362-1051
 F: (432)362-1052

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)