



Built for a lifetime™

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Machine Id
KAESER AIRTOWER 7.5 6489250 (S/N 1009)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		KCPA014718	KCP53535	KCP45346
Sample Date		Client Info		08 Feb 2024	24 Apr 2023	01 Apr 2022
Machine Age	hrs	Client Info		9094	7026	5733
Oil Age	hrs	Client Info		2068	1293	2152
Filter Age	hrs	Client Info		2068	1293	2152
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ATTENTION

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	2	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	1	5	11
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION












There is a high amount of particulates present in the oil.

Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Potassium	ppm	ASTM D5185m	>20	3	3	0
Water	%	ASTM D6304	>0.05	0.016	0.004	0.002
ppm Water	ppm	ASTM D6304	>500	169	49.4	18.0
Particles >4µm		ASTM D7647		18273	9763	6057
Particles >6µm		ASTM D7647	>1300	▲ 5312	▲ 3530	● 1389
Particles >14µm		ASTM D7647	>80	▲ 340	▲ 168	47
Particles >21µm		ASTM D7647	>20	▲ 60	▲ 33	7
Particles >38µm		ASTM D7647	>4	2	2	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>-/17/13	▲ 21/20/16	▲ 20/19/15	● 18/13
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		25	14	3
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	3	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	66	40	14
Calcium	ppm	ASTM D5185m	0	0	<1	0
Phosphorus	ppm	ASTM D5185m	0	<1	<1	7
Zinc	ppm	ASTM D5185m	0	5	9	8
Sulfur	ppm	ASTM D5185m	23500	19693	20666	17496
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.35	0.38	0.41
Visc @ 40°C	cSt	ASTM D445	45	47.8	48.0	48.3

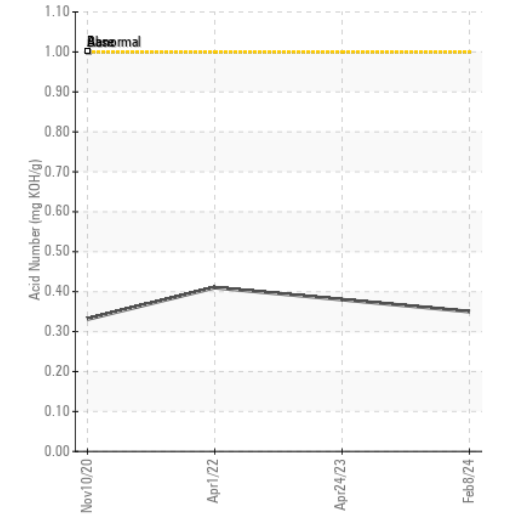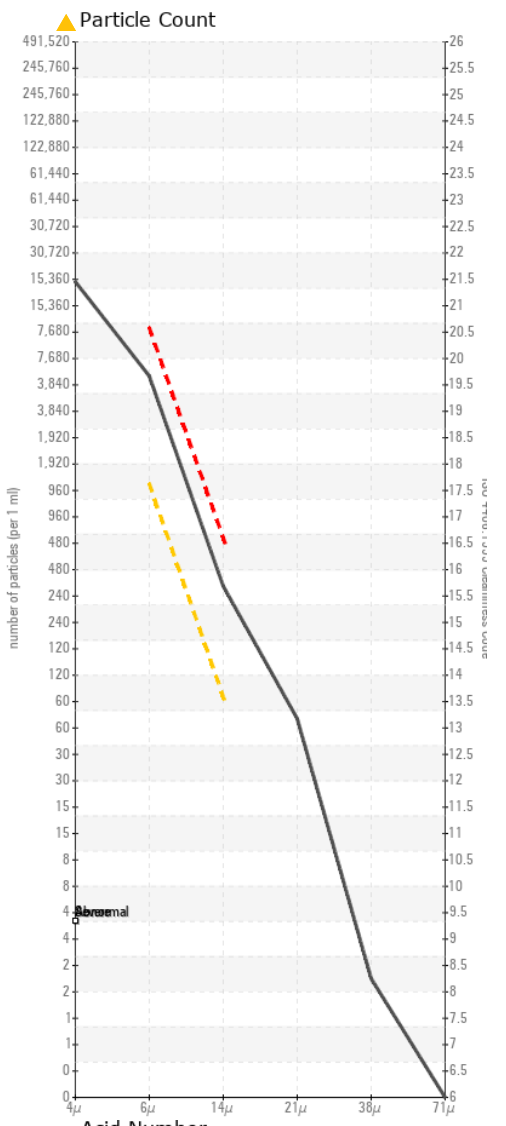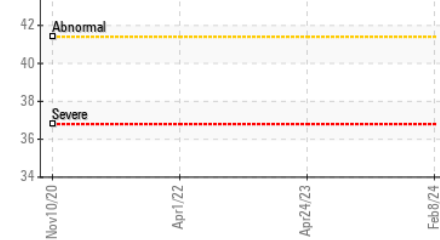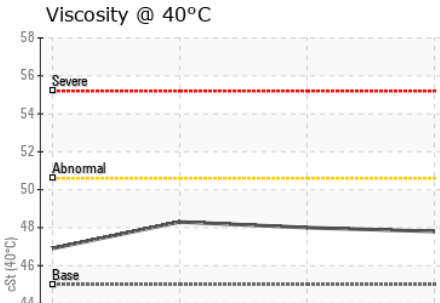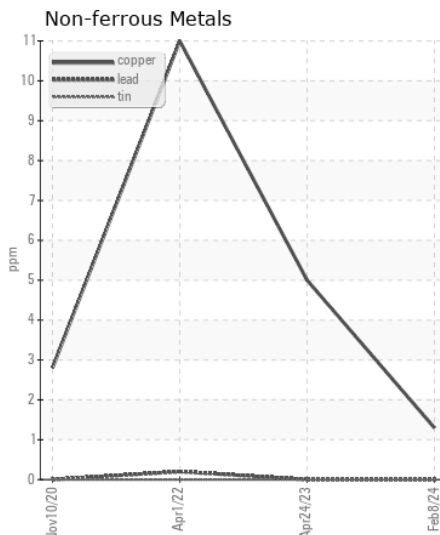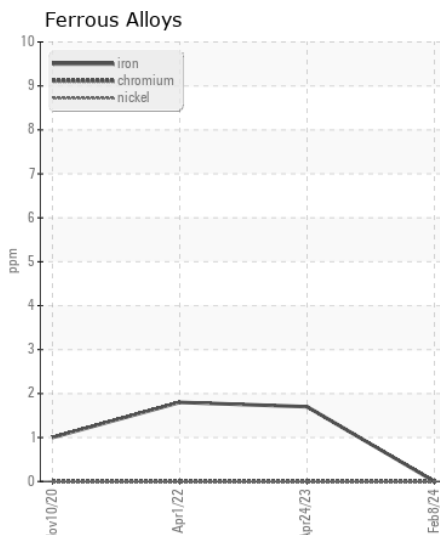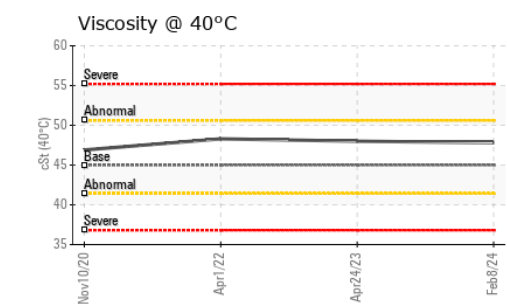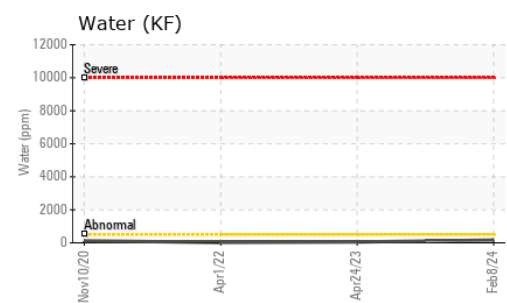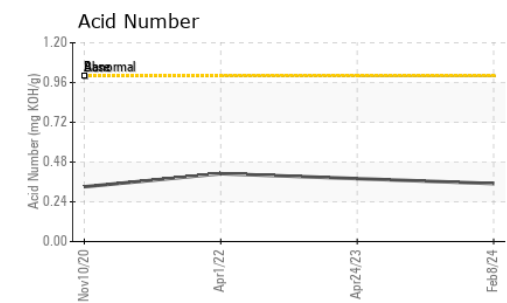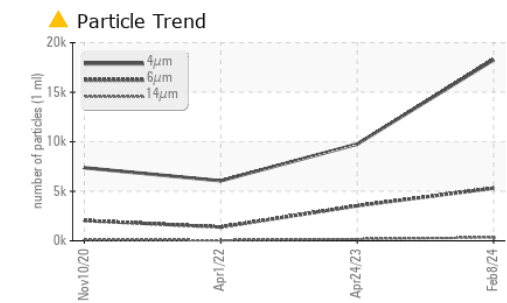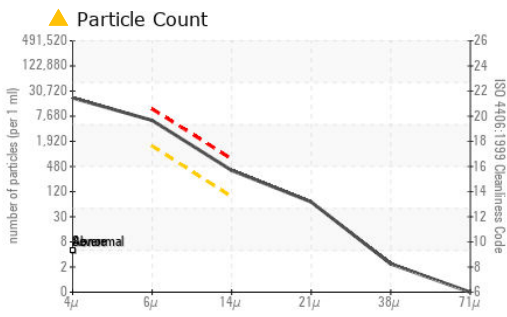

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA014718 **Received** : 14 Feb 2024
Lab Number : 06088778 **Tested** : 15 Feb 2024
Unique Number : 10876223 **Diagnosed** : 15 Feb 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AMAZON DEN5
 19799 E 36TH DR
 AURORA, CO
 US 80011
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: