

WEAR NORMAL CONTAMINATION NORMAL FLUID CONDITION NORMAL

## Area MAXAIR FG 32 Machine Id SULLIVAN PALATEK 01G054 - MINN DAK Component Compressor

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		UCS06088920	UCS05975844	UCS05842252
	Sample Date		Client Info		01 Feb 2024	29 Sep 2023	24 Apr 2023
	Machine Age	hrs	Client Info		31090	30106	28167
	Oil Age	hrs	Client Info		1731	2500	3000
	Filter Age	hrs	Client Info		1731	2500	3000
	Oil Changed		Client Info		Changed	Changed	Changed
	Filter Changed		Client Info		Changed	Changed	Changed
	Sample Status				NORMAL	NORMAL	NORMAL
WEAR	Iron	ppm	ASTM D5185m	>50	0	0	0
All component wear rates are normal.	Chromium	ppm	ASTM D5185m	>10	0	0	<1
	Nickel	ppm	ASTM D5185m		0	0	0
	Titanium	ppm	ASTM D5185m		0	0	<1
	Silver	ppm	ASTM D5185m		0	0	<1
	Aluminum	ppm	ASTM D5185m	>25	0	0	0
	Lead	ppm	ASTM D5185m	>25	0	0	0
	Copper	ppm	ASTM D5185m	>50	<1	2	<1
	Tin	ppm	ASTM D5185m	>15	0	0	0
	Vanadium	ppm	ASTM D5185m		0	0	<1
	White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	0	0	<1
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m	>20	0	0	1
	Water		WC Method	>0.1	NEG	NEG	NEG
	Silt	scalar	*Visual	NONE	NONE	NONE	NONE
	Debris	scalar	*Visual	NONE	LIGHT	LIGHT	LIGHT
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
	Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
	Odor	scalar	*Visual	NORML	NORML	NORML	NORML
	Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
FLUID CONDITION	Sodium	ppm	ASTM D5185m		0	<1	<1
The AN level is acceptable for this fluid. The condition of the oil is	Boron	ppm	ASTM D5185m		0	0	0
suitable for further service.	Barium	ppm	ASTM D5185m		0	0	0
	Molybdenum	ppm	ASTM D5185m		<1	0	0
	Manganese	ppm	ASTM D5185m		0	0	<1
	Magnesium	ppm	ASTM D5185m		0	0	<1
	Calcium	ppm	ASTM D5185m		0	<1	0
	Phosphorus	ppm	ASTM D5185m		330	224	266
	Zinc	ppm	ASTM D5185m		<1	0	0
	Sulfur	ppm	ASTM D5185m		962	590	558

Acid Number (AN) mg KOH/g ASTM D8045

Visc @ 40°C cSt ASTM D445

Contact/Location: DALE K - UCJEMWES

1.08


51.0

0.55

46.1

0.40

47.8

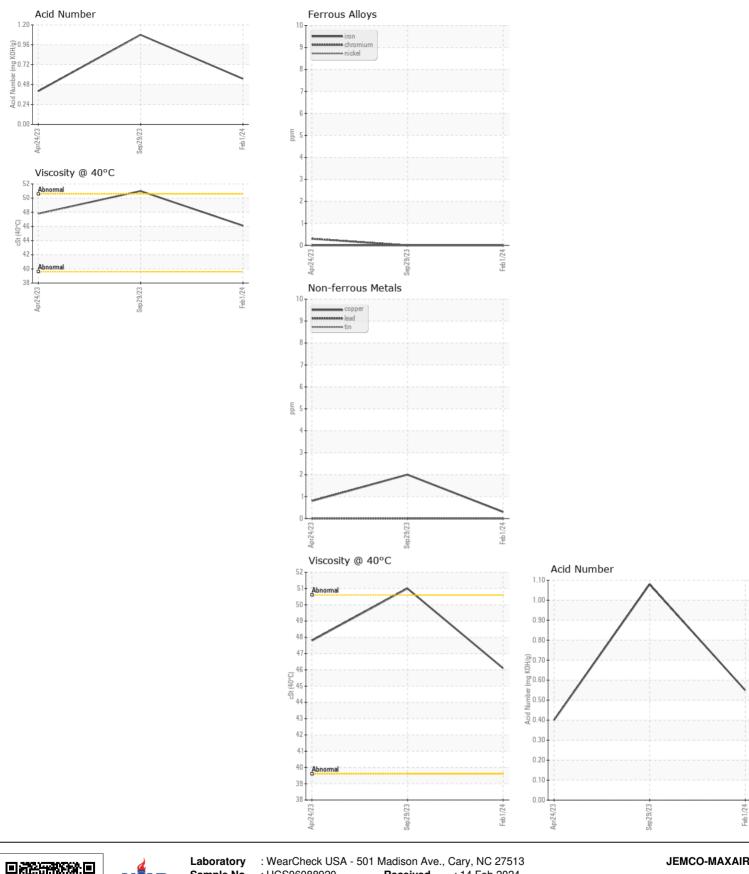

**JEMCO-MAXAIR** Sample No. : UCS06088920 Received : 14 Feb 2024 WEST FARGO, ND Lab Number : 06088920 : 15 Feb 2024 Tested : 15 Feb 2024 - Don Baldridge Unique Number : 10876365 US 58078 Diagnosed Test Package : IND 2 Contact: DALE K Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. dalek@jemco-maxair.com \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (701)281-0362 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: x: