



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	ATTENTION

Area
ROTO XTEND
Machine Id
ATLAS COPCO ITJ641420 - NDSU INNOVATION
Component
Compressor

RECOMMENDATION

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCS06088932	---	---
Sample Date		Client Info		31 Jan 2024	---	---
Machine Age	hrs	Client Info		146	---	---
Oil Age	hrs	Client Info		146	---	---
Filter Age	hrs	Client Info		146	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Not Changed	---	---
Sample Status				ATTENTION	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>5	0	---	---
Nickel	ppm	ASTM D5185m		10	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>15	0	---	---
Lead	ppm	ASTM D5185m	>65	0	---	---
Copper	ppm	ASTM D5185m	>65	5	---	---
Tin	ppm	ASTM D5185m	>10	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION

There is no indication of any contamination in the oil.


Silicon	ppm	ASTM D5185m	>35	6	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water		WC Method	>0.1	NEG	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---

FLUID CONDITION


The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

Sodium	ppm	ASTM D5185m		3	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		<1	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		11	---	---
Calcium	ppm	ASTM D5185m		2	---	---
Phosphorus	ppm	ASTM D5185m		63	---	---
Zinc	ppm	ASTM D5185m		70	---	---
Sulfur	ppm	ASTM D5185m		191	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	0.18	---	---
Visc @ 40°C	cSt	ASTM D445	46	▲ 57.2	---	---


▲ Viscosity @ 40°C

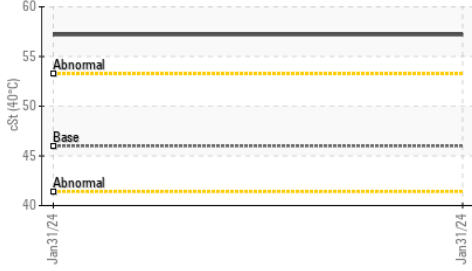


Acid Number

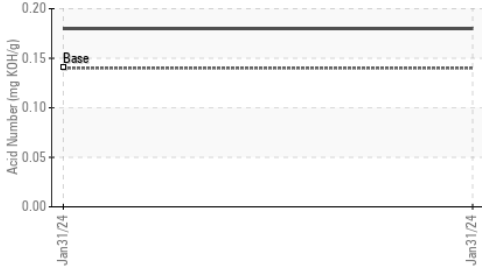


Ferrous Alloys

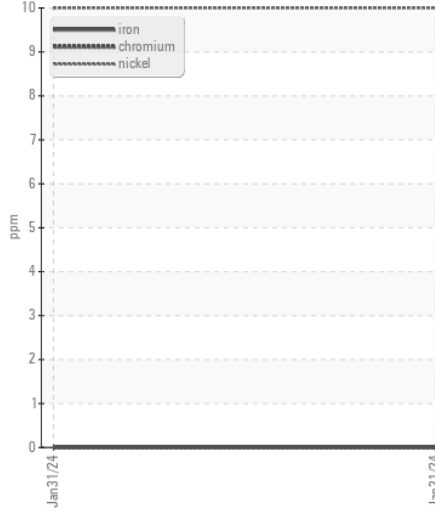


Non-ferrous Metals

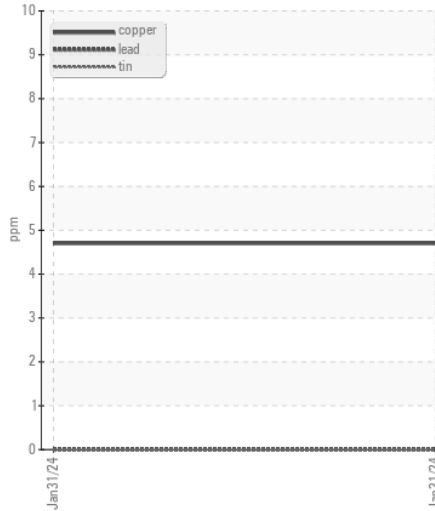

▲ Viscosity @ 40°C

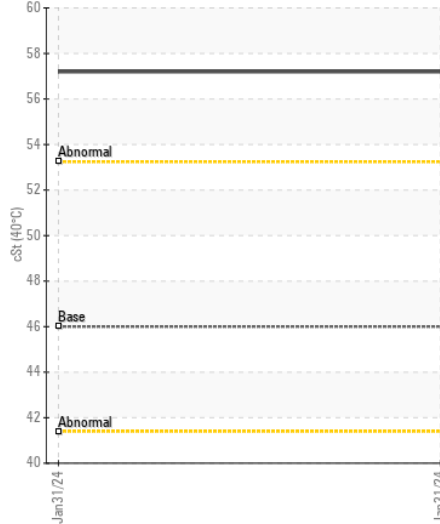

Acid Number

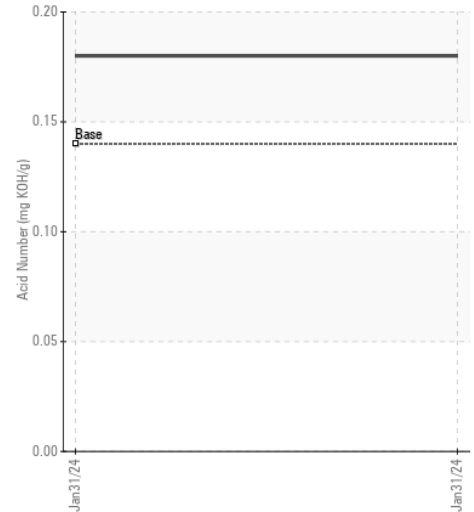

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : UCS06088932

Lab Number : 06088932

Unique Number : 10876377

Test Package : IND 2

Received : 14 Feb 2024

Tested : 15 Feb 2024

Diagnosed : 15 Feb 2024 - Don Baldrige

JEMCO-MAXAIR

WEST FARGO, ND
US 58078

Contact: DALE K
dalek@jemco-maxair.com

T: (701)281-0362

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)