**WEAR** CONTAMINATION **FLUID CONDITION** 


**NORMAL NORMAL NORMAL** 


Machine Id


946022-260306


Component Natural Gas Engine


RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
	Sample Number		Client Info		GFL0092065	GFL0084623	GFL008458
Resample at the next service interval to monitor.	Sample Date		Client Info		12 Feb 2024	09 Nov 2023	27 May 202
	Machine Age	hrs	Client Info		87692	973	71057
	Oil Age	hrs	Client Info		0	0	0
	Filter Age	hrs	Client Info		0	0	0
	Oil Changed		Client Info		Changed	Changed	Changed
	Filter Changed		Client Info		Changed	Changed	Changed
	Sample Status				NORMAL	NORMAL	NORMAL
VEAD			AOTM DE LOE			00	
VEAR	Iron	ppm	ASTM D5185m		29	20	20
Metal levels are typical for a new component breaking in.	Chromium	ppm	ASTM D5185m		2	1	2
	Nickel	ppm	ASTM D5185m	>2	<1	<1	<1
	Titanium	ppm	ASTM D5185m	0	0	0	0
	Silver	ppm	ASTM D5185m		0	0	0
	Aluminum	ppm	ASTM D5185m		2	2	2
	Lead	ppm	ASTM D5185m		4	<1	0
	Copper	ppm	ASTM D5185m		1	0	<1
	Tin	ppm	ASTM D5185m	>4	1	<1	<1
	Vanadium	ppm	ASTM D5185m	NONE	0	0	0
	White Metal	scalar	*Visual	NONE	NONE NONE	NONE NONE	NONE
	Yellow Metal	scalar	*Visual	NONE	NONE	INOINE	NONE
CONTAMINATION	Silicon	ppm	ASTM D5185m	>+100	12	10	5
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m	>20	<1	<1	<1
	Water		WC Method	>0.1	NEG	NEG	NEG
	Soot %	%	*ASTM D7844		0.1	0	0
	Nitration	Abs/cm	*ASTM D7624	>20	13.9	13.7	12.3
	Sulfation	Abs/.1mm	*ASTM D7415	>30	27.7	25.0	26.5
	Silt	scalar	*Visual	NONE	NONE	NONE	NONE
	Debris	scalar	*Visual	NONE	NONE	NONE	NONE
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
	Appearance	scalar	*Visual	NORML	NORML	NORML	NORM
	Odor	scalar	*Visual	NORML	NORML	NORML	NORN
	Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
LUID CONDITION	Sodium	nnm	ASTM D5185m		8	5	6
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.	Boron	ppm	ASTM D5185m	50	10	15	19
	Barium	ppm	ASTM D5185m		0	0	0
	Molybdenum	ppm	ASTM D5185m		65	59	61
	Manganese	ppm	ASTM D5185m		1	<1	1
	Magnesium	ppm	ASTM D5185m		720	679	701
	Calcium	ppm	ASTM D5185m		1824	1848	1927
	Phosphorus	ppm	ASTM D5185m		920	892	888
	Zinc	ppm	ASTM D5185m		1156	1148	1151
	Sulfur	ppm	ASTM D5185m		3104	2938	3355
	Oxidation	Abs/.1mm	*ASTM D7414		20.7	19.9	21.1
							5.6
	Base Number (BN)	mg KOH/g	ASTM D2896	10.2	3.8	5.5	0.0

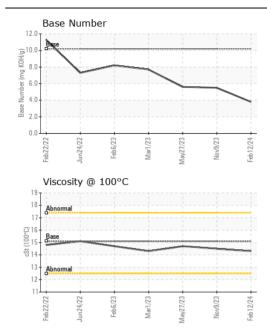

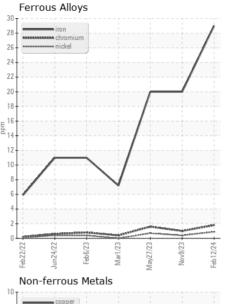









Certificate L2367

Laboratory Sample No.

Lab Number : 06089336

: GFL0092065

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 14 Feb 2024 **Tested** 

Unique Number : 10876781 Diagnosed Test Package : FLEET

: 15 Feb 2024 : 15 Feb 2024 - Wes Davis

GFL Environmental - 856 - Houston South 8515 Highway 6 South

Houston, TX US 77083

Contact: Apolinar Zacarias pzacariascano@gflenv.com T:

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: