



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id  
**27289**

Component  
**Diesel Engine**

Fluid  
**DIESEL ENGINE OIL SAE 40 (--- GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>KL0014031</b>	KL0012029	KL0012048
Sample Date		Client Info		<b>02 Feb 2024</b>	14 Nov 2023	03 Aug 2023
Machine Age	hrs	Client Info		<b>59754</b>	34218	30169
Oil Age	hrs	Client Info		<b>34218</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ATTENTION	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>100	<b>70</b>	27	12
Chromium	ppm	ASTM D5185m	>20	<b>2</b>	<1	<1
Nickel	ppm	ASTM D5185m	>4	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>22</b>	7	2
Lead	ppm	ASTM D5185m	>40	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>330	<b>4</b>	2	<1
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**











There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>25	<b>11</b>	6	4
Potassium	ppm	ASTM D5185m	>20	<b>55</b>	15	4
Fuel		WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844	>3	<b>1.3</b>	1	0.4
Nitration	Abs/cm	*ASTM D7624	>20	<b>11.8</b>	10.5	7.7
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>30.4</b>	26.0	20.6
Particles >4µm		ASTM D7647		<b>4576</b>	12632	5063
Particles >6µm		ASTM D7647	>5000	<b>2493</b>	▲ 6881	2758
Particles >14µm		ASTM D7647	>640	<b>424</b>	▲ 1171	469
Particles >21µm		ASTM D7647	>160	<b>143</b>	▲ 394	158
Particles >38µm		ASTM D7647	>40	<b>22</b>	▲ 61	24
Particles >71µm		ASTM D7647	>10	<b>2</b>	6	2
Oil Cleanliness		ISO 4406 (c)	>19/16	<b>18/16</b>	▲ 20/17	19/16
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>216	<b>9</b>	4	3
Boron	ppm	ASTM D5185m	250	<b>39</b>	50	91
Barium	ppm	ASTM D5185m	10	<b>11</b>	0	0
Molybdenum	ppm	ASTM D5185m	100	<b>104</b>	70	74
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	450	<b>896</b>	732	778
Calcium	ppm	ASTM D5185m	3000	<b>1762</b>	1362	1398
Phosphorus	ppm	ASTM D5185m	1150	<b>1293</b>	1049	1077
Zinc	ppm	ASTM D5185m	1350	<b>1634</b>	1312	1303
Sulfur	ppm	ASTM D5185m	4250	<b>5030</b>	3573	4274
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>31.1</b>	26.2	18.1
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>6.59</b>	8.50	11.06
Visc @ 100°C	cSt	ASTM D445	14.4	<b>12.9</b>	13.1	13.4

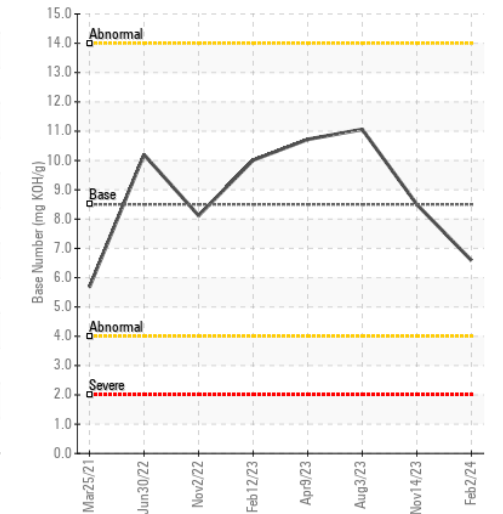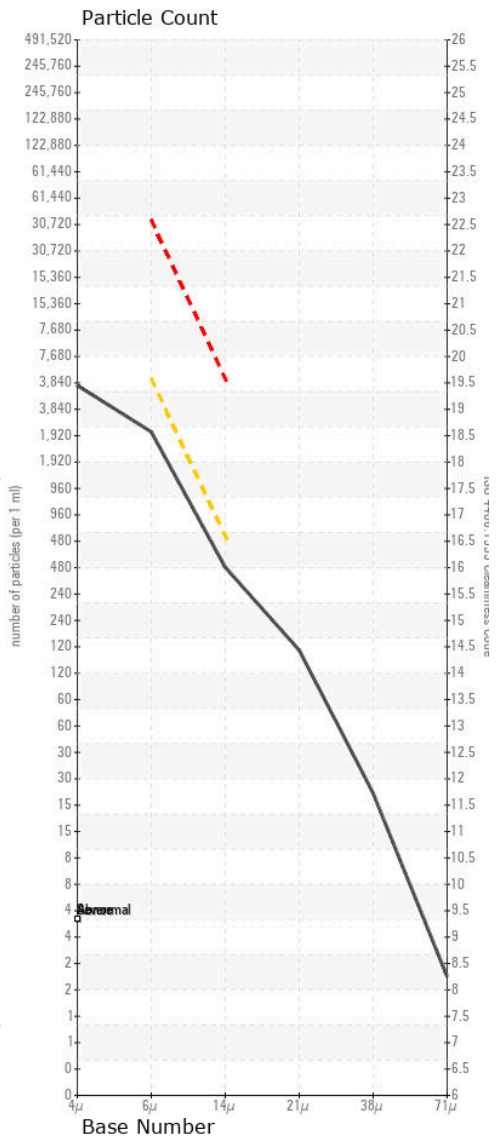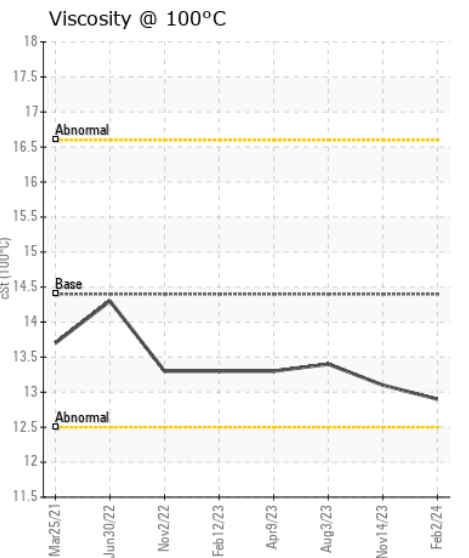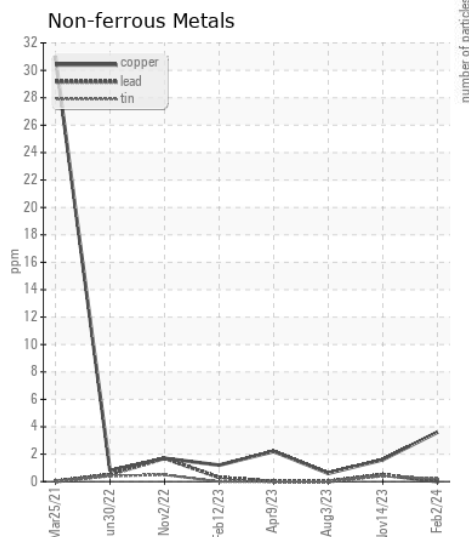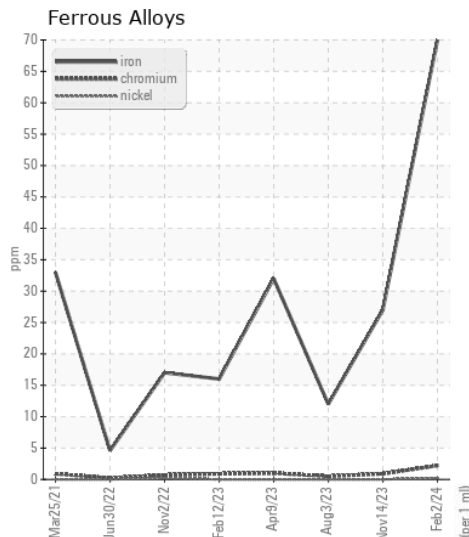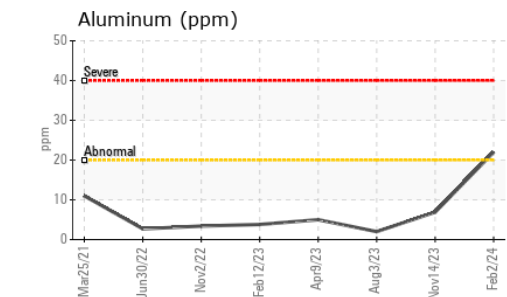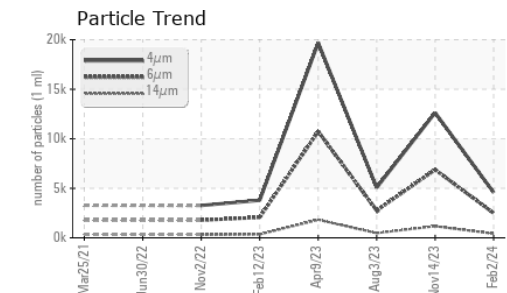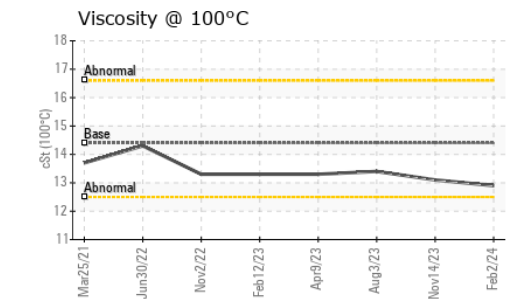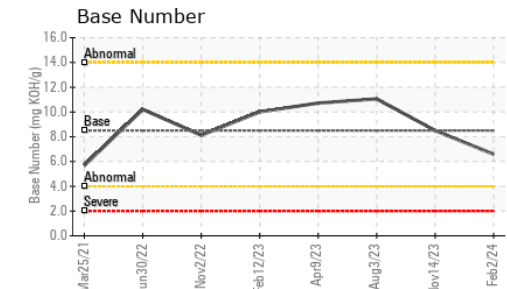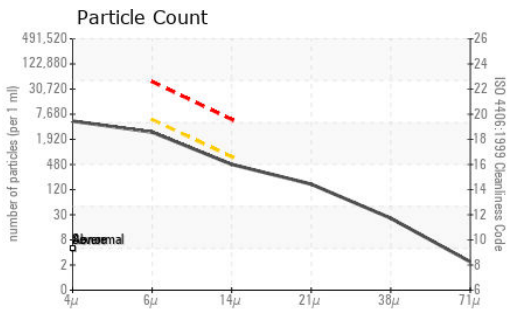

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KL0014031 **Received** : 14 Feb 2024  
**Lab Number** : 06089636 **Tested** : 16 Feb 2024  
**Unique Number** : 10877081 **Diagnosed** : 16 Feb 2024 - Jonathan Hester  
**Test Package** : MOB 2 ( Additional Tests: PrtCount )

**CITY & COUNTY HONOLULU**  
 99-999 IWAENA RD  
 AIEA, HI  
 US 96701  
 Contact: CLYDE OMIJA  
 comija@honolulu.gov  
 T: (575)623-9952  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)