



**PERFORMANCE
UNDER
PRESSURE**

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
CARL_U2120 CARL_U2120_SS2120
Component
Non-Drive End Seal Pot
Fluid
ROYAL PURPLE BARRIER FLUID FDA22 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		RP0025827	RP0034103	RP0034007
Sample Date		Client Info		20 Feb 2024	15 Nov 2023	25 Sep 2023
Machine Age	hrs	Client Info		2358	2358	2358
Oil Age	hrs	Client Info		2358	2358	2358
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>20	0	---	0
Chromium	ppm	ASTM D5185m	>20	0	---	0
Nickel	ppm	ASTM D5185m	>20	<1	---	<1
Titanium	ppm	ASTM D5185m		0	---	0
Silver	ppm	ASTM D5185m		0	---	0
Aluminum	ppm	ASTM D5185m	>20	0	---	0
Lead	ppm	ASTM D5185m	>20	0	---	0
Copper	ppm	ASTM D5185m	>20	0	---	0
Tin	ppm	ASTM D5185m	>20	<1	---	0
Vanadium	ppm	ASTM D5185m		0	---	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION









The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>15	<1	---	<1
Potassium	ppm	ASTM D5185m	>20	<1	---	<1
Water	%	ASTM D6304	>0.05	0.003	0.009	0.007
ppm Water	ppm	ASTM D6304	>500	30	92	70.3
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<1	---	0
Boron	ppm	ASTM D5185m		0	---	0
Barium	ppm	ASTM D5185m		0	---	0
Molybdenum	ppm	ASTM D5185m		0	---	0
Manganese	ppm	ASTM D5185m		<1	---	0
Magnesium	ppm	ASTM D5185m		0	---	0
Calcium	ppm	ASTM D5185m		<1	---	0
Phosphorus	ppm	ASTM D5185m		<1	---	<1
Zinc	ppm	ASTM D5185m		0	---	0
Acid Number (AN)	mg KOH/g	ASTM D8045		0.046	0.08	0.038
Visc @ 40°C	cSt	ASTM D445	5.2	5.99	---	5.64
Visc @ 100°C	cSt	ASTM D445	1.7	2.04	---	---
Viscosity Index (VI)	Scale	ASTM D2270		150	---	---

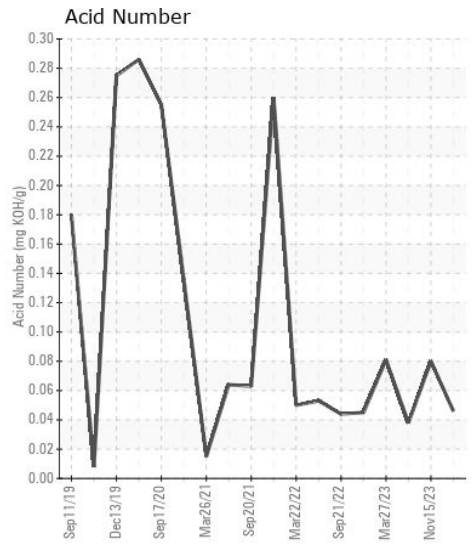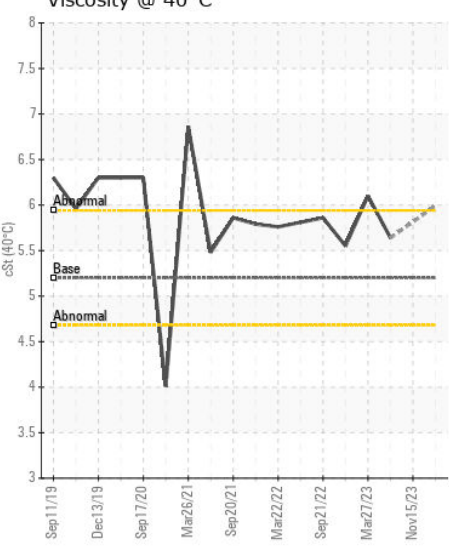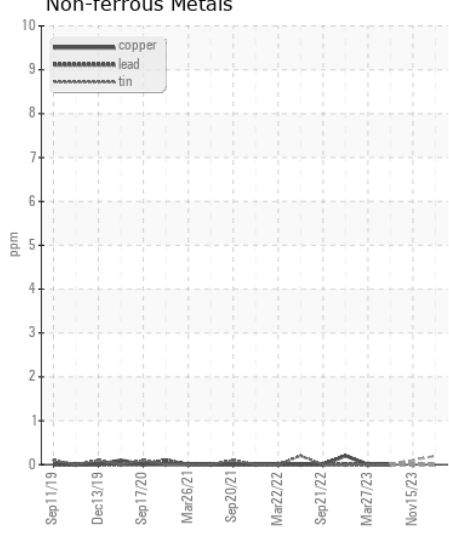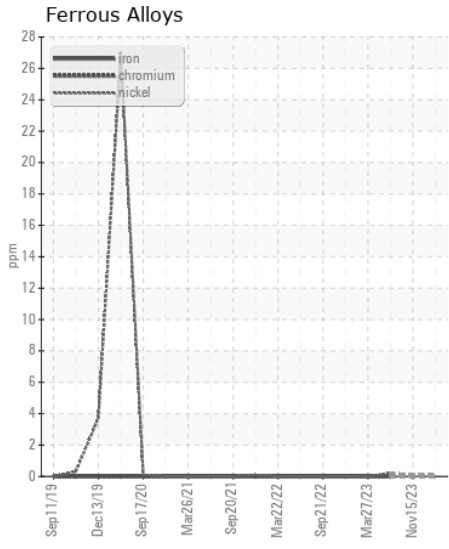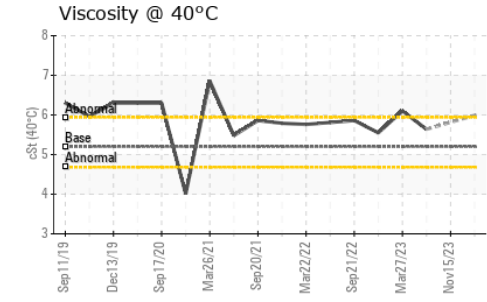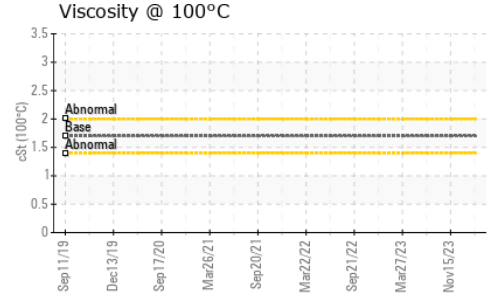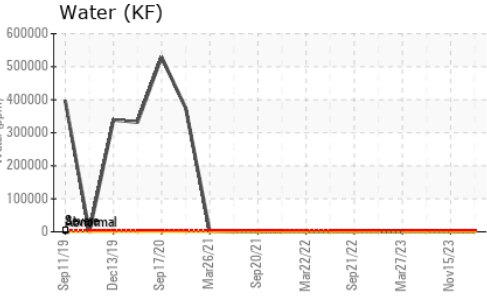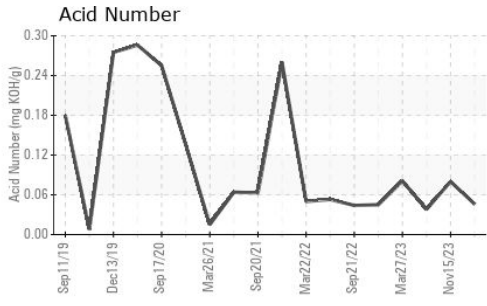

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0025827
Lab Number : 06097340
Unique Number : 10890193
Test Package : PLANT (Additional Tests: KV100, VI)

Received : 22 Feb 2024
Tested : 26 Feb 2024
Diagnosed : 26 Feb 2024 - Jonathan Hester

ENERGY TRANSFER - CARLTON
 11500 FRESSNER ROAD
 CARLTON, MI
 US 48117
 Contact: SCOTT VERHELLE

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (313)580-0267

F: