



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
[3186660]
 Machine Id
3039557
 Component
Diesel Engine
 Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0034224	DC0017048	---
Sample Date		Client Info		21 Feb 2024	01 Feb 2022	---
Machine Age	hrs	Client Info		0	380	---
Oil Age	hrs	Client Info		0	0	---
Filter Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		N/A	Changed	---
Filter Changed		Client Info		N/A	Changed	---
Sample Status				NORMAL	NORMAL	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>100	1	3	---
Chromium	ppm	ASTM D5185m	>20	0	0	---
Nickel	ppm	ASTM D5185m	>4	0	<1	---
Titanium	ppm	ASTM D5185m		0	<1	---
Silver	ppm	ASTM D5185m	>3	0	0	---
Aluminum	ppm	ASTM D5185m	>20	<1	2	---
Lead	ppm	ASTM D5185m	>40	<1	<1	---
Copper	ppm	ASTM D5185m	>330	<1	2	---
Tin	ppm	ASTM D5185m	>15	1	1	---
Vanadium	ppm	ASTM D5185m		<1	0	---
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	3	4	---
Potassium	ppm	ASTM D5185m	>20	0	2	---
Fuel		WC Method	>5	<1.0	<1.0	---
Water		WC Method	>0.2	NEG	NEG	---
Glycol		WC Method		NEG	NEG	---
Soot %	%	*ASTM D7844	>3	0.1	0.1	---
Nitration	Abs/cm	*ASTM D7624	>20	5.6	6.3	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	15.9	21.3	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	---

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>158	<1	2	---
Boron	ppm	ASTM D5185m	250	4	15	---
Barium	ppm	ASTM D5185m	10	0	0	---
Molybdenum	ppm	ASTM D5185m	100	5	58	---
Manganese	ppm	ASTM D5185m		0	<1	---
Magnesium	ppm	ASTM D5185m	450	47	913	---
Calcium	ppm	ASTM D5185m	3000	2099	1149	---
Phosphorus	ppm	ASTM D5185m	1150	854	1083	---
Zinc	ppm	ASTM D5185m	1350	1009	1197	---
Sulfur	ppm	ASTM D5185m	4250	3485	2959	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	9.8	17.8	---
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	7.5	10.5	---
Visc @ 100°C	cSt	ASTM D445	14.4	12.6	12.7	---

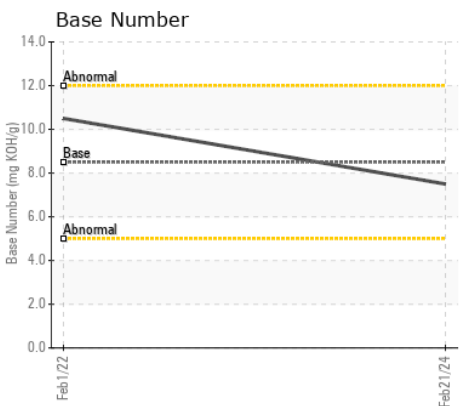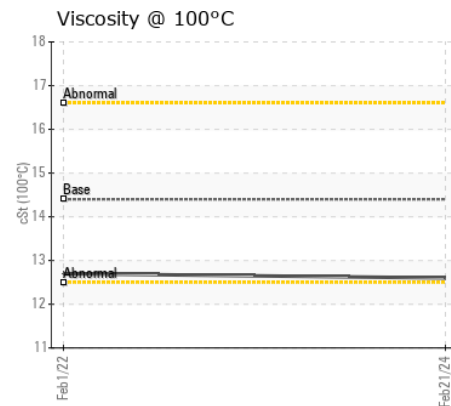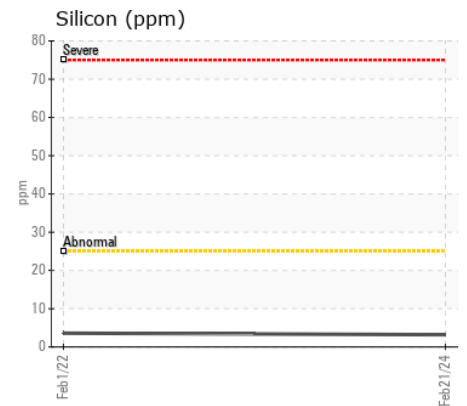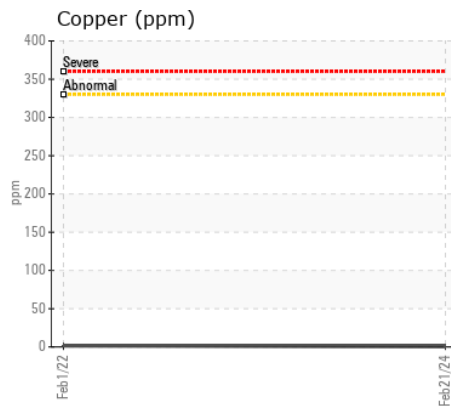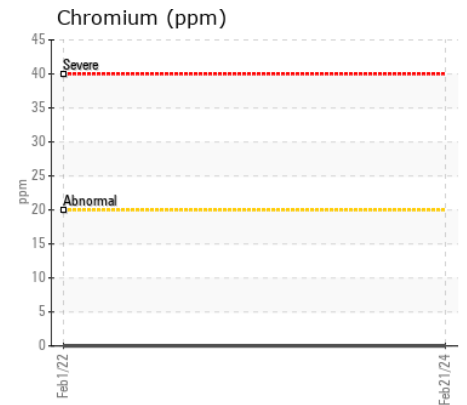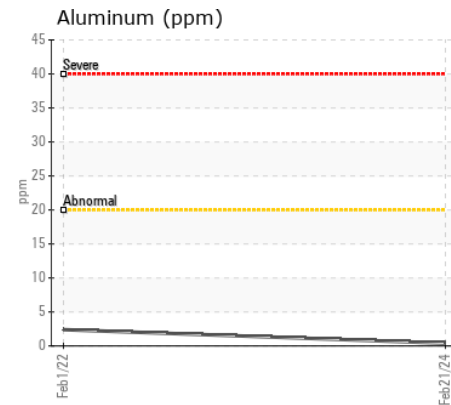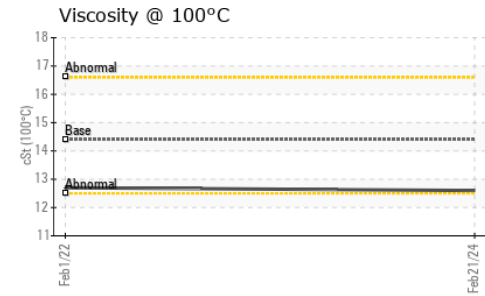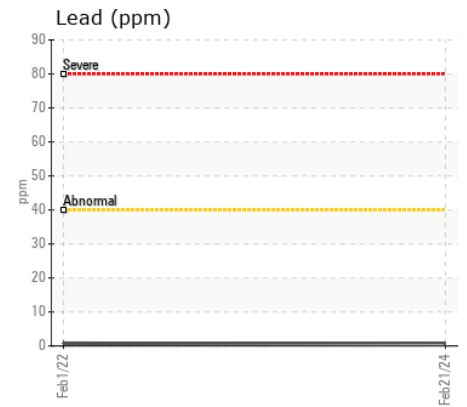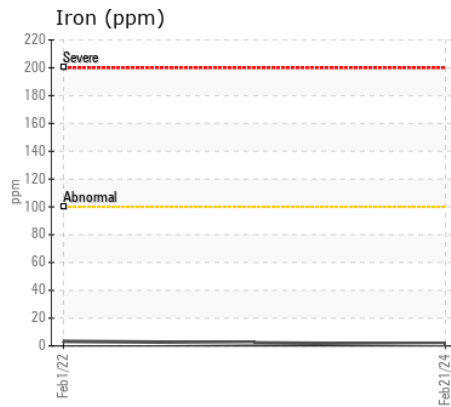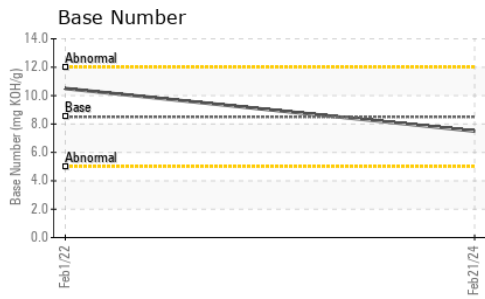

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0034224
Lab Number : 06097386
Unique Number : 10890239
Test Package : MOB 1 (Additional Tests: TBN)

Received : 22 Feb 2024
Tested : 23 Feb 2024
Diagnosed : 23 Feb 2024 - Wes Davis

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)