
WEAR CONTAMINATION **FLUID CONDITION** **NORMAL NORMAL NORMAL**

HYD WEST 2-8

Component Hydraulic System

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History
Resample at the next service interval to monitor.	Sample Number		Client Info		PH0003266		
	Sample Date		Client Info		13 Feb 2024		
	Machine Age	hrs	Client Info		0		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				NORMAL		
VEAR	Iron	ppm	ASTM D5185m	>20	0		
	Chromium	ppm	ASTM D5185m	>20	<1		
All component wear rates are normal.	Nickel	ppm	ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m		0		
	Aluminum	ppm	ASTM D5185m	>20	0		
	Lead	ppm	ASTM D5185m		0		
	Copper	ppm	ASTM D5185m	>20	<1		
	Tin	ppm	ASTM D5185m	>20	0		
	Vanadium	ppm	ASTM D5185m		0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
ONTAMINATION	Silicon	ppm	ASTM D5185m	>15	<1		
ONTAMINATION	Potassium	ppm	ASTM D5185m		0		
There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.	Water	ppiii	WC Method		NEG		
	Particles >4µm		ASTM D7647		326		
	Particles >6µm		ASTM D7647		87		
	Particles >14µm		ASTM D7647		9		
	Particles >21µm		ASTM D7647		3		
	Particles >38µm		ASTM D7647		0		
	Particles >71µm		ASTM D7647		0		
	Oil Cleanliness		ISO 4406 (c)		16/14/10		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.05	NEG		
LUID CONDITION	Sodium	ppm	ASTM D5185m		1		
ESIB CONDITION	Boron	ppm	ASTM D5185m		0		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		0		
	Manganese	ppm	ASTM D5185m		0		
	Magnesium	ppm	ASTM D5185m		<1		
	Calcium	ppm	ASTM D5185m		33		
	Phosphorus	ppm	ASTM D5185m		320		
	Zinc	ppm	ASTM D5185m		325		
	Sulfur	ppm	ASTM D5185m		3352		
	Acid Number (AN)	mg KOH/g	ASTM D8045		0.43		
	Visc @ 40°C	cSt	ASTM D445		68.1		



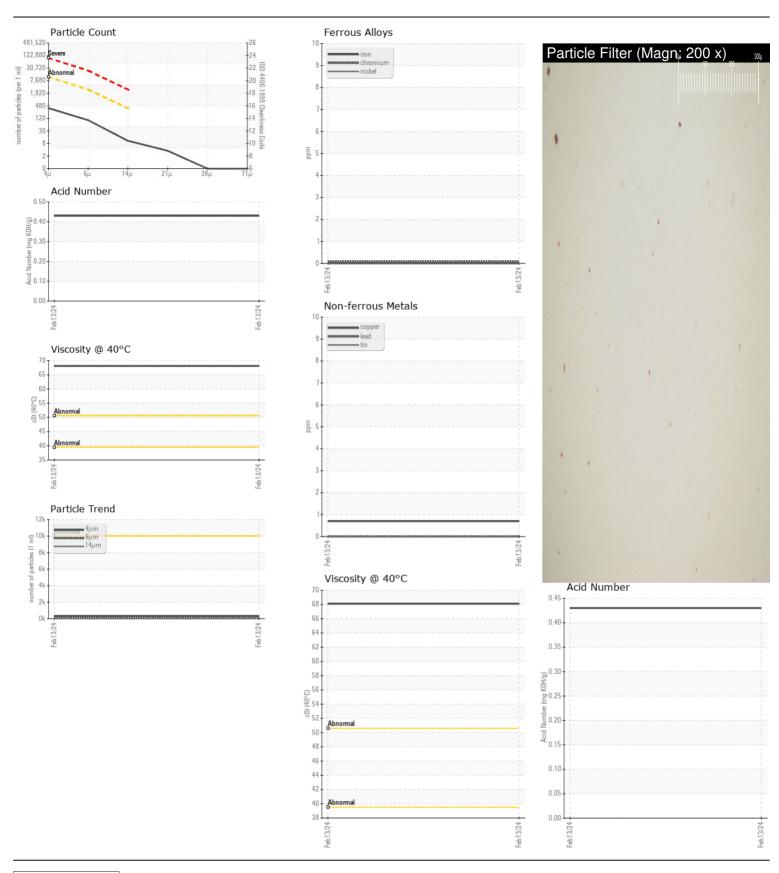

Laboratory Sample No.

Lab Number : 06097655

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : PH0003266

Tested Unique Number: 10890508 Test Package: PLANT (Additional Tests: PrtFilter)

Received : 22 Feb 2024 : 26 Feb 2024 Diagnosed

: 26 Feb 2024 - Jonathan Hester

NPAA - NIPPON PAINT AUTOMOTIVE AMERICAS 2701 E 170TH ST

LANSING, IL US 60438

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: