



Machine Id
Ramsey Ridge 1
Component
Natural Gas Engine
Fluid
PETRO CANADA SENTRON LD 3000 (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PCA0111945	PCA0111984	PCA0092162
Sample Date		Client Info		06 Feb 2024	04 Jan 2024	02 May 2023
Machine Age	hrs	Client Info		123096	136738	126487
Oil Age	hrs	Client Info		2068	1198	0
Filter Age	hrs	Client Info		2068	0	0
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Filter Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	1	<1	5
Chromium	ppm	ASTM D5185m	>4	<1	0	0
Nickel	ppm	ASTM D5185m	>2	<1	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>3	<1	0	0
Aluminum	ppm	ASTM D5185m	>9	<1	2	6
Lead	ppm	ASTM D5185m	>30	<1	0	13
Copper	ppm	ASTM D5185m	>35	<1	<1	1
Tin	ppm	ASTM D5185m	>4	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION













Fuel content negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>+100	2	1	2
Potassium	ppm	ASTM D5185m	>20	<1	1	<1
Fuel	%	ASTM D3524	>4.0	0.2	0.0	0.3
Water		WC Method	>0.1	NEG	NEG	NEG
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624	>15	3.8	3.8	6.4
Sulfation	Abs/.1mm	*ASTM D7415	>25	14.3	14.2	19.3
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>20	0	0	1
Boron	ppm	ASTM D5185m	5	<1	0	1
Barium	ppm	ASTM D5185m	1	5	0	5
Molybdenum	ppm	ASTM D5185m	2	2	<1	3
Manganese	ppm	ASTM D5185m	1	<1	0	0
Magnesium	ppm	ASTM D5185m	5	6	7	36
Calcium	ppm	ASTM D5185m	1220	1179	1286	1582
Phosphorus	ppm	ASTM D5185m	298	245	313	327
Zinc	ppm	ASTM D5185m	350	319	331	428
Sulfur	ppm	ASTM D5185m	1995	2360	2449	2702
Oxidation	Abs/.1mm	*ASTM D7414	>20	8.1	8.2	17.9
Acid Number (AN)	mg KOH/g	ASTM D8045	0.86	0.33	0.33	1.75
Base Number (BN)	mg KOH/g	ASTM D2896	3.9	4.12	3.29	3.37
Visc @ 100°C	cSt	ASTM D445	13.7	13.0	13.2	14.3

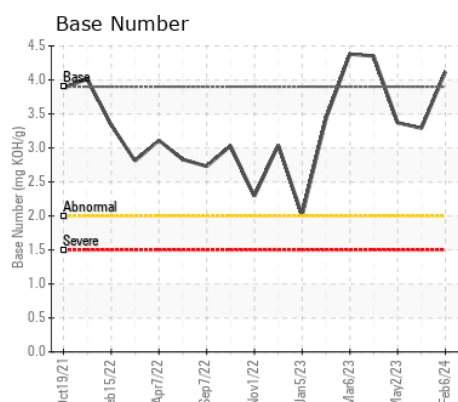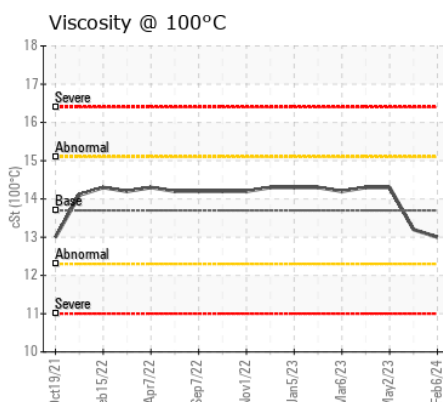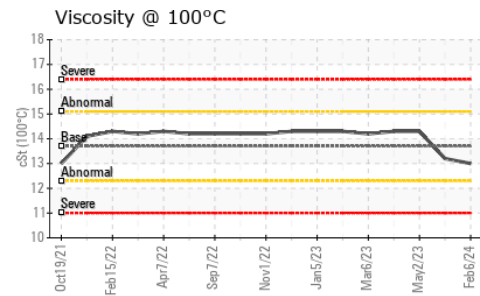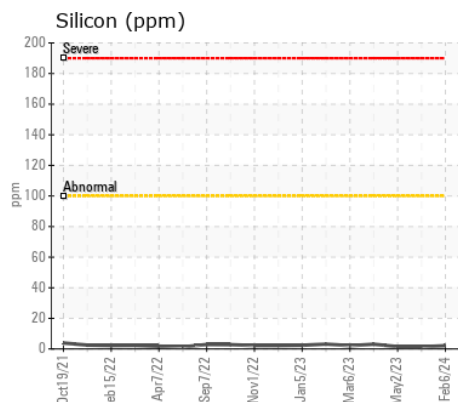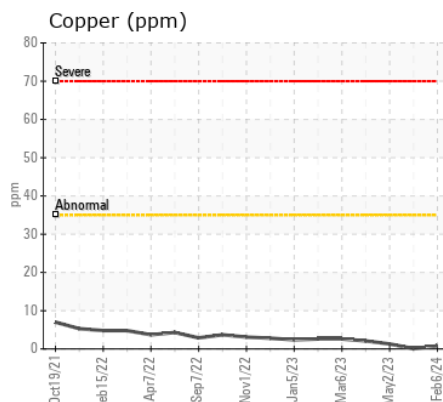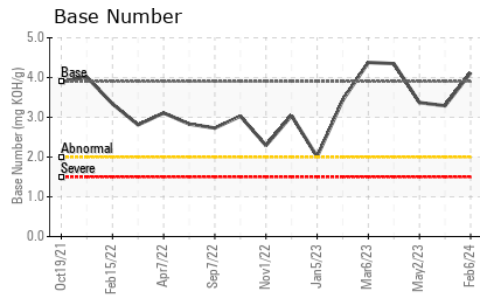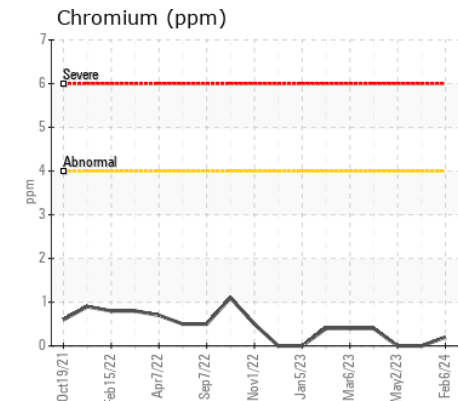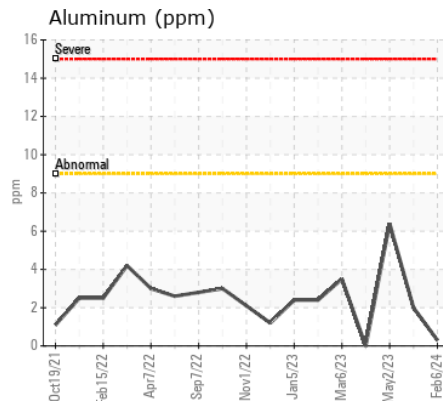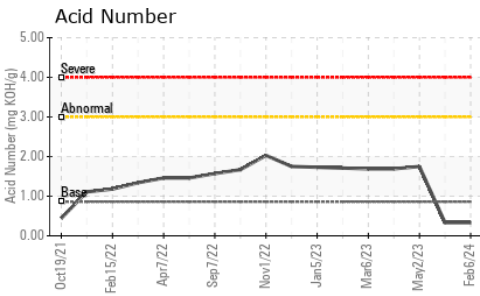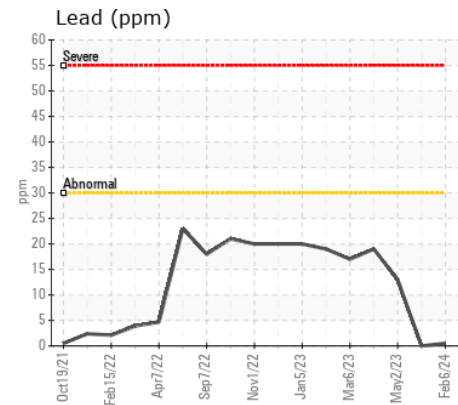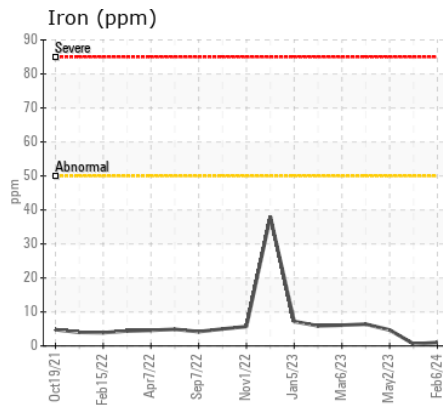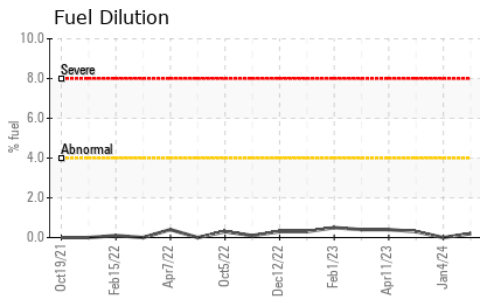

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0111945 **Received** : 22 Feb 2024
Lab Number : 06097903 **Tested** : 26 Feb 2024
Unique Number : 10896133 **Diagnosed** : 26 Feb 2024 - Wes Davis
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

ENERVEST OPERATING - RAMSEY RIDGE
 2368 RAMSEY RIDGE
 CLINCHCO, VA
 US 24226
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: