



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**[PMOAS3186677]**  
 Machine Id  
**KOHLER 150REOZJF 3032955**  
 Component  
**Diesel Engine**  
 Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>DC0033799</b>	DC0025606	DC0019159
Sample Date		Client Info		<b>21 Feb 2024</b>	06 Feb 2023	17 Jan 2022
Machine Age	hrs	Client Info		<b>0</b>	420	377
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	Changed	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>100	<b>3</b>	3	2
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Silver	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m	>40	<b>&lt;1</b>	1	<1
Copper	ppm	ASTM D5185m	>330	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

## CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>5</b>	4	4
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	2	1
Fuel		WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844	>3	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>5.1</b>	5.3	5.2
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>15.3</b>	15.6	24.1
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	NEG

## FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>158	<b>0</b>	1	7
Boron	ppm	ASTM D5185m	250	<b>5</b>	7	23
Barium	ppm	ASTM D5185m	10	<b>5</b>	0	0
Molybdenum	ppm	ASTM D5185m	100	<b>4</b>	7	53
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	450	<b>37</b>	98	914
Calcium	ppm	ASTM D5185m	3000	<b>2072</b>	2326	1143
Phosphorus	ppm	ASTM D5185m	1150	<b>830</b>	897	990
Zinc	ppm	ASTM D5185m	1350	<b>968</b>	1106	1087
Sulfur	ppm	ASTM D5185m	4250	<b>3703</b>	4310	3079
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>8.9</b>	9.0	22.2
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>8.77</b>	8.3	10.2
Visc @ 100°C	cSt	ASTM D445	14.4	<b>13.6</b>	13.5	13.5

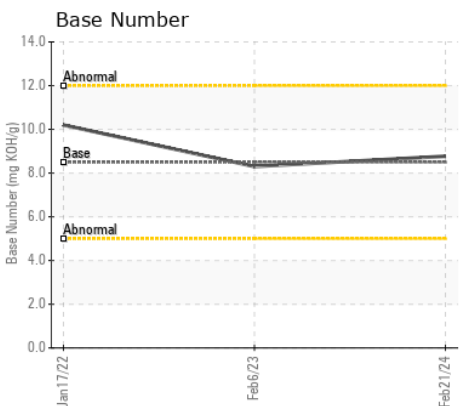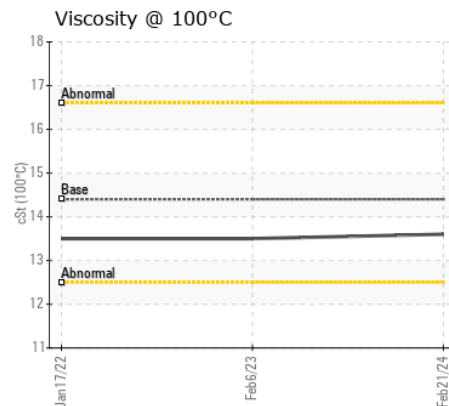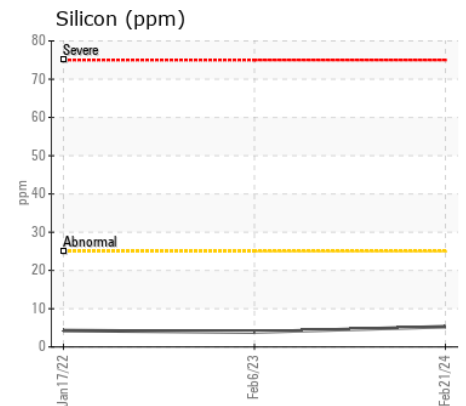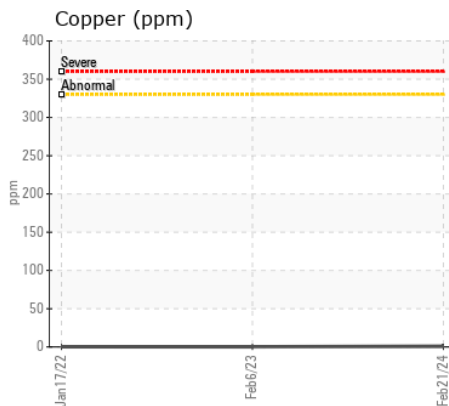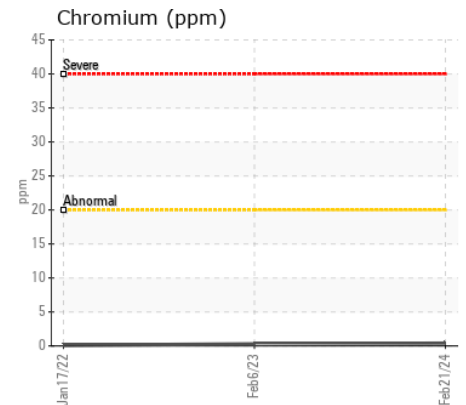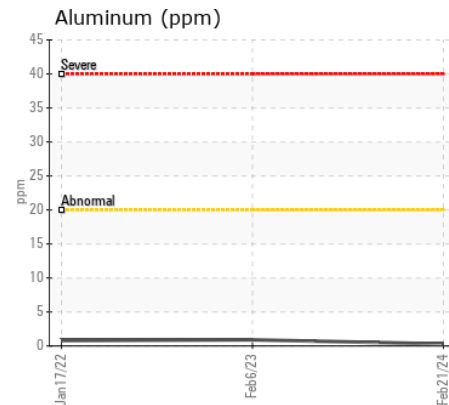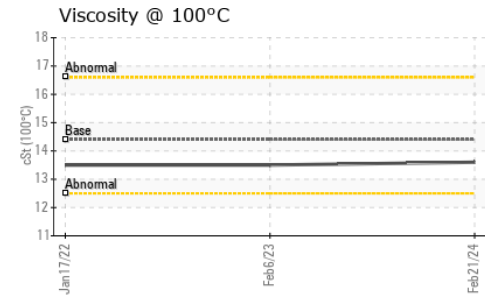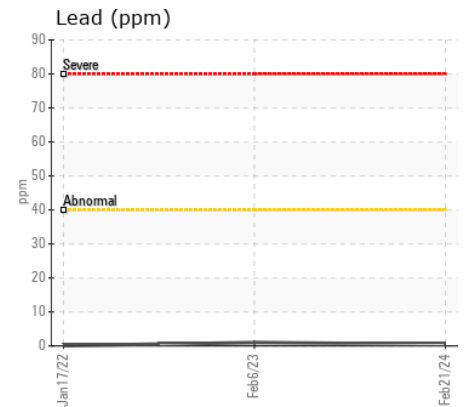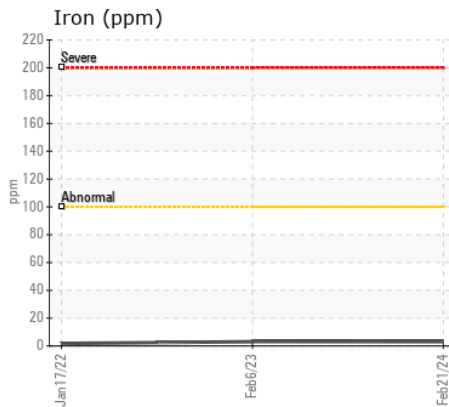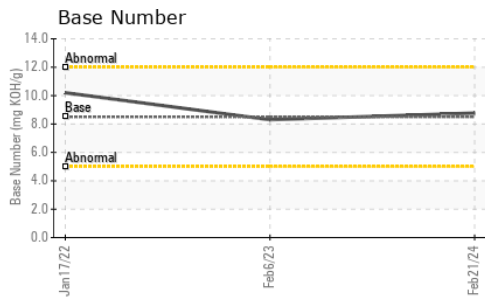

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : DC0033799  
**Lab Number** : 06097907  
**Unique Number** : 10896137  
**Test Package** : MOB 2

**Received** : 22 Feb 2024  
**Tested** : 23 Feb 2024  
**Diagnosed** : 23 Feb 2024 - Wes Davis

**KELLY GENERATOR & EQUIPMENT INC**  
 1955 DALE LN  
 OWINGS, MD  
 US 20736  
 Contact: LESLIE SNURR  
 LSNURR@KGE.COM  
 T: (410)257-5225  
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)