

## Machine Id **401** Component Compressor Fluid VILTER SF PAO 150 (--- QTS) RECOMMENDATION


Resample at the next service interval to monitor.

## **WEAR**

All component wear rates are normal.

## CONTAMINATION

There is no indication of any contamination in the oil.

## FLUID CONDITION


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0858373		
Sample Date		Client Info		19 Feb 2024		
Machine Age	hrs	Client Info		2649		
Oil Age	hrs	Client Info		2649		
Filter Age	hrs	Client Info		2649		
Oil Changed		Client Info		Not Changd		
Filter Changed		Client Info		Not Changd		
Sample Status				NORMAL		
Iron	ppm	ASTM D5185m	>50	7		
Chromium	ppm	ASTM D5185m	>5	<1		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		<1		
Aluminum	ppm	ASTM D5185m	>15	<1		
Lead	ppm	ASTM D5185m	>65	<1		
Copper	ppm	ASTM D5185m	>65	1		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Silicon	ppm	ASTM D5185m	>35	5		
Potassium	ppm	ASTM D5185m	>20	۲ ۲		
Water	%	ASTM D5105III	>0.1	0.055		
ppm Water	ppm	ASTM D6304	>1000	550		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	LIGHT		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	0.2%		
	Jouran	viouur	20.1	0.2 /0		
Sodium	ppm	ASTM D5185m		0		
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		5		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		2		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		10		
Sulfur	ppm	ASTM D5185m		0		
Acid Number (AN)	mg KOH/g	ASTM D8045		0.092		
Vice @ 40°C	0°+	ACTM D445		147		

Visc @ 40°C cSt ASTM D445

Contact/Location: PHIL PRIEBE - TERSUF

147

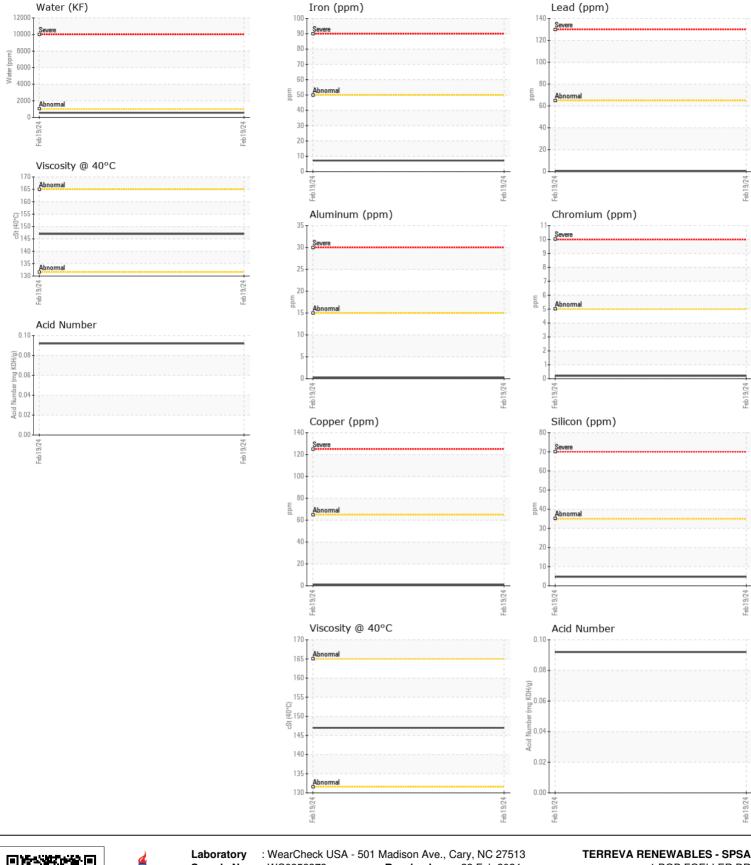

Sample No. : WC0858373 Received 1 BOB FOELLER DR : 23 Feb 2024 Lab Number : 06099287 Tested : 27 Feb 2024 SUFFOLK, VA Unique Number : 10897517 : 28 Feb 2024 - Jonathan Hester US 23434 Diagnosed Test Package : MOB 2 (Additional Tests: KF) Contact: PHIL PRIEBE Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. ppriebe@terrevarenewables.com \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (815)671-3576 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: