

Machine Id EASG 1013964 Component Diesel Engine Fluid DIESEL ENGINE OIL SAE 40 (--- GAL)

Resample at the next service interval to monitor. Please specify the component make and model with your next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

RECOMMENDATION


CONTAMINATION


There is no indication of any contamination in the oil.

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Test		UOM	Method	Limit/Abn	Current	History1	History2
Sample N	lumber	00111	Client Info	Ennorton	WC0868930	WC0779440	WC0688894
Sample Date			Client Info		07 Jan 2024	05 Apr 2023	12 Apr 2022
Machine		hrs	Client Info		0	6175	4664
Oil Age	3-	hrs	Client Info		0	0	0
Filter Ag	е	hrs	Client Info		0	0	0
Oil Changed			Client Info		Changed	N/A	N/A
Filter Ch	•		Client Info		Changed	N/A	N/A
Sample	•				NORMAL	NORMAL	NORMAL
· · ·							
Iron		ppm	ASTM D5185m	>100	5	6	8
Chromiu	Im	ppm	ASTM D5185m	>20	0	<1	<1
Nickel		ppm	ASTM D5185m	>4	0	0	0
Titanium	1	ppm	ASTM D5185m		0	0	<1
Silver		ppm	ASTM D5185m	>3	0	0	<1
Aluminu	m	ppm	ASTM D5185m	>20	3	2	3
Lead		ppm	ASTM D5185m	>40	1	0	0
Copper		ppm	ASTM D5185m	>330	2	2	2
Tin		ppm	ASTM D5185m	>15	<1	0	<1
Vanadiu		ppm	ASTM D5185m		0	0	0
White M	etal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow N	/letal	scalar	*Visual	NONE	NONE	NONE	NONE
Silicon		ppm	ASTM D5185m	>25	5	5	4
Potassiu	m	ppm	ASTM D5185m	>20	1	<1	0
Fuel		ppin	WC Method	>5	- <1.0	<1.0	<1.0
Water			WC Method	>0.2	NEG	NEG	NEG
Glycol			WC Method	20.L	NEG	NEG	NEG
Soot %		%	*ASTM D7844	>3	0.1	0.2	0.2
Nitration		Abs/cm	*ASTM D7624	>20	6.4	6.8	7.5
Sulfation		Abs/.1mm	*ASTM D7415	>30	20.3	21.4	22.4
Silt		scalar	*Visual	NONE	NONE	NONE	NONE
Debris		scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Di	rt	scalar	*Visual	NONE	NONE	NONE	NONE
Appeara	ince	scalar	*Visual	NORML	NORML	NORML	NORML
Odor		scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified	d Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Sodium		ppm	ASTM D5185m	>216	2	2	2
Boron		ppm	ASTM D5185m	250	378	337	376
Barium		ppm	ASTM D5185m	10	0	0	0
Molybde		ppm	ASTM D5185m	100	87	82	92
Mangan		ppm	ASTM D5185m		<1	<1	<1
Magnesi		ppm	ASTM D5185m	450	407	482	450
Calcium		ppm	ASTM D5185m	3000	1405	1408	1569
Phospho	orus	ppm	ASTM D5185m	1150	1080	980	993
Zinc		ppm	ASTM D5185m	1350	1280	1193	1091
Sulfur		ppm	ASTM D5185m	4250	3260	3789	2815
Oxidatio		Abs/.1mm	*ASTM D7414	>25	14.8	16.7	17.4
Base Num		mg KOH/g	ASTM D2896	8.5	7.1	7.6	8.3
Visc @	100°C	cSt	ASTM D445	14.4	12.9	12.6	12.8

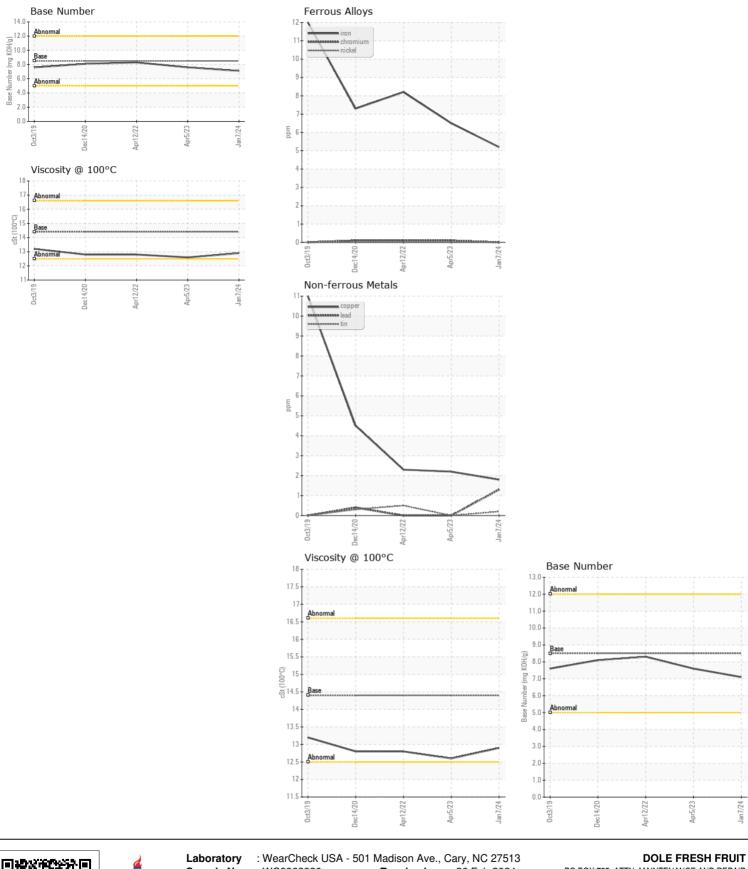



ĕ

Contact/Location: LUIS LAPIERRE - DOLWIL