



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
CARDINAL PRIDE
Machine Id
CPR
Component
Port Genset
Fluid
CHEVRON DELO 710 LS (3 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		MW0065118	MW0065145	MW0061003
Sample Date		Client Info		19 Feb 2024	29 Dec 2023	14 Nov 2023
Machine Age	hrs	Client Info		10103	9481	8941
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	12	5	2
Chromium	ppm	ASTM D5185m	>4	1	<1	0
Nickel	ppm	ASTM D5185m	>2	<1	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>12	4	2	1
Lead	ppm	ASTM D5185m	>17	<1	0	0
Copper	ppm	ASTM D5185m	>70	<1	0	0
Tin	ppm	ASTM D5185m	>15	<1	0	<1
Vanadium	ppm	ASTM D5185m		<1	0	<1
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	6	2	3
Potassium	ppm	ASTM D5185m	>20	2	2	0
Fuel		WC Method	>4.0	<1.0	<1.0	<1.0
Water		WC Method	>0.1	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844		0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	7.8	7.0	6.5
Sulfation	Abs/.1mm	*ASTM D7415	>30	14.6	13.9	13.5
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		4	0	2
Boron	ppm	ASTM D5185m		54	45	42
Barium	ppm	ASTM D5185m		34	3	0
Molybdenum	ppm	ASTM D5185m		62	45	42
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		14	7	9
Calcium	ppm	ASTM D5185m		4217	3220	3321
Phosphorus	ppm	ASTM D5185m		39	46	0
Zinc	ppm	ASTM D5185m		32	0	0
Sulfur	ppm	ASTM D5185m		3173	2223	2079
Oxidation	Abs/.1mm	*ASTM D7414	>25	8.7	7.6	7.3
Base Number (BN)	mg KOH/g	ASTM D2896	10.5	5.9	6.1	6.0
Visc @ 100°C	cSt	ASTM D445	15.5	14.4	14.3	14.3

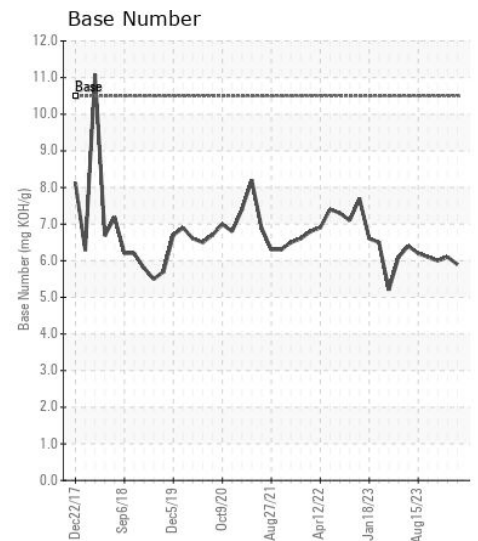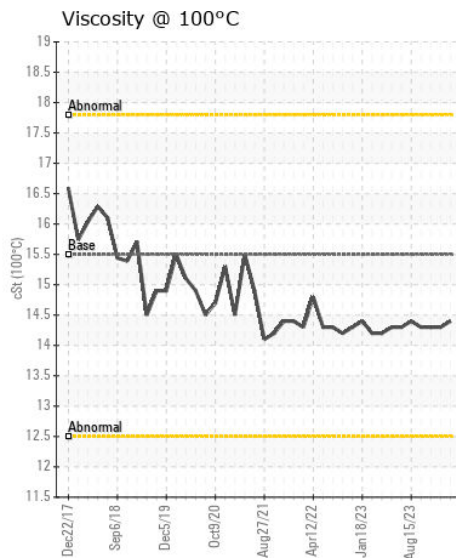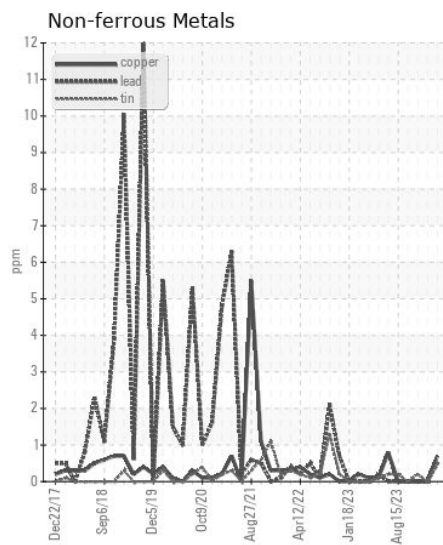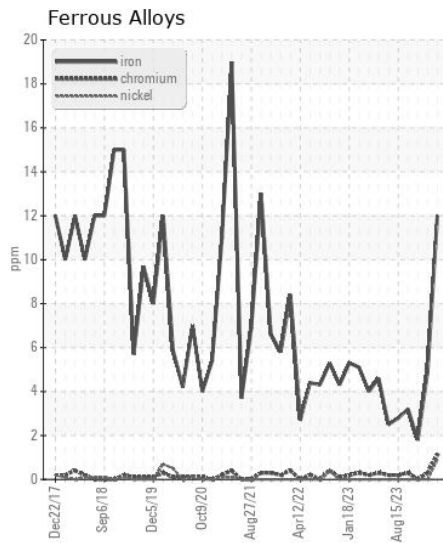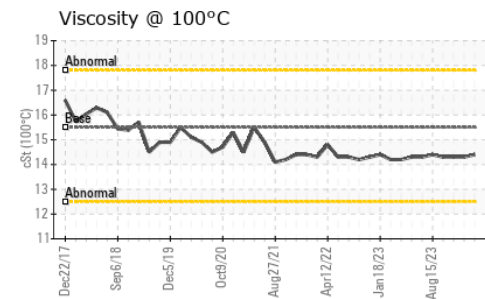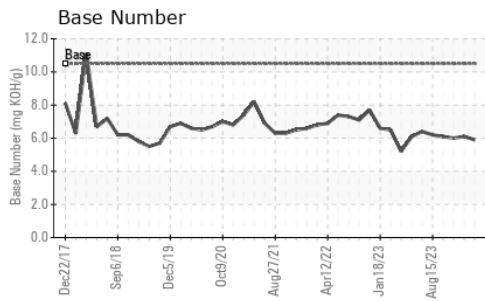

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MW0065118
Lab Number : 06099890
Unique Number : 10898120
Test Package : MAR 2

Received : 26 Feb 2024
Tested : 27 Feb 2024
Diagnosed : 27 Feb 2024 - Don Baldrige

AMERICAN RIVER TRANSPORTATION CO.
 P.O. BOX 2889
 ST. LOUIS, MO
 US 63111
 Contact: BRIAN GRIEWING
 brian.griewing@adm.com
 T:
 F: (314)481-5278

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)