

Area PALASYN 45 Machine Id PALATEK 22CE002981 - SUMMIT TOYOTA Component Compressor


RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		UCS06100227	UCS05973087	
	Sample Date		Client Info		20 Feb 2024	23 Sep 2023	
	Machine Age	hrs	Client Info		6259	5636	
	Oil Age	hrs	Client Info		1500	2000	
	Filter Age	hrs	Client Info		1000	1000	
	Oil Changed		Client Info		Not Changd	Not Changd	
	Filter Changed		Client Info		Changed	Changed	
	Sample Status				NORMAL	NORMAL	
WEAR	Iron		ACTM DE10Em	. 50	•	0	
WEAN	Iron	ppm	ASTM D5185m		0	0	
All component wear rates are normal.	Chromium	ppm	ASTM D5185m	>10	0	0	
	Nickel	ppm	ASTM D5185m		0	<1	
	Titanium	ppm	ASTM D5185m		0	0	
	Silver	ppm	ASTM D5185m	05	0	0	
	Aluminum	ppm	ASTM D5185m		0	0	
	Lead	ppm	ASTM D5185m		0	<1	
	Copper Tin	ppm	ASTM D5185m ASTM D5185m		<1 0	<1	
	Vanadium	ppm		>15		0	
	White Metal	ppm	ASTM D5185m		0 NONE		
		scalar	*Visual *Visual	NONE	NONE	NONE	
	Yellow Metal	scalar	visual	NONE	NONE	NONE	
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	1	3	
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m	>20	0	1	
	Water		WC Method	>0.1	NEG	NEG	
	Silt	scalar	*Visual	NONE	NONE	NONE	
	Debris	scalar	*Visual	NONE	NONE	NONE	
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
	Appearance	scalar	*Visual	NORML	NORML	NORML	
	Odor	scalar	*Visual	NORML	NORML	NORML	
	Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	
FLUID CONDITION	Sodium		ASTM D5185m		1	0	
	Boron	ppm ppm	ASTM D5185m	0.0	0	0	
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		0	0	
	Molybdenum	ppm	ASTM D5185m		0	0	
	Manganese	ppm	ASTM D5185m		0	0	
	Magnesium	ppm	ASTM D5185m		0	0	
	Calcium	ppm	ASTM D5185m		0	0	
	Phosphorus	ppm	ASTM D5185m		618	623	
	Zinc	ppm	ASTM D5185m		0	023	
	Sulfur	ppm	ASTM D5185m		1133	1245	
	Acid Number (AN)		ASTM D5185III ASTM D8045		0.091	0.181	
		ing KOLI/g		0.172	0.091	0.101	

Contact/Location: TODD HYDRAN - UCAIRLOWOH

42.1

42.1

Visc @ 40°C cSt ASTM D445 39.9

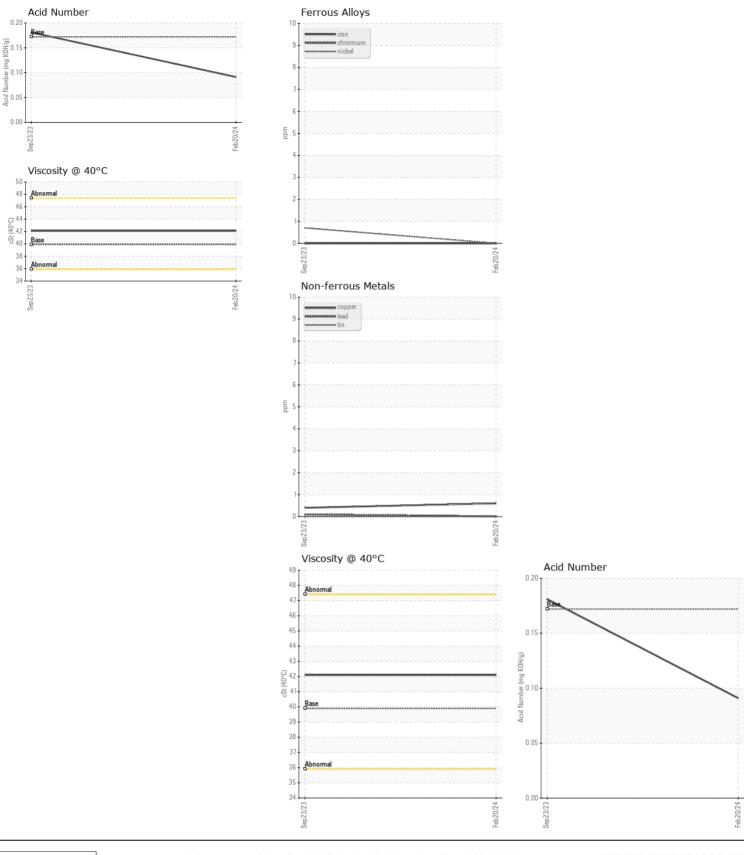

THE AIR COMPRESSOR CO Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCS06100227 : 26 Feb 2024 Sample No. Received Lab Number : 06100227 : 27 Feb 2024 LOWELLVILLE, OH Tested Unique Number : 10898457 : 28 Feb 2024 - Jonathan Hester US 44436 Diagnosed Test Package : IND 2 Contact: TODD HYDRAN Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. service@aircompressorco.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (330)536-9665 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (330)536-9667

Contact/Location: TODD HYDRAN - UCAIRLOWOH