



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	ATTENTION

Area  
**WQ**  
Machine Id  
**DODGE 00101**  
Component  
**Gearbox**  
Fluid  
**GEAR OIL ISO 220 (1 GAL)**

## RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

## WEAR

All component wear rates are normal.

## CONTAMINATION

There is no indication of any contamination in the oil.

## FLUID CONDITION











The oil viscosity is lower than normal. Confirm oil type. The AN level is acceptable for this fluid.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC0721336</b>	WC0570399	WC0524330
Sample Date		Client Info		<b>25 Feb 2024</b>	17 Jan 2023	07 Feb 2022
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>ATTENTION</b>	NORMAL	ATTENTION

Iron	ppm	ASTM D5185m	>200	<b>62</b>	102	81
Chromium	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>5</b>	6	6
Lead	ppm	ASTM D5185m	>100	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>200	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	VLITE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

Silicon	ppm	ASTM D5185m	>50	<b>21</b>	33	23
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	3	2
Water		WC Method	>0.2	<b>NEG</b>	NEG	NEG
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	NEG

Sodium	ppm	ASTM D5185m		<b>2</b>	0	1
Boron	ppm	ASTM D5185m	50	<b>12</b>	8	5
Barium	ppm	ASTM D5185m	15	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	15	<b>&lt;1</b>	1	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	1	<1
Magnesium	ppm	ASTM D5185m	50	<b>3</b>	2	2
Calcium	ppm	ASTM D5185m	50	<b>12</b>	8	8
Phosphorus	ppm	ASTM D5185m	350	<b>202</b>	171	178
Zinc	ppm	ASTM D5185m	100	<b>0</b>	3	2
Sulfur	ppm	ASTM D5185m	12500	<b>10285</b>	14106	14366
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	<b>0.51</b>	0.44	0.45
Visc @ 40°C	cSt	ASTM D445	220	<b>160.9</b>	202	136.7

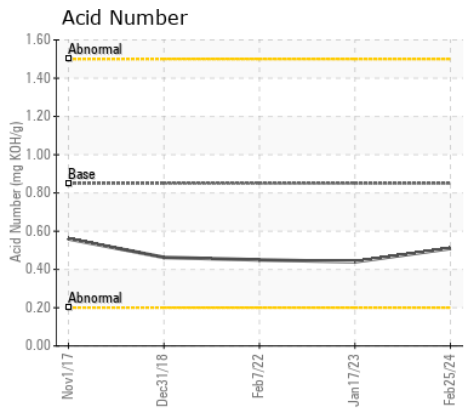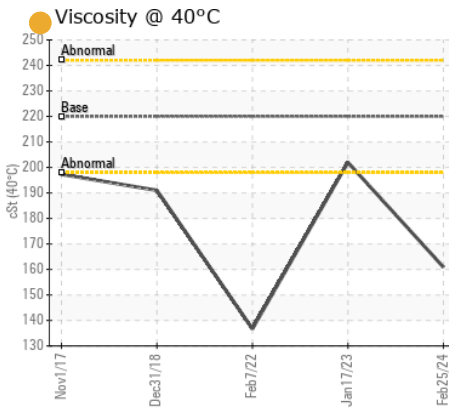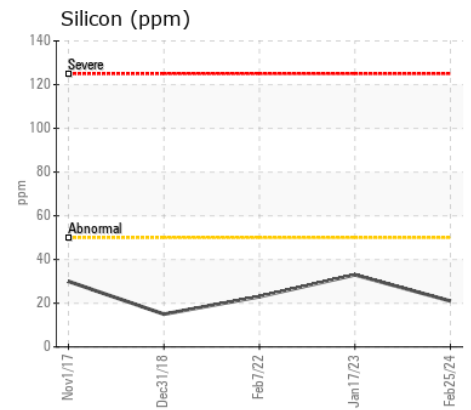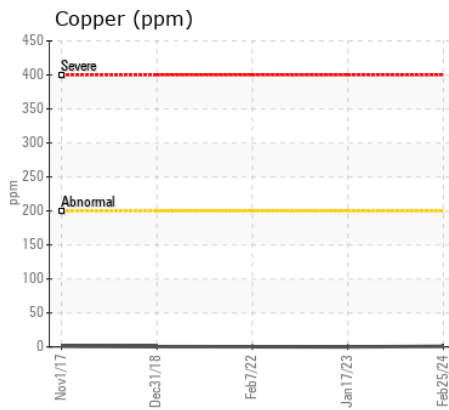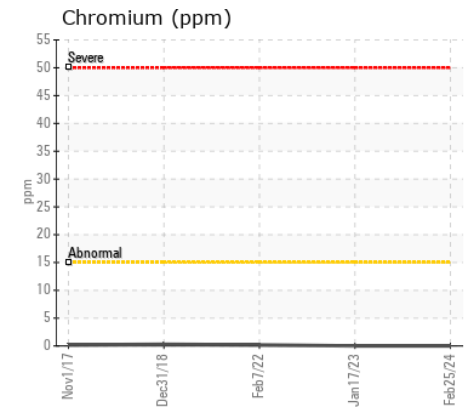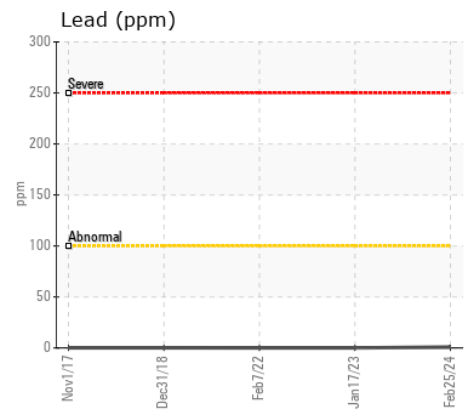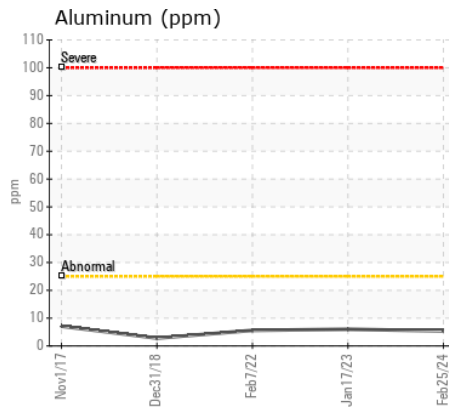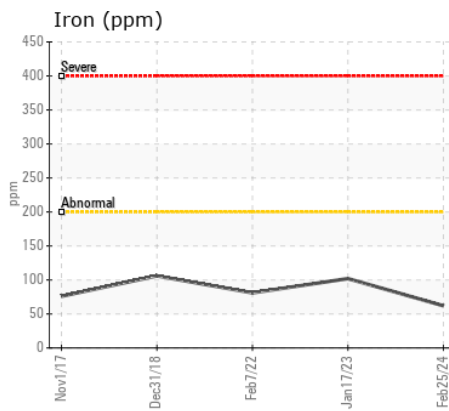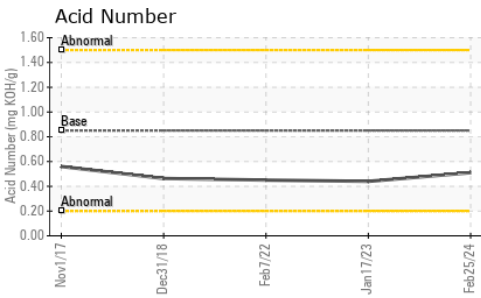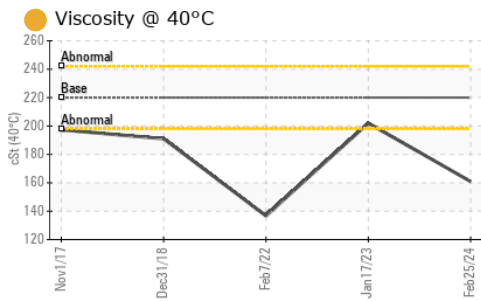

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0721336

Lab Number : 06100258

Unique Number : 10898488

Test Package : MOB 2

Received : 26 Feb 2024

Tested : 01 Mar 2024

Diagnosed : 01 Mar 2024 - Jonathan Hester

S.M. LORUSSO & SONS

221 NORFOLK ST.

WALPOLE, MA

US 02081

Contact: PAUL BECKMAN

pbeckman@smlorusso.com

T: (508)668-2603

F: (508)660-0232

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)