



# OIL ANALYSIS REPORT

|                 |        |
|-----------------|--------|
| WEAR            | NORMAL |
| CONTAMINATION   | NORMAL |
| FLUID CONDITION | NORMAL |



Machine Id  
**SJNM01BE**  
Component  
**Biogas Engine**  
Fluid

**CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor.

| Test           | UOM | Method      | Limit/Abn | Current            | History1    | History2    |
|----------------|-----|-------------|-----------|--------------------|-------------|-------------|
| Sample Number  |     | Client Info |           | <b>WC0865845</b>   | WC0865844   | WC0865701   |
| Sample Date    |     | Client Info |           | <b>22 Feb 2024</b> | 15 Feb 2024 | 08 Feb 2024 |
| Machine Age    | hrs | Client Info |           | <b>70531</b>       | 70362       | 70196       |
| Oil Age        | hrs | Client Info |           | <b>169</b>         | 996         | 830         |
| Filter Age     | hrs | Client Info |           | <b>335</b>         | 166         | 995         |
| Oil Changed    |     | Client Info |           | <b>Not Changed</b> | Changed     | Not Changed |
| Filter Changed |     | Client Info |           | <b>Changed</b>     | Not Changed | Changed     |
| Sample Status  |     |             |           | <b>NORMAL</b>      | ABNORMAL    | ABNORMAL    |

## WEAR

All component wear rates are normal.

|              |        |             |      |              |      |      |
|--------------|--------|-------------|------|--------------|------|------|
| Iron         | ppm    | ASTM D5185m | >15  | <b>&lt;1</b> | 3    | 2    |
| Chromium     | ppm    | ASTM D5185m | >4   | <b>0</b>     | <1   | 0    |
| Nickel       | ppm    | ASTM D5185m | >2   | <b>0</b>     | 0    | 0    |
| Titanium     | ppm    | ASTM D5185m |      | <b>0</b>     | <1   | 0    |
| Silver       | ppm    | ASTM D5185m | >5   | <b>0</b>     | 0    | 0    |
| Aluminum     | ppm    | ASTM D5185m | >6   | <b>2</b>     | 2    | <1   |
| Lead         | ppm    | ASTM D5185m | >9   | <b>2</b>     | 4    | 3    |
| Copper       | ppm    | ASTM D5185m | >6   | <b>&lt;1</b> | 1    | <1   |
| Tin          | ppm    | ASTM D5185m | >4   | <b>2</b>     | 3    | 2    |
| Vanadium     | ppm    | ASTM D5185m |      | <b>0</b>     | 0    | 0    |
| White Metal  | scalar | *Visual     | NONE | <b>NONE</b>  | NONE | NONE |
| Yellow Metal | scalar | *Visual     | NONE | <b>NONE</b>  | NONE | NONE |

## CONTAMINATION












There is no indication of any contamination in the oil.

|                  |          |             |       |                |       |       |
|------------------|----------|-------------|-------|----------------|-------|-------|
| Silicon          | ppm      | ASTM D5185m | >181  | <b>77</b>      | ▲ 184 | ▲ 188 |
| Potassium        | ppm      | ASTM D5185m | >20   | <b>1</b>       | 2     | 0     |
| Fuel             |          | WC Method   | >4.0  | <b>&lt;1.0</b> | <1.0  | <1.0  |
| Water            |          | WC Method   | >0.1  | <b>NEG</b>     | NEG   | NEG   |
| Glycol           |          | WC Method   |       | <b>NEG</b>     | NEG   | NEG   |
| Soot %           | %        | *ASTM D7844 |       | <b>0.1</b>     | 0.1   | 0.1   |
| Nitration        | Abs/cm   | *ASTM D7624 | >20   | <b>6.8</b>     | 8.2   | 8.1   |
| Sulfation        | Abs/.1mm | *ASTM D7415 | >30   | <b>18.5</b>    | 23.6  | 23.3  |
| Silt             | scalar   | *Visual     | NONE  | <b>NONE</b>    | NONE  | NONE  |
| Debris           | scalar   | *Visual     | NONE  | <b>NONE</b>    | NONE  | NONE  |
| Sand/Dirt        | scalar   | *Visual     | NONE  | <b>NONE</b>    | NONE  | NONE  |
| Appearance       | scalar   | *Visual     | NORML | <b>NORML</b>   | NORML | NORML |
| Odor             | scalar   | *Visual     | NORML | <b>NORML</b>   | NORML | NORML |
| Emulsified Water | scalar   | *Visual     | >0.1  | <b>NEG</b>     | NEG   | NEG   |

## FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

|                  |          |             |      |              |      |      |
|------------------|----------|-------------|------|--------------|------|------|
| Sodium           | ppm      | ASTM D5185m |      | <b>1</b>     | 0    | <1   |
| Boron            | ppm      | ASTM D5185m |      | <b>4</b>     | 3    | 2    |
| Barium           | ppm      | ASTM D5185m |      | <b>0</b>     | 10   | 0    |
| Molybdenum       | ppm      | ASTM D5185m |      | <b>4</b>     | 8    | 9    |
| Manganese        | ppm      | ASTM D5185m |      | <b>&lt;1</b> | 0    | 0    |
| Magnesium        | ppm      | ASTM D5185m |      | <b>25</b>    | 27   | 28   |
| Calcium          | ppm      | ASTM D5185m |      | <b>1903</b>  | 2147 | 2136 |
| Phosphorus       | ppm      | ASTM D5185m |      | <b>289</b>   | 396  | 325  |
| Zinc             | ppm      | ASTM D5185m |      | <b>362</b>   | 399  | 418  |
| Sulfur           | ppm      | ASTM D5185m |      | <b>1961</b>  | 2744 | 2403 |
| Oxidation        | Abs/.1mm | *ASTM D7414 | >25  | <b>13.1</b>  | 20.6 | 20.2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045  | 1.1  | <b>0.84</b>  | 1.74 | 1.62 |
| Base Number (BN) | mg KOH/g | ASTM D2896  | 5.4  | <b>4.74</b>  | 3.93 | 5.89 |
| Visc @ 100°C     | cSt      | ASTM D445   | 13.4 | <b>13.6</b>  | 14.4 | 14.3 |

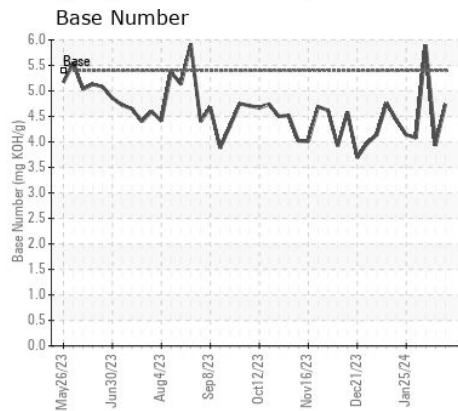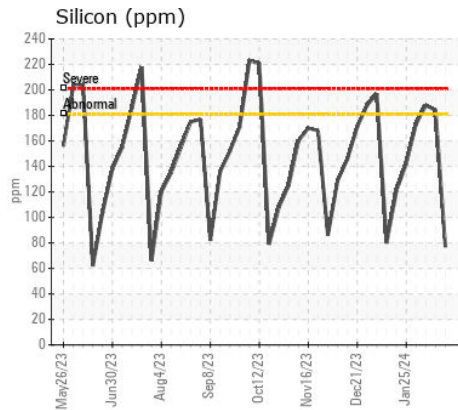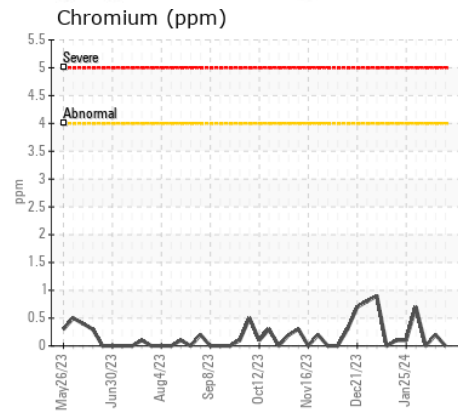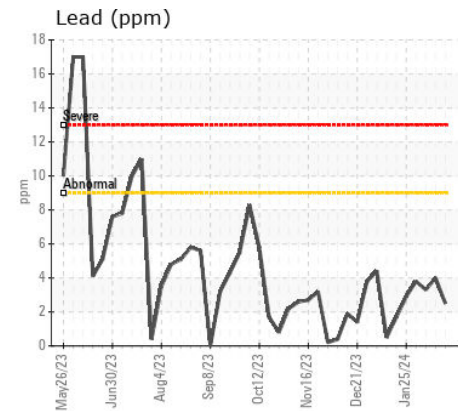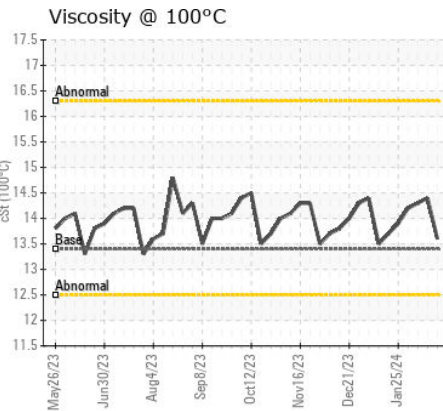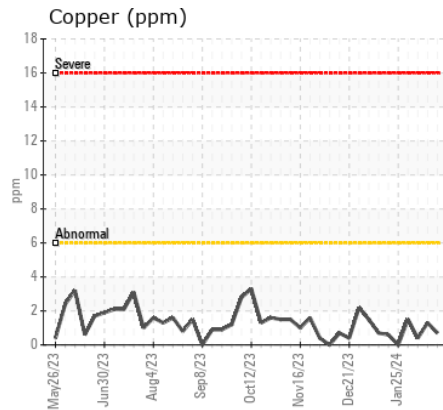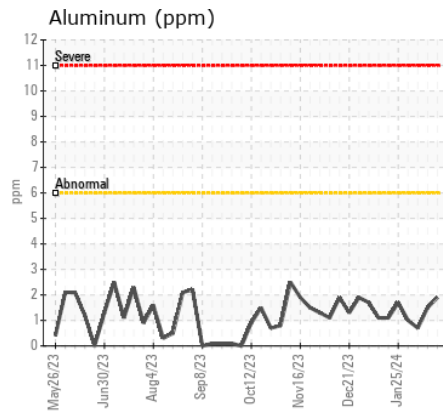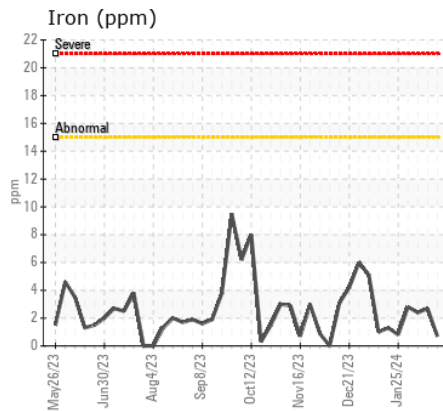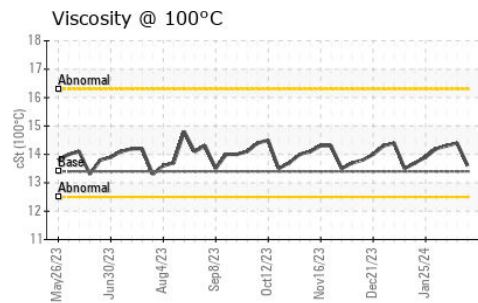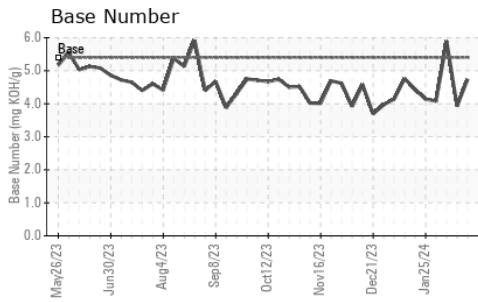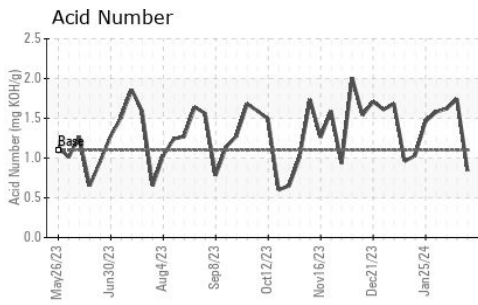

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0865845  
**Lab Number** : 06100286  
**Unique Number** : 10898516  
**Test Package** : MOB 2  
**Received** : 26 Feb 2024  
**Tested** : 27 Feb 2024  
**Diagnosed** : 28 Feb 2024 - Jonathan Hester

**EDL NA Recips-South Jordan**  
 South Jordan Powerstation, 10473 S. Bacchus Hwy.  
 South Jordan, UT  
 US 84095  
 Contact: Aaron Klein  
 aaron.klein@edlenergy.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)