



LUBE PLUS+

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL



Machine Id
CATERPILLAR CAT GEN
Component
Diesel Engine
Fluid
FLEET GUARD 15W40 (18 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		LP0001236	LP0001323	LP0000640
Sample Date		Client Info		03 Feb 2024	20 Nov 2023	02 Oct 2023
Machine Age	hrs	Client Info		10213	9614	9362
Oil Age	hrs	Client Info		250	254	250
Filter Age	hrs	Client Info		250	254	250
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>100	10	14	23
Chromium	ppm	ASTM D5185m	>20	<1	<1	<1
Nickel	ppm	ASTM D5185m	>2	<1	2	3
Titanium	ppm	ASTM D5185m	>2	0	<1	<1
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>25	<1	2	2
Lead	ppm	ASTM D5185m	>40	0	2	1
Copper	ppm	ASTM D5185m	>330	3	6	16
Tin	ppm	ASTM D5185m	>15	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	<1	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	2	3	4
Potassium	ppm	ASTM D5185m	>20	0	3	2
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844	>3	0.4	0.5	0.6
Nitration	Abs/cm	*ASTM D7624	>20	6.9	6.9	7.0
Sulfation	Abs/.1mm	*ASTM D7415	>30	16.6	17.5	19.2
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	2	1
Boron	ppm	ASTM D5185m		4	7	11
Barium	ppm	ASTM D5185m		0	0	10
Molybdenum	ppm	ASTM D5185m		13	28	61
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		163	436	753
Calcium	ppm	ASTM D5185m		1921	1754	1206
Phosphorus	ppm	ASTM D5185m		801	976	1035
Zinc	ppm	ASTM D5185m		1035	1169	1203
Sulfur	ppm	ASTM D5185m		3145	3453	3444
Oxidation	Abs/.1mm	*ASTM D7414	>25	9.8	11.9	15.2
Base Number (BN)	mg KOH/g	ASTM D2896		9.89	10.44	9.46
Visc @ 100°C	cSt	ASTM D445		12.5	12.8	12.6

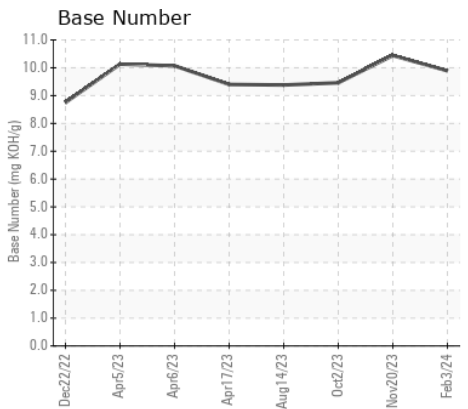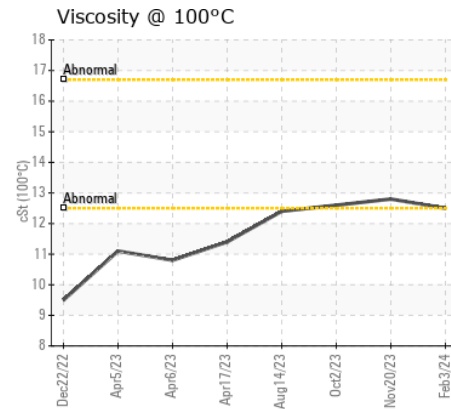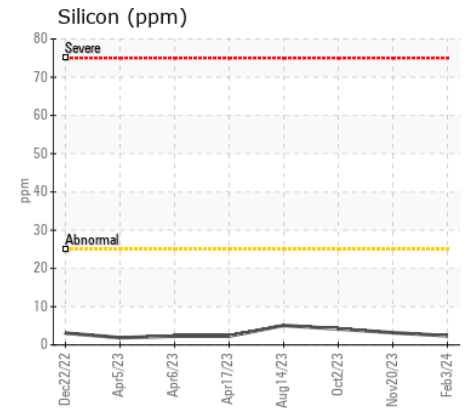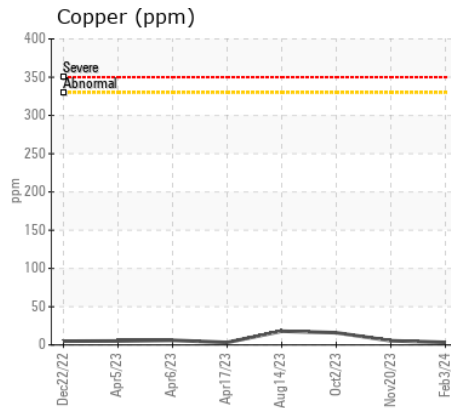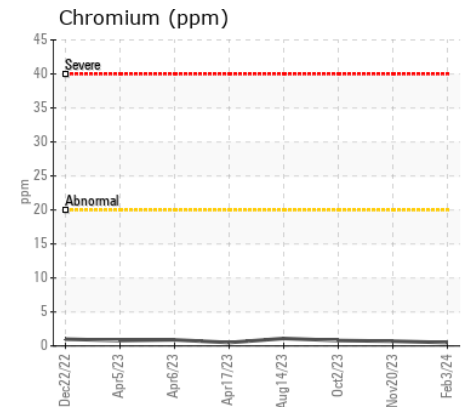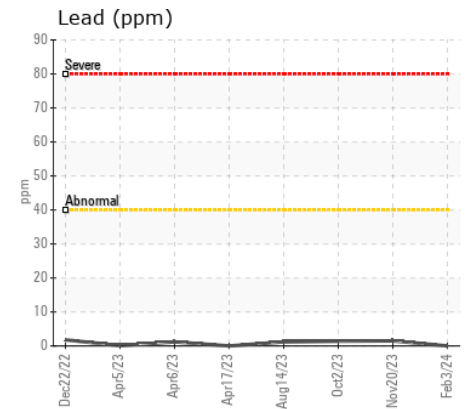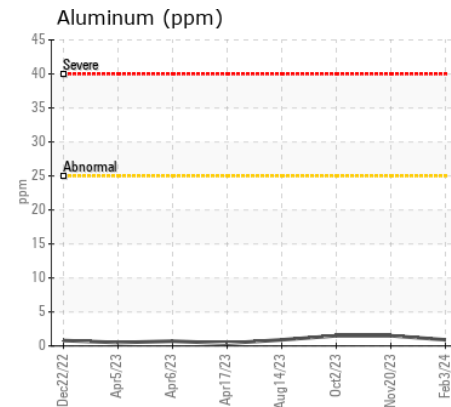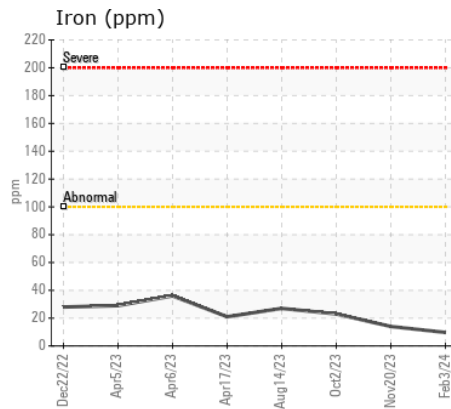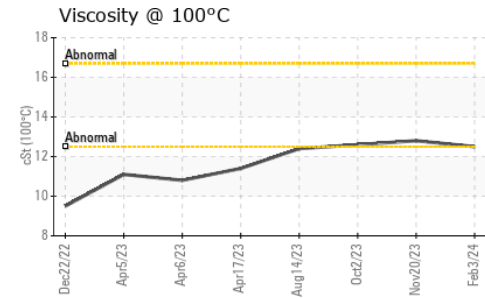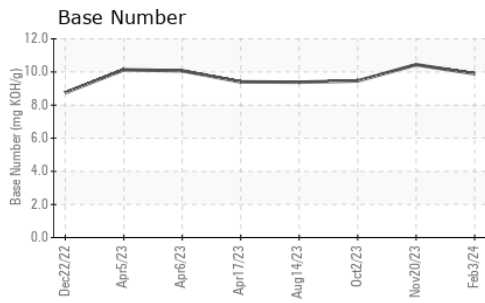

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : LP0001236
Lab Number : 06101151
Unique Number : 10899381
Test Package : MOB 2

Received : 26 Feb 2024
Tested : 28 Feb 2024
Diagnosed : 28 Feb 2024 - Wes Davis

S.M. LORUSSO & SONS
 10 GROVE ST
 WEST ROXBURY, MA
 US 02132
 Contact: MARK ERWIN
 merwin@smlorusso.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: